
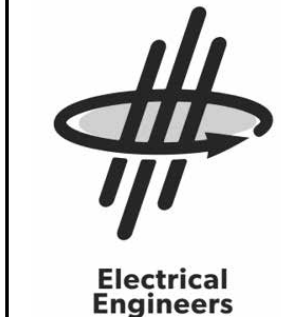


1. SEE SHEET E-202 FOR GENERAL LIGHTING NOTES

- 1 PROVIDE FIXTURE WITH EMERGENCY BATTERY PACK. FIXTURE NOTED FOR CLARITY.
- 2 COORDINATE EXACT MOUNTING HEIGHT PRIOR TO ELECTRICAL ROUGH-IN.
- 3 PROVIDE 365 DAY DIGITAL, PROGRAMMABLE TYPE ELECTRONIC CONTROL TIME CLOCK WITH MINIMUM 10 CONTACTS AND MINIMUM 96 ON/OFF EVENTS PER WEEK. CONTACTS RATED FOR MINIMUM 30 AMPS AND 120 VOLTS. PROVIDE WITH NEMA TYPE 1 ENCLOSURE AND CAPACITOR BACKUP. PROVIDE WITH AUTO-ON-OFF FUNCTION. PROVIDE AUXILIARY INPUT FROM PHOTO CELL FOR OVERRIDE ON OR OFF CONTROL.
- 4 ROUTE VIA 14 POLE EXTERIOR LIGHTING CONTACTOR/TIMECLOCK LOCATED ADJACENT PANEL. PHOTO CELL SHALL CONTROL DUSK TIL DAWN OPERATION. TIMECLOCK SHALL INTERRUPT CIRCUIT DURING MIDNIGHT HOURS. SEE KEYED NOTE 7. USE #10'S ENTIRE CIRCUIT IN 1 IN. C. UNLESS NOTED OTHERWISE. PROVIDE MANUAL OVERRIDE SWITCH. COORDINATE FINAL LOCATION WITH OWNER.
- 5 ADJUST LOCATION OF LIGHT FIXTURE AS REQUIRED FOR UNIMPEDED OPERATION OF OVERHEAD DOOR.
- 6 ADJUST LOCATION OF LIGHT FIXTURE AS REQUIRED FOR UNIMPEDED OPERATION OF RADIANT HEATERS AND HVLS FAN.
- 7 PROVIDE 365 DAY DIGITAL, PROGRAMMABLE TYPE ELECTRONIC CONTROL TIME CLOCK WITH MINIMUM 4 CONTACTS AND MINIMUM 96 ON/OFF EVENTS PER WEEK. CONTACTS RATED FOR MINIMUM 30 AMPS AND 120 VOLTS. PROVIDE WITH NEMA TYPE 1 ENCLOSURE AND CAPACITOR BACKUP. PROVIDE WITH AUTO-ON-OFF FUNCTION. PROVIDE AUXILIARY INPUT FROM PHOTO CELL FOR OVERRIDE ON OR OFF CONTROL.
- 8 ROUTE VIA 14 POLE EXTERIOR LIGHTING CONTACTOR/TIMECLOCK LOCATED ADJACENT PANEL. PHOTO CELL SHALL CONTROL DUSK TIL DAWN OPERATION. TIMECLOCK SHALL INTERRUPT CIRCUIT DURING MIDNIGHT HOURS. SEE KEYED NOTE 7. USE #10'S ENTIRE CIRCUIT IN 1 IN. C. UNLESS NOTED OTHERWISE. PROVIDE MANUAL OVERRIDE SWITCH. COORDINATE FINAL LOCATION WITH OWNER.
- 9 NO LIGHTING WORK IN TOWER.

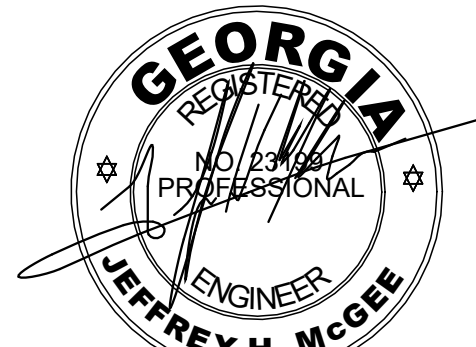

HIGHWAY 36
COVINGTON, GA 30014

[illegible]

Drawn By TAW	Checked By JHM
Date 07/17/2026	Job No. 25033

Sheet Title
LEVEL 1 - LIGHTING

Sheet No.

E-201

RELEASED FOR CONSTRUCTION