


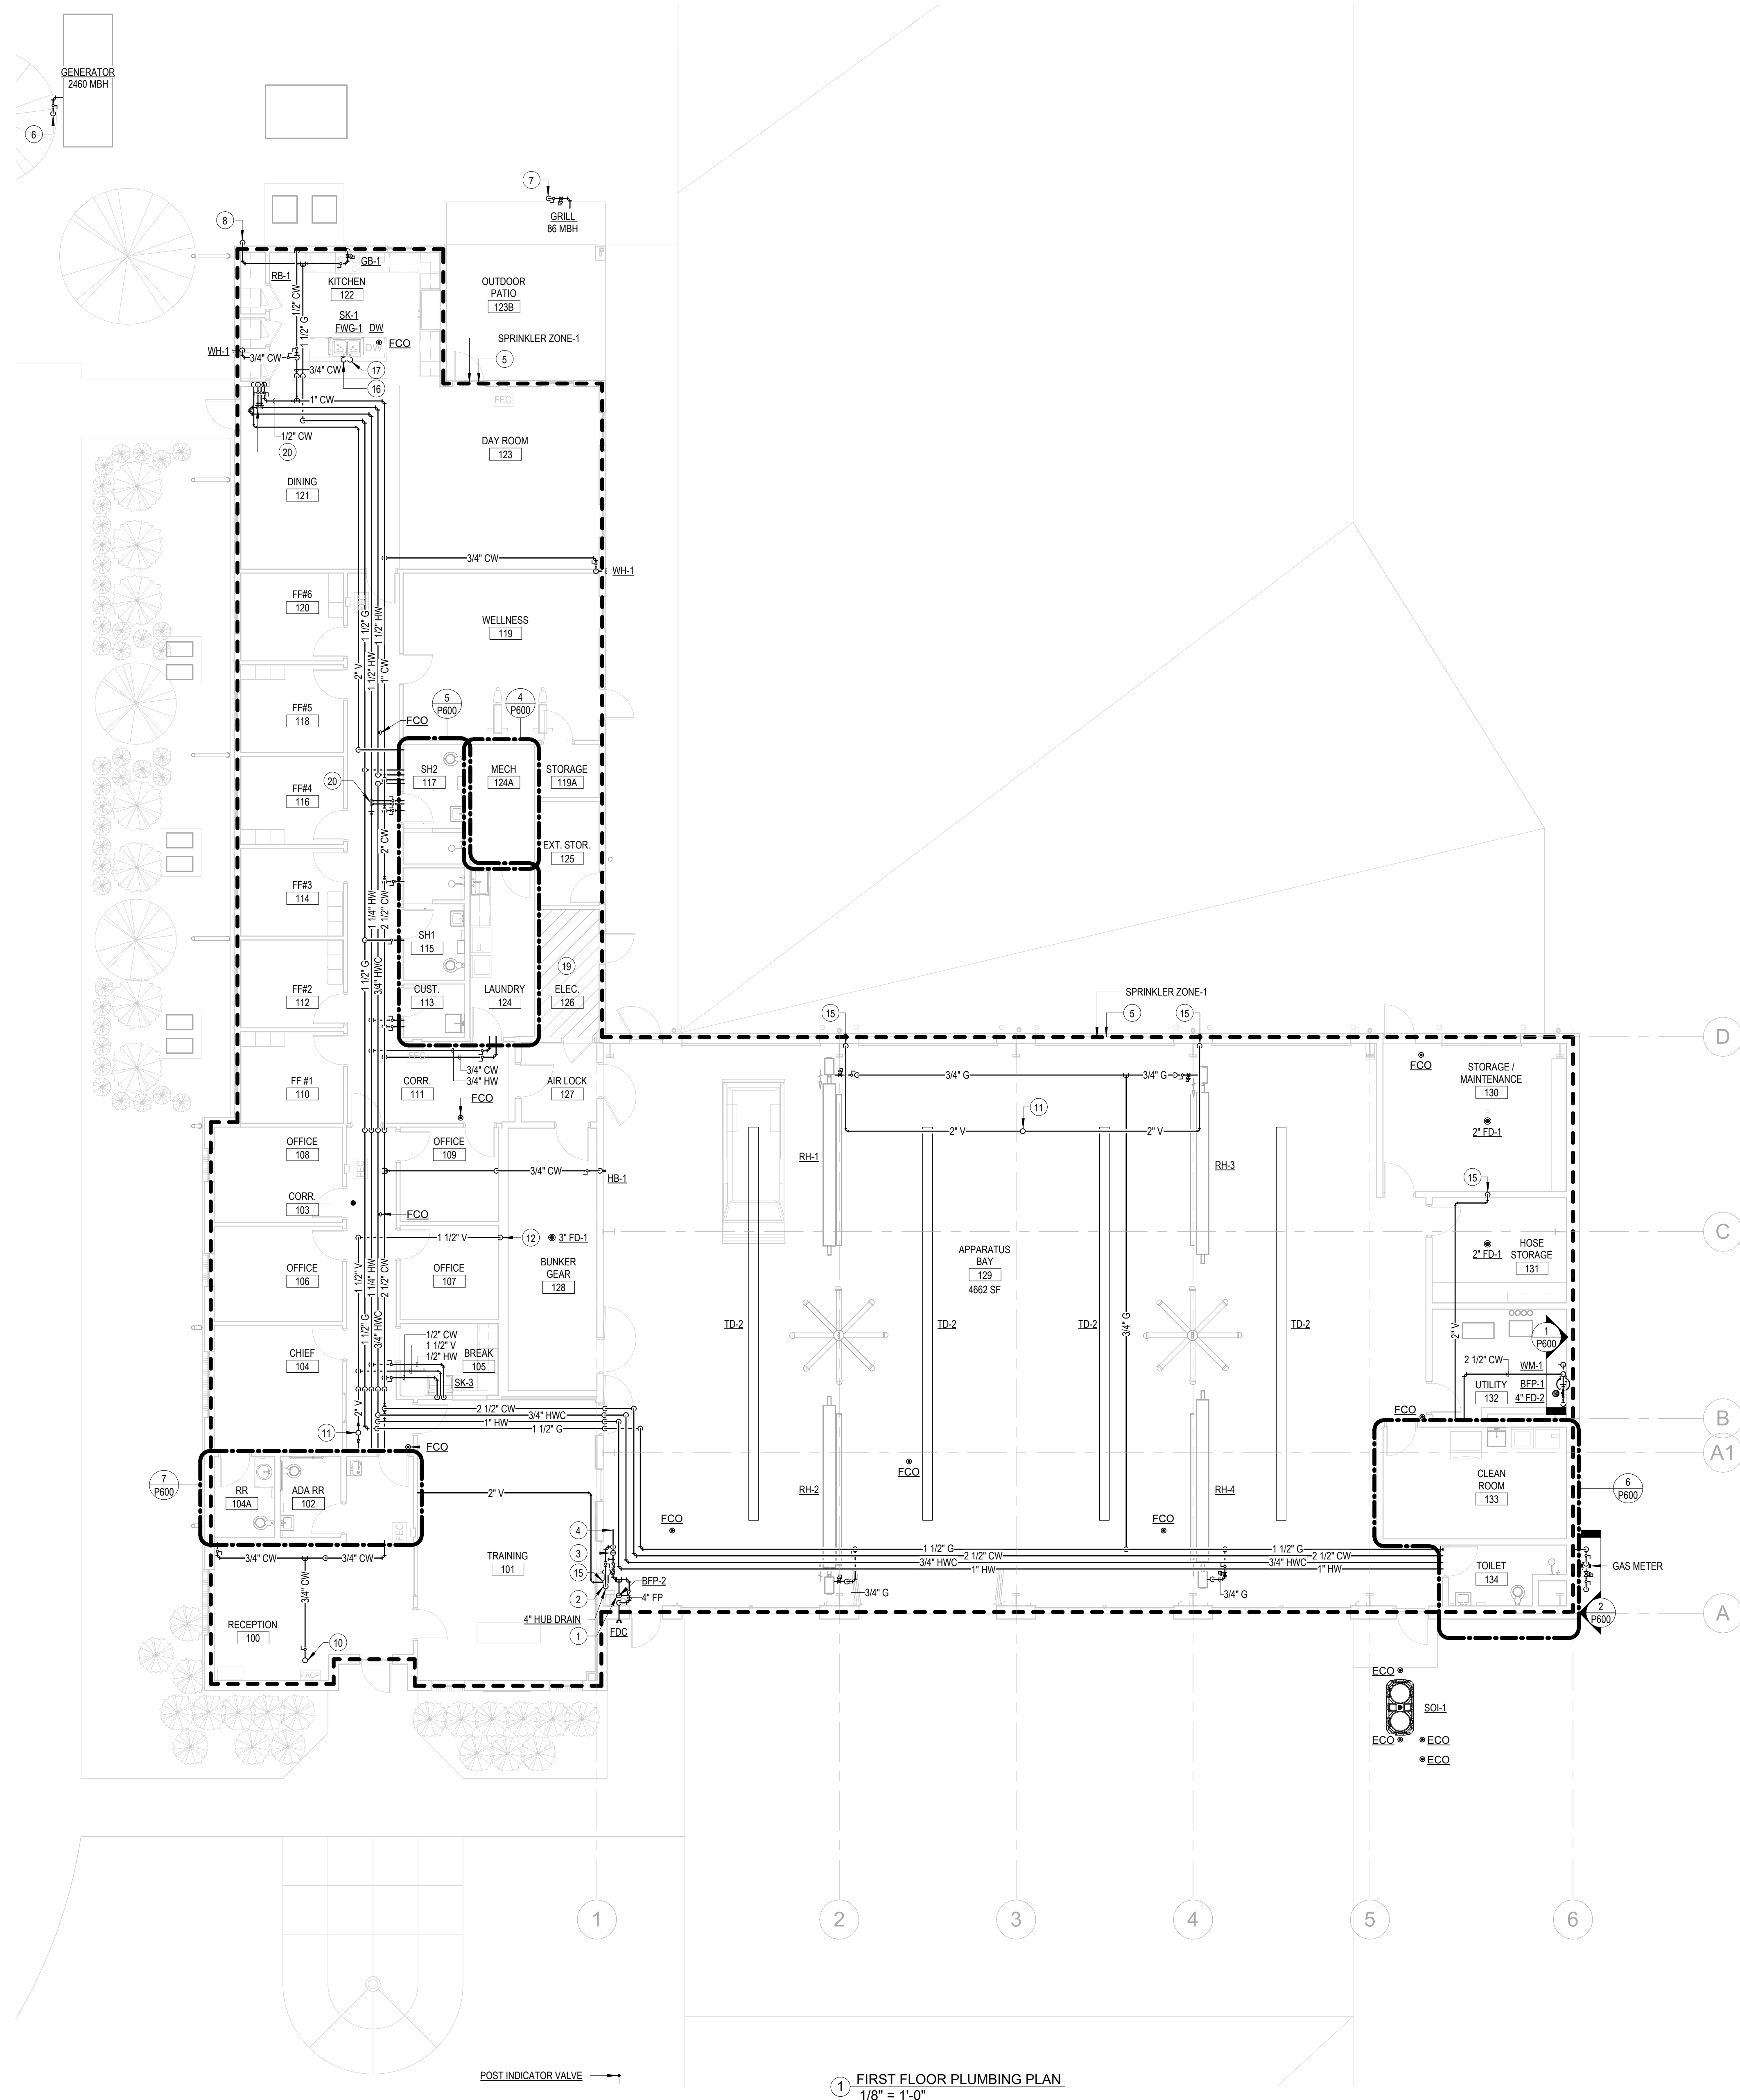

- PLAN NOTES**
- 4" FP DN.
 - 2" SPRINKLER DRAIN DISCHARGING TO OPEN SITE DRAIN.
 - ZONE CONTROL VALVE, FLOW SWITCH AND PRESSURE GAUGE.
 - 4" FP TO SERVE SPRINKLER ZONE-1. FP CONTRACTOR TO CONTINUE FROM THIS POINT.
 - WITHIN THIS OUTLINED AREA, THE FIRE PROTECTION CONTRACTOR SHALL INSTALL SPRINKLER MAINS, BRANCH PIPING, AND SPRINKLER HEADS AS REQUIRED TO COORDINATE WITH NEW CEILING LAYOUT AND OCCUPANCY REQUIREMENTS. CONTRACTOR SHALL PERFORM HYDRAULIC CALCULATIONS AND PROVIDE THE PROPER NUMBER OF SPRINKLER HEADS AND SPACING TO BE DESIGNED AND INSTALLED IN COMPLIANCE WITH NFPA AND ALL OTHER STATE AND LOCAL CODES.
 - 1-1/4" G FROM BELOW GRADE.
 - 3/4" G FROM BELOW GRADE.
 - 1-1/4" G DN TO BELOW GRADE AND SERVES GENERATOR AND GAS GRILL.
 - 3/4" CW UP.
 - 3" V UP TO 4" VTR.
 - 1-1/2" V DN.
 - 2" V DN.
 - 1/2" CW DN.
 - 1/2" HW DN.
 - NO PIPING ALLOWED IN THIS AREA UNLESS EXPLICITLY SHOWN.
 - FLOW SPLITTER VALVE (KEMPER-KHS FPT).