

Will Hunter Road Site

Power, Fiber, Natural Gas Source Context

Substation: 2000 Block, E. Lumpkin

To Ramsey Student Center via Riverbend Rd

WOODLAND HILLS

Electric aerial distribution lines from substations, typ.

NG line, 4" high pressure on Macon Hwy.

Will Hunter Road Site
access via S. Milledge Ave.

- Dual source utility power to site via two substations.
- Confirming capacity.
- Pricing new dedicated underground circuit via Will Hunter Substation.
- Fiber service on site.
- Capacity must be increased.

NG line, 1.25" low pressure along Will Hunter residential and under loop to Macon Hwy.

Substation: Will Hunter Rd.

NG line, 4" high pressure terminates near Milledge and Riverbend Rd.

NG line, 1.25" low pressure along Will Hunter residential and under loop to Macon Hwy.

Fiber (buried) via Ramsey Student Center
-Redundant Milledge Ave loop forthcoming

441

78


78

S Miller

Initial Draft Layout

Further Design Confirmation Required to Confirm Module Layout


Preliminary Layout: DATA POWER SOURCE/Kent distributed 2026.04.13

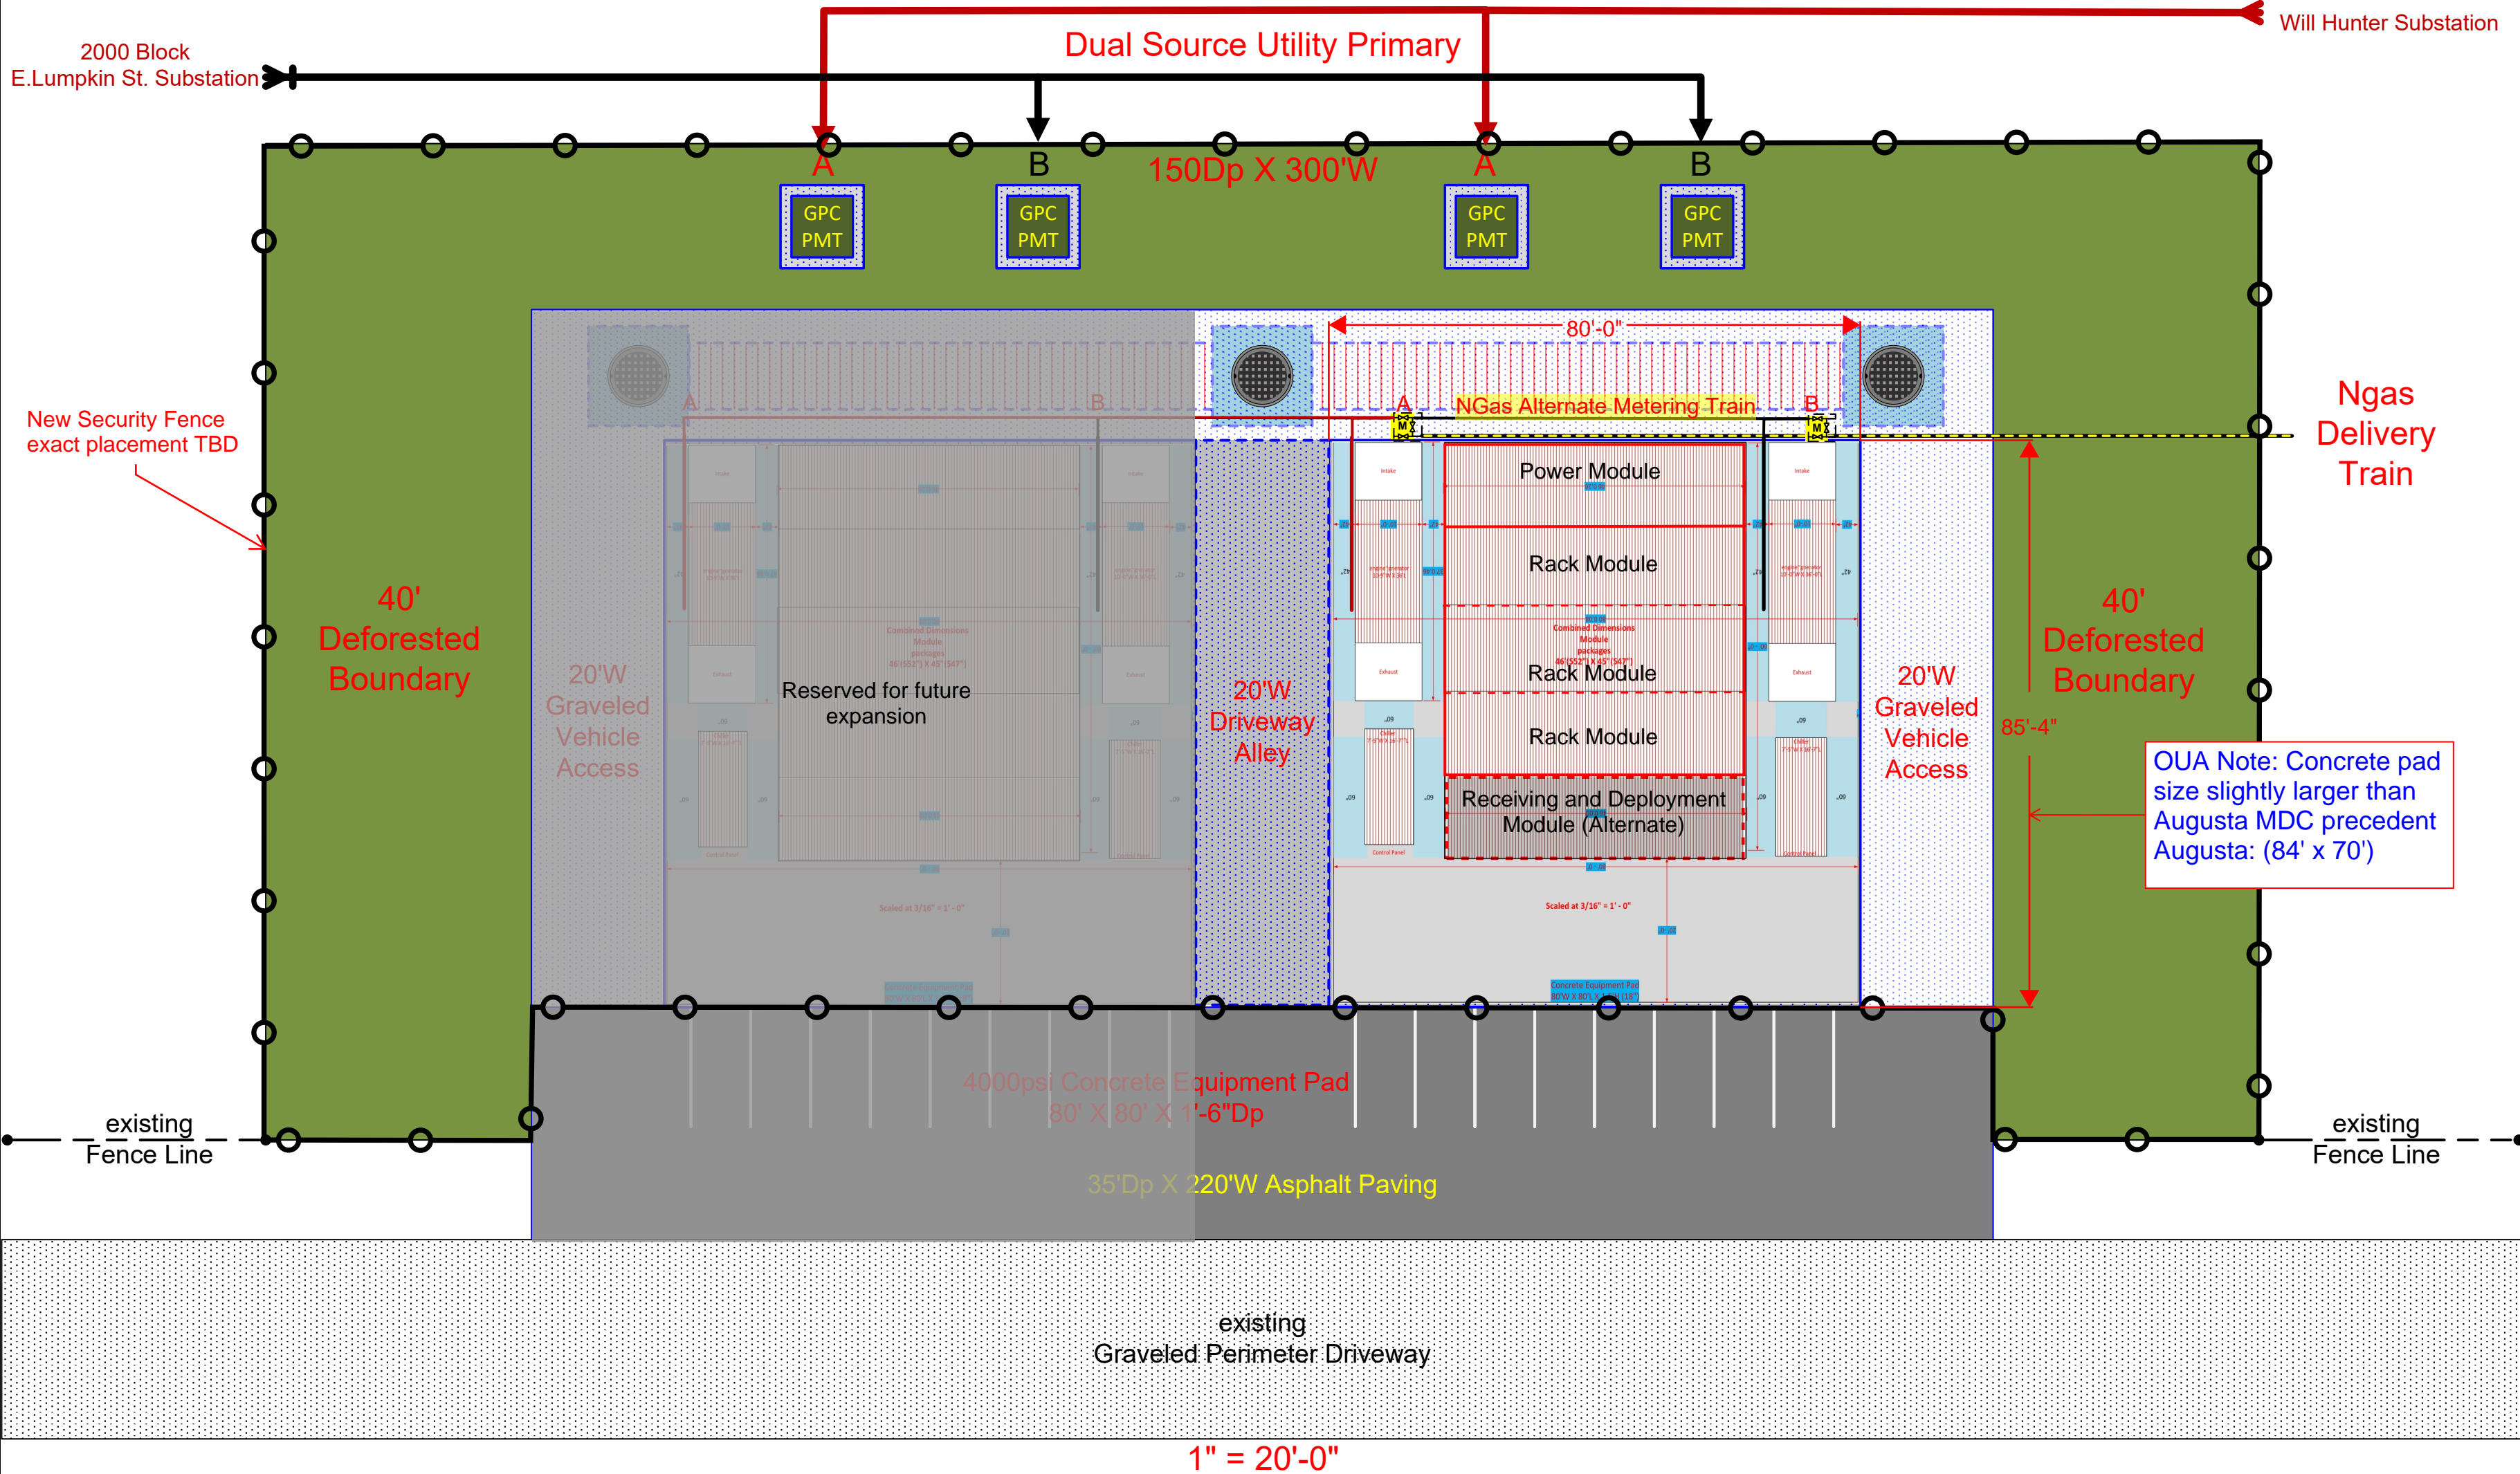

OUA Draft Layout

Data Power Source's 4/13 Preliminary Layout, amended for property constraints

Notes:
-Natural gas service not shown in this
-Diesel storage (alt. back-up fuel) not shown in this exhibit
-Stormwater management not shown in this exhibit

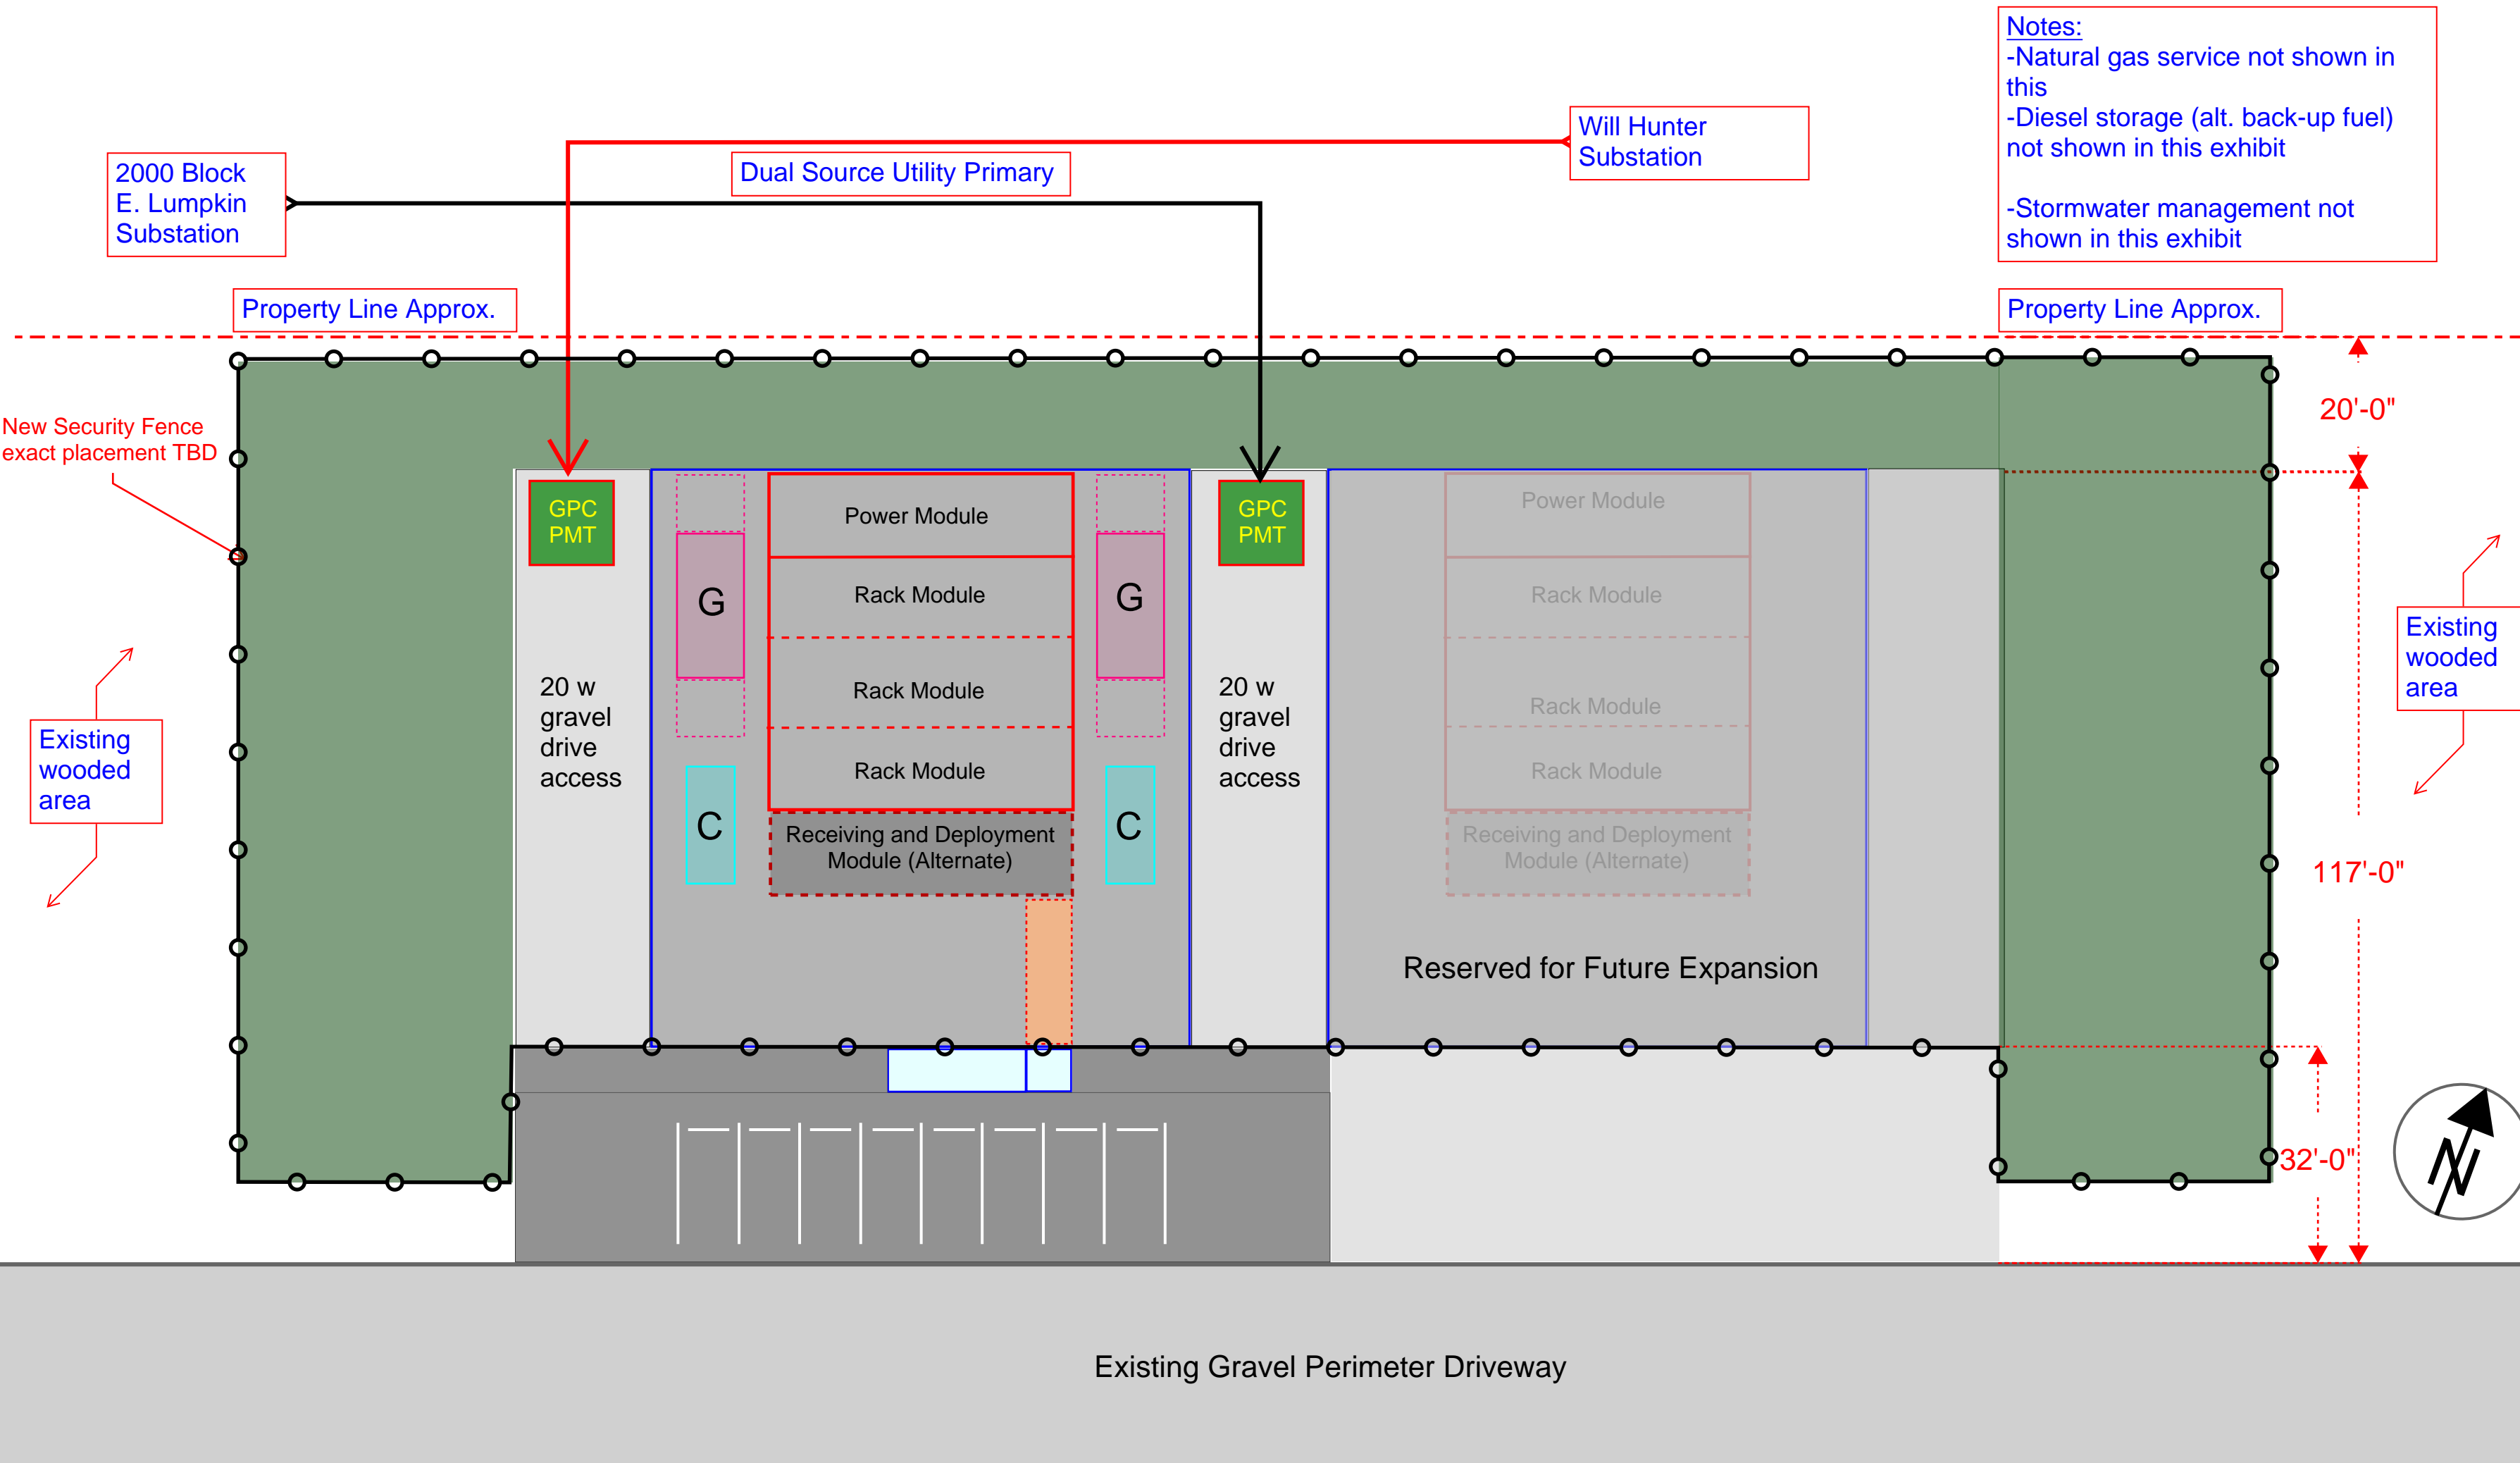



property line, typ.

ramp to covered entry

asphalt paving

20' w drive access

pad-mount transformers

20' w graveled vehicle access


Research Stores Admin. Building (2434) 2553 SF

UGAPD Storage (2435)

Note: Topography represented at 1' contour intervals

OUA Draft Layout
Data Power Source's 4/13 Prelim. Layout, amended for property constraints


Preliminary Layout: DATA POWER SOURCE/Kent distributed 2026.04.13

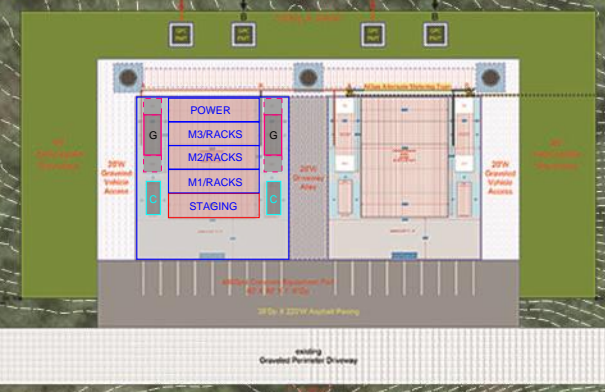

ACC Water Treatment Facility

Will Hunter Road Area

0 50 100 200 Feet

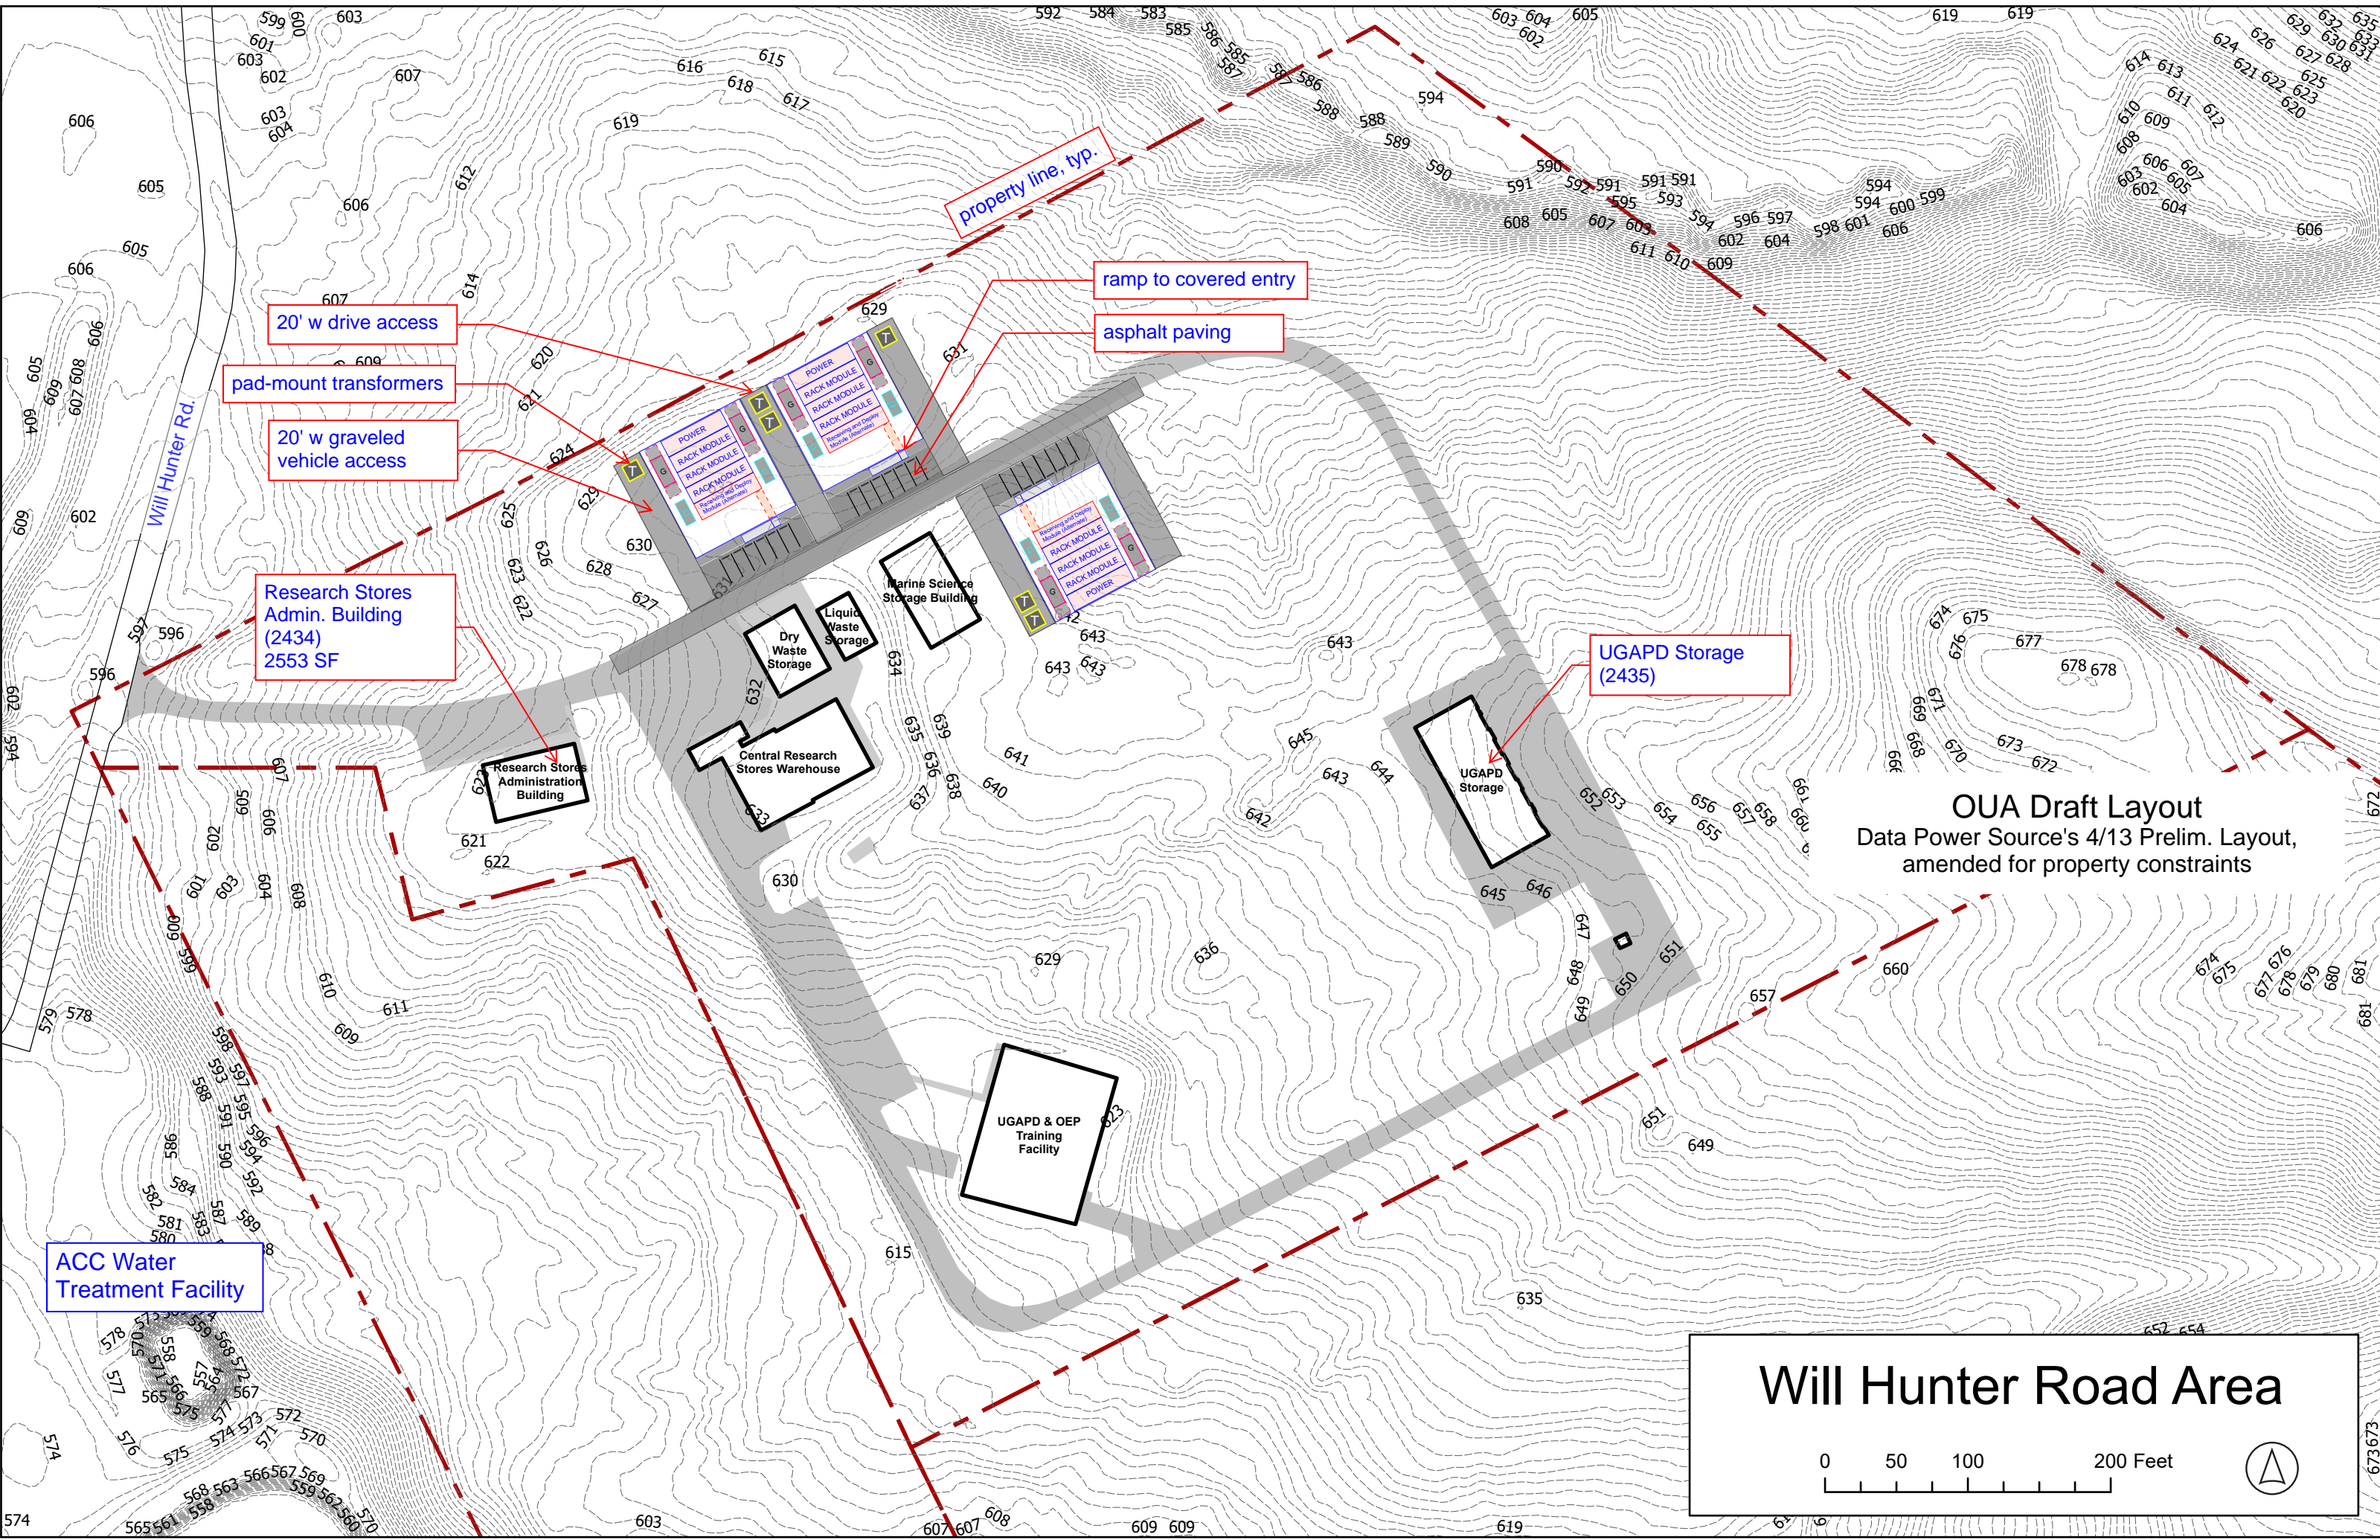

20' w drive access

pad-mount transformers

20' w graveled vehicle access

Research Stores Admin. Building (2434) 2553 SF

Research Stores Administration Building

Dry Waste Storage

Liquid Waste Storage

Marine Science Storage Building

Central Research Stores Warehouse

UGAPD & OEP Training Facility

UGAPD Storage (2435)

UGAPD Storage

property line, typ.

ramp to covered entry

asphalt paving

ACC Water Treatment Facility

OUA Draft Layout
Data Power Source's 4/13 Prelim. Layout,
amended for property constraints

Will Hunter Road Area

0 50 100 200 Feet