





PLAN LEGEND

-  NEW CONCRETE WALL
-  NEW C. M. U. WALL OR PARTITION
-  NEW BRICK WALL OR PARTITION
-  NEW STEEL STUD WALL OR PARTITION

PARTITION TYPES

NON-STRUCTURAL METAL FRAMING PARTITIONS
(DELEGATED DESIGN)

3-5/8" STEEL STUD PARTITIONS

- 9.4.1 3-5/8" STEEL STUDS AT 16" O. C. WITH 1 LAYER 5/8" GYPSUM BOARD ON ROOM SIDE FACE ONLY.
- 9.4.2 3-5/8" STEEL STUDS AT 16" O. C. WITH 1 LAYER 5/8" GYPSUM BOARD TYPE "X" ON EACH FACE & SOUND ATTENUATION INSULATION.
- 9.4.2L 3-5/8" STEEL STUDS AT 16" O. C. WITH 1 LAYER 5/8" GYPSUM BOARD TYPE "X" ON EACH FACE (4'-0" HIGH WALL)
- 9.4.3 3-5/8" STEEL STUDS AT 16" O. C. WITH 1 LAYER 5/8" GYPSUM BOARD TYPE "X" ON ROOM SIDE FACE ONLY & SOUND ATTENUATION INSULATION.
- 9.4.4 3-5/8" STEEL STUDS AT 16" O. C. WITH 1 LAYER 5/8" TYPE "X" GYPSUM BOARD ON EACH FACE & SOUND ATTENUATION INSULATION (UL DESIGN NO. U419) ONE HOUR RATED ASSEMBLY.
- 9.4.5 3-5/8" STEEL STUDS AT 16" O. C. WITH 2 LAYERS 5/8" TYPE "X" GYPSUM BOARD ON EACH FACE & SOUND ATTENUATION INSULATION (UL DESIGN NO. U419) TWO HOUR RATED ASSEMBLY.

6" STEEL STUD PARTITIONS

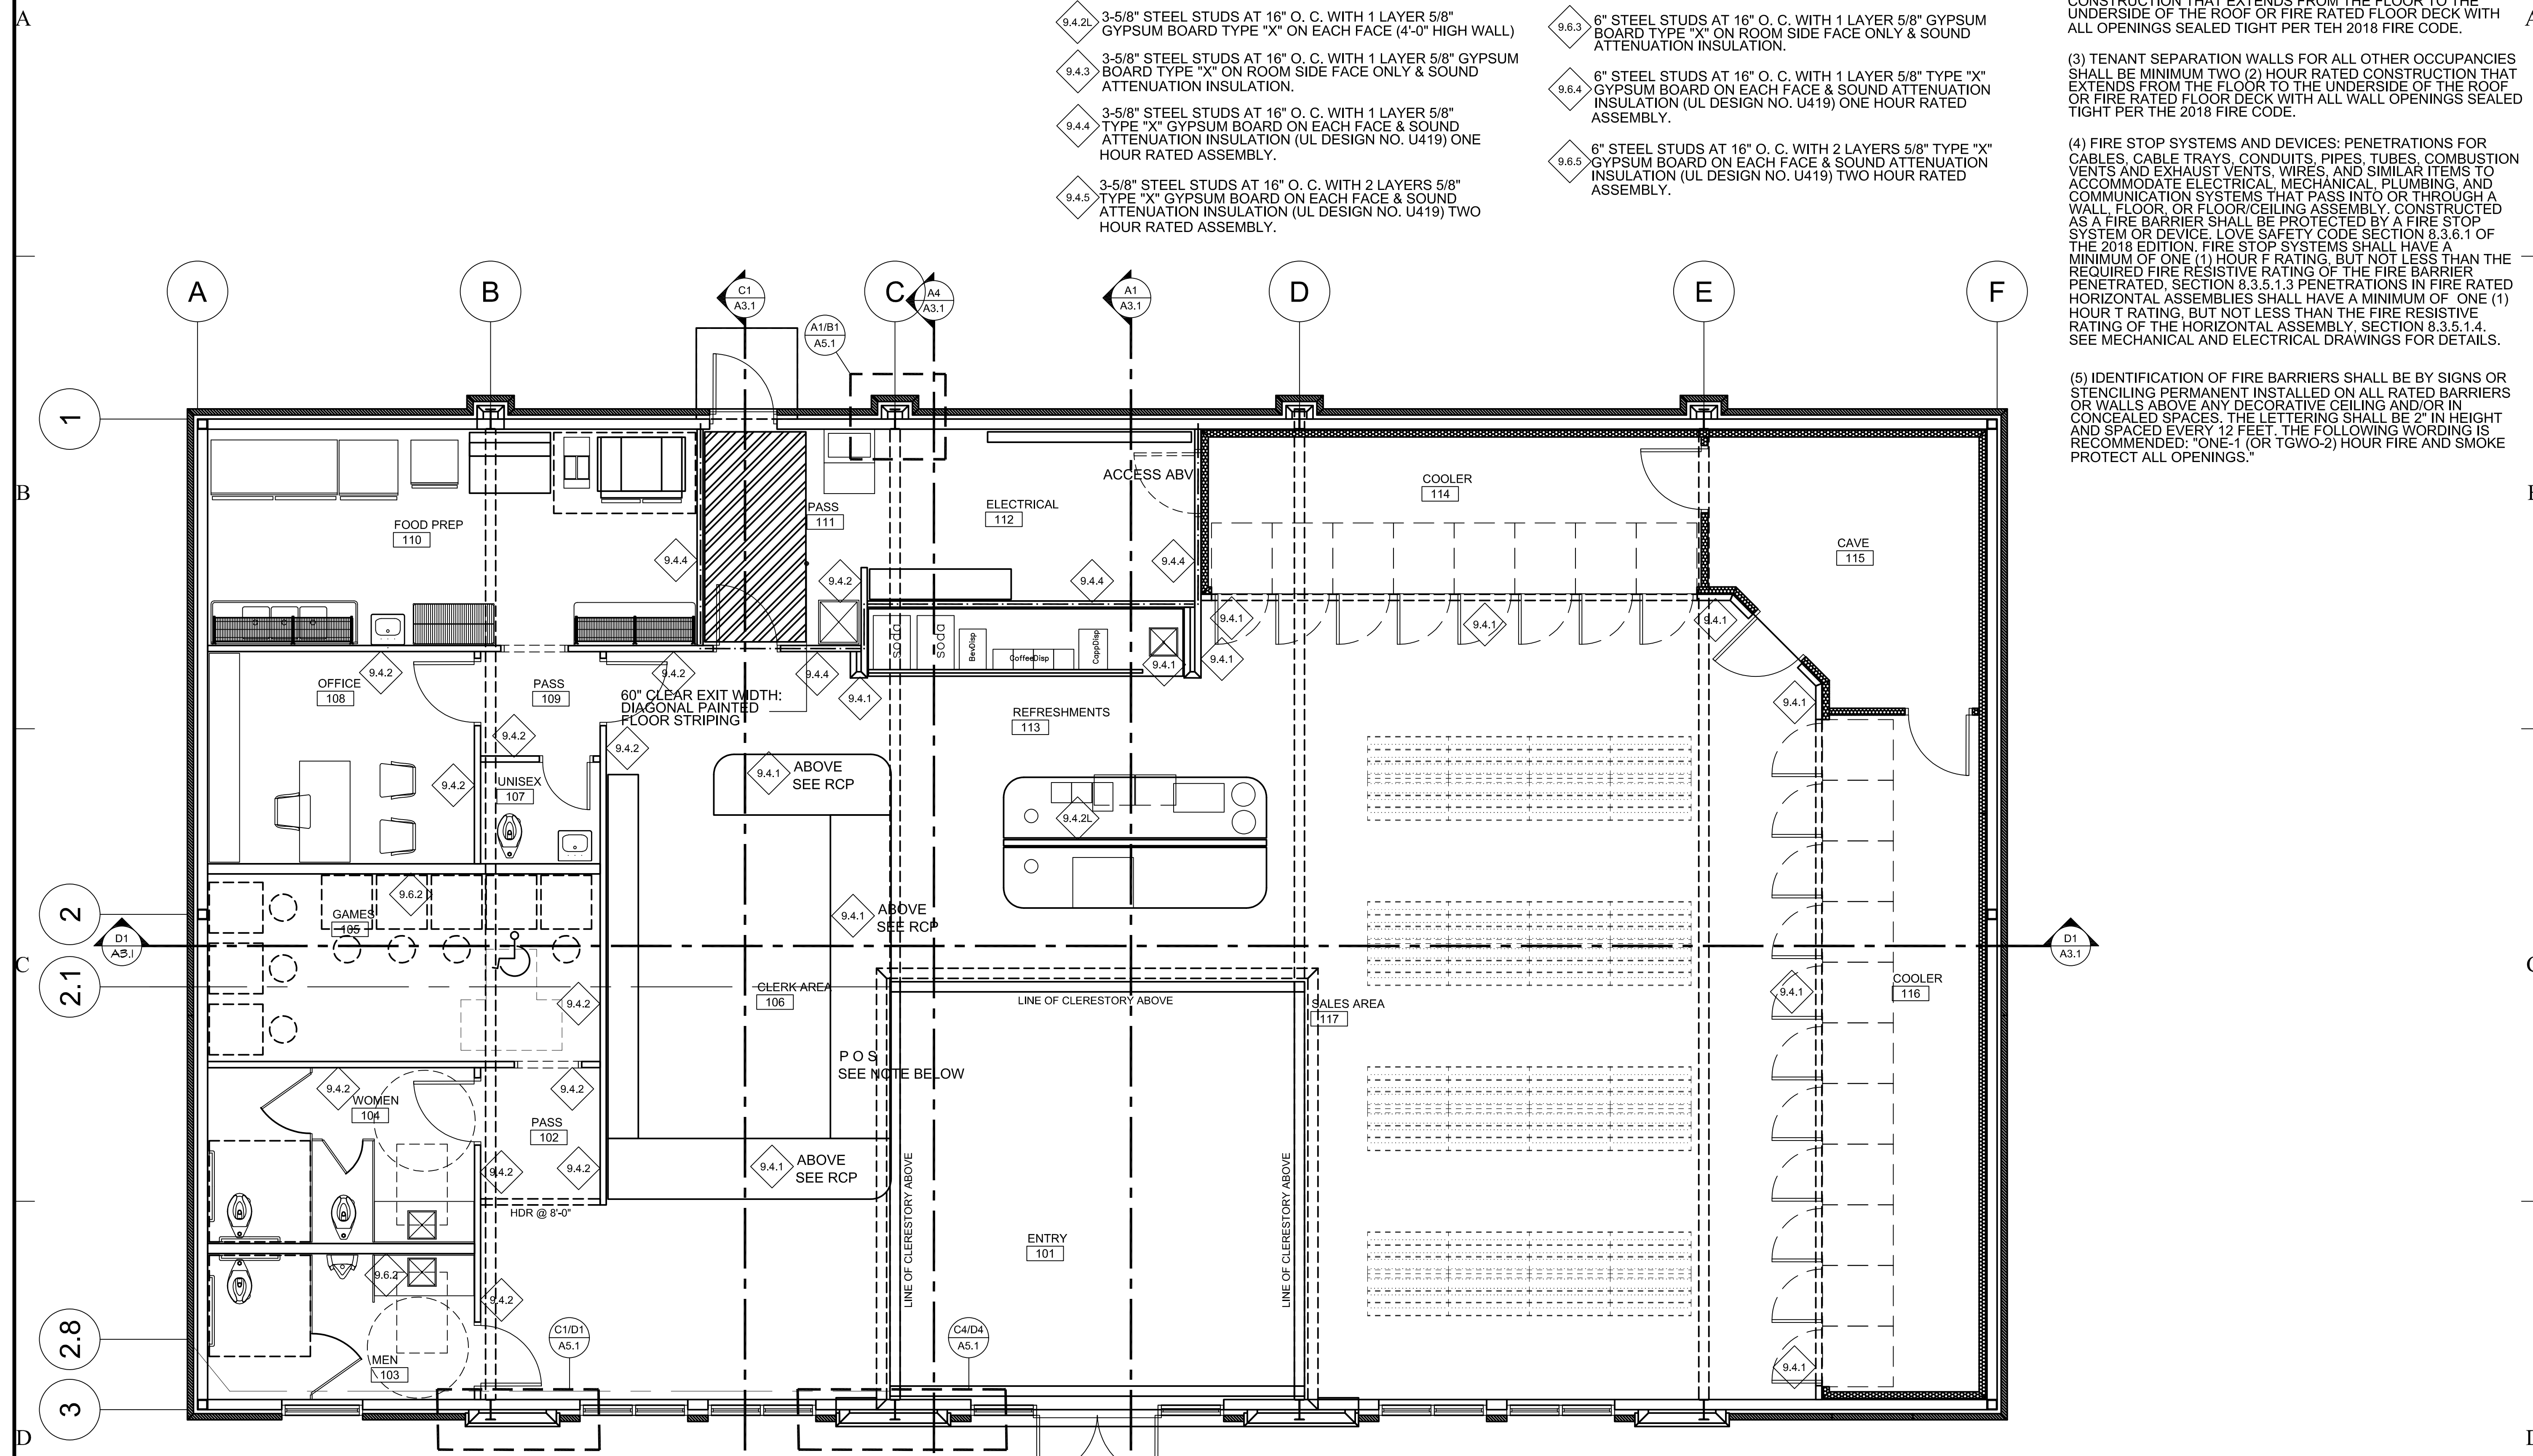
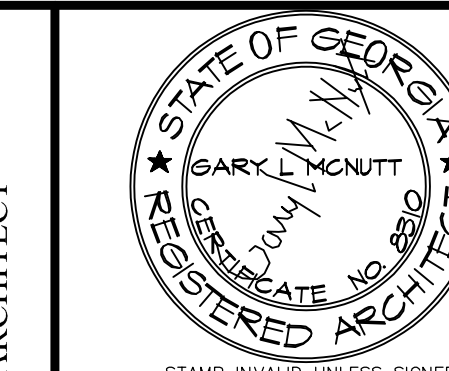
- 9.6.1 6" STEEL STUDS AT 16" O. C. WITH 1 LAYER 5/8" GYPSUM BOARD ON ROOM SIDE FACE ONLY.
- 9.6.2 6" STEEL STUDS AT 16" O. C. WITH 1 LAYER 5/8" GYPSUM BOARD TYPE "X" ON EACH FACE & SOUND ATTENUATION INSULATION.
- 9.6.3 6" STEEL STUDS AT 16" O. C. WITH 1 LAYER 5/8" GYPSUM BOARD TYPE "X" ON ROOM SIDE FACE ONLY & SOUND ATTENUATION INSULATION.
- 9.6.4 6" STEEL STUDS AT 16" O. C. WITH 1 LAYER 5/8" TYPE "X" GYPSUM BOARD ON EACH FACE & SOUND ATTENUATION INSULATION (UL DESIGN NO. U419) ONE HOUR RATED ASSEMBLY.
- 9.6.5 6" STEEL STUDS AT 16" O. C. WITH 2 LAYERS 5/8" TYPE "X" GYPSUM BOARD ON EACH FACE & SOUND ATTENUATION INSULATION (UL DESIGN NO. U419) TWO HOUR RATED ASSEMBLY.

GENERAL PARTITIONS NOTES:

- (1) ALL PARTITIONS TO TERMINATE AT UNDERSIDE OF ROOF STRUCTURE, FLOOR AND/OR ROOF DECK, UNLESS OTHERWISE NOTED. WALLS NOTED WITH A
- (2) TENANT SEPARATION WALLS FOR OTHER MERCANTILE OCCUPANCIES SHALL BE MINIMUM ONE (1) HOUR RATED CONSTRUCTION THAT EXTENDS FROM THE FLOOR TO THE UNDERSIDE OF THE ROOF OR FIRE RATED FLOOR DECK WITH ALL OPENINGS SEALED TIGHT PER THE 2018 FIRE CODE.
- (3) TENANT SEPARATION WALLS FOR ALL OTHER OCCUPANCIES SHALL BE MINIMUM TWO (2) HOUR RATED CONSTRUCTION THAT EXTENDS FROM THE FLOOR TO THE UNDERSIDE OF THE ROOF OR FIRE RATED FLOOR DECK WITH ALL WALL OPENINGS SEALED TIGHT PER THE 2018 FIRE CODE.
- (4) FIRE STOP SYSTEMS AND DEVICES; PENETRATIONS FOR CABLES, CABLE TRAYS, CONDUITS, PIPES, TUBES, COMBUSTION VENTS AND EXHAUST VENTS, WIRES, AND SIMILAR ITEMS TO ACCOMMODATE ELECTRICAL, MECHANICAL, PLUMBING, AND COMMUNICATION SYSTEMS THAT PASS INTO OR THROUGH A WALL, FLOOR, OR FLOOR/CEILING ASSEMBLY, CONSTRUCTED AS A FIRE BARRIER SHALL BE PROTECTED BY A FIRE STOP SYSTEM OR DEVICE. FIRE STOP SYSTEMS SHALL HAVE A MINIMUM OF ONE (1) HOUR F RATING, BUT NOT LESS THAN THE REQUIRED FIRE RESISTIVE RATING OF THE FIRE BARRIER PENETRATED. SECTION 8.3.5.1.3 PENETRATIONS IN FIRE RATED HORIZONTAL ASSEMBLIES SHALL HAVE A MINIMUM OF ONE (1) HOUR T RATING, BUT NOT LESS THAN THE FIRE RESISTIVE RATING OF THE HORIZONTAL ASSEMBLY, SECTION 8.3.5.1.4. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DETAILS.
- (5) IDENTIFICATION OF FIRE BARRIERS SHALL BE BY SIGNS OR STENCILING PERMANENTLY INSTALLED ON ALL RATED BARRIERS OR WALLS ABOVE ANY DECORATIVE CEILING AND/OR IN CONCEALED SPACES. THE LETTERING SHALL BE 2" IN HEIGHT AND SPACED EVERY 12 FEET. THE FOLLOWING WORDING IS RECOMMENDED: "ONE-1 (OR TWO-2) HOUR FIRE AND SMOKE PROTECT ALL OPENINGS."

GM
Architect

102 Sammy Court
WARNER ROBINS, GEORGIA 31088
gmarch@outlook.com
(478)-365-8976



P O S SALES AND SERVICE COUNTERS:
NOTE: CHECK-OUT AISLES, SALES COUNTER, SERVICE COUNTERS, FOOD SERVICE LINES, QUEUES, AND WAITING LINES SHALL COMPLY WITH SECTION 227 AND 904. PARALLEL APPROACH, A PORTION OF THE COUNTER SURFACE THAT IS 36 INCHES LONG MINIMUM AND 36 INCHES HIGH MAXIMUM ABOVE THE FINISH FLOOR SHALL BE PROVIDED. FORWARD APPROACH, A PORTION OF THE COUNTER SURFACE THAT IS 30 INCHES LONG MINIMUM AND 36 INCHES HIGH MAXIMUM SHALL BE PROVIDED. 2010 ADA STANDARD FOR ACCESSIBLE DESIGN. ALL CABINERY DESIGN, FABRICATION AND INSTALLATION BY GENERAL CONTRACTOR.

CONSULTANT

STAMP INVALID UNLESS SIGNED

New Facility
Hampton Travel Center
Hwy 81 / Parcel # 019-02031002 Hampton, Georgia 30253

JOB NO.:	02511
DRAWN BY:	GM
CHECKED BY:	GM
DESCRIPTION:	SCH-REVIEW
DATE:	00.00.25
DESCRIPTION:	DD-REVIEW
DATE:	00.00.25
DESCRIPTION:	CD-REVIEW
DATE:	01.12.26
DESCRIPTION:	BID-CONST
DATE:	00.00.26
REVISIONS:	
1	03.13.26
2	
3	
4	
5	
6	
7	

THESE DRAWINGS ARE THE PROPERTY OF GM ARCHITECT AND ARE NOT TO BE REPRODUCED OR REUSED WITHOUT PERMISSION AND CREDIT.
COPYRIGHT © 2025

SHEET
A1.1
OF