


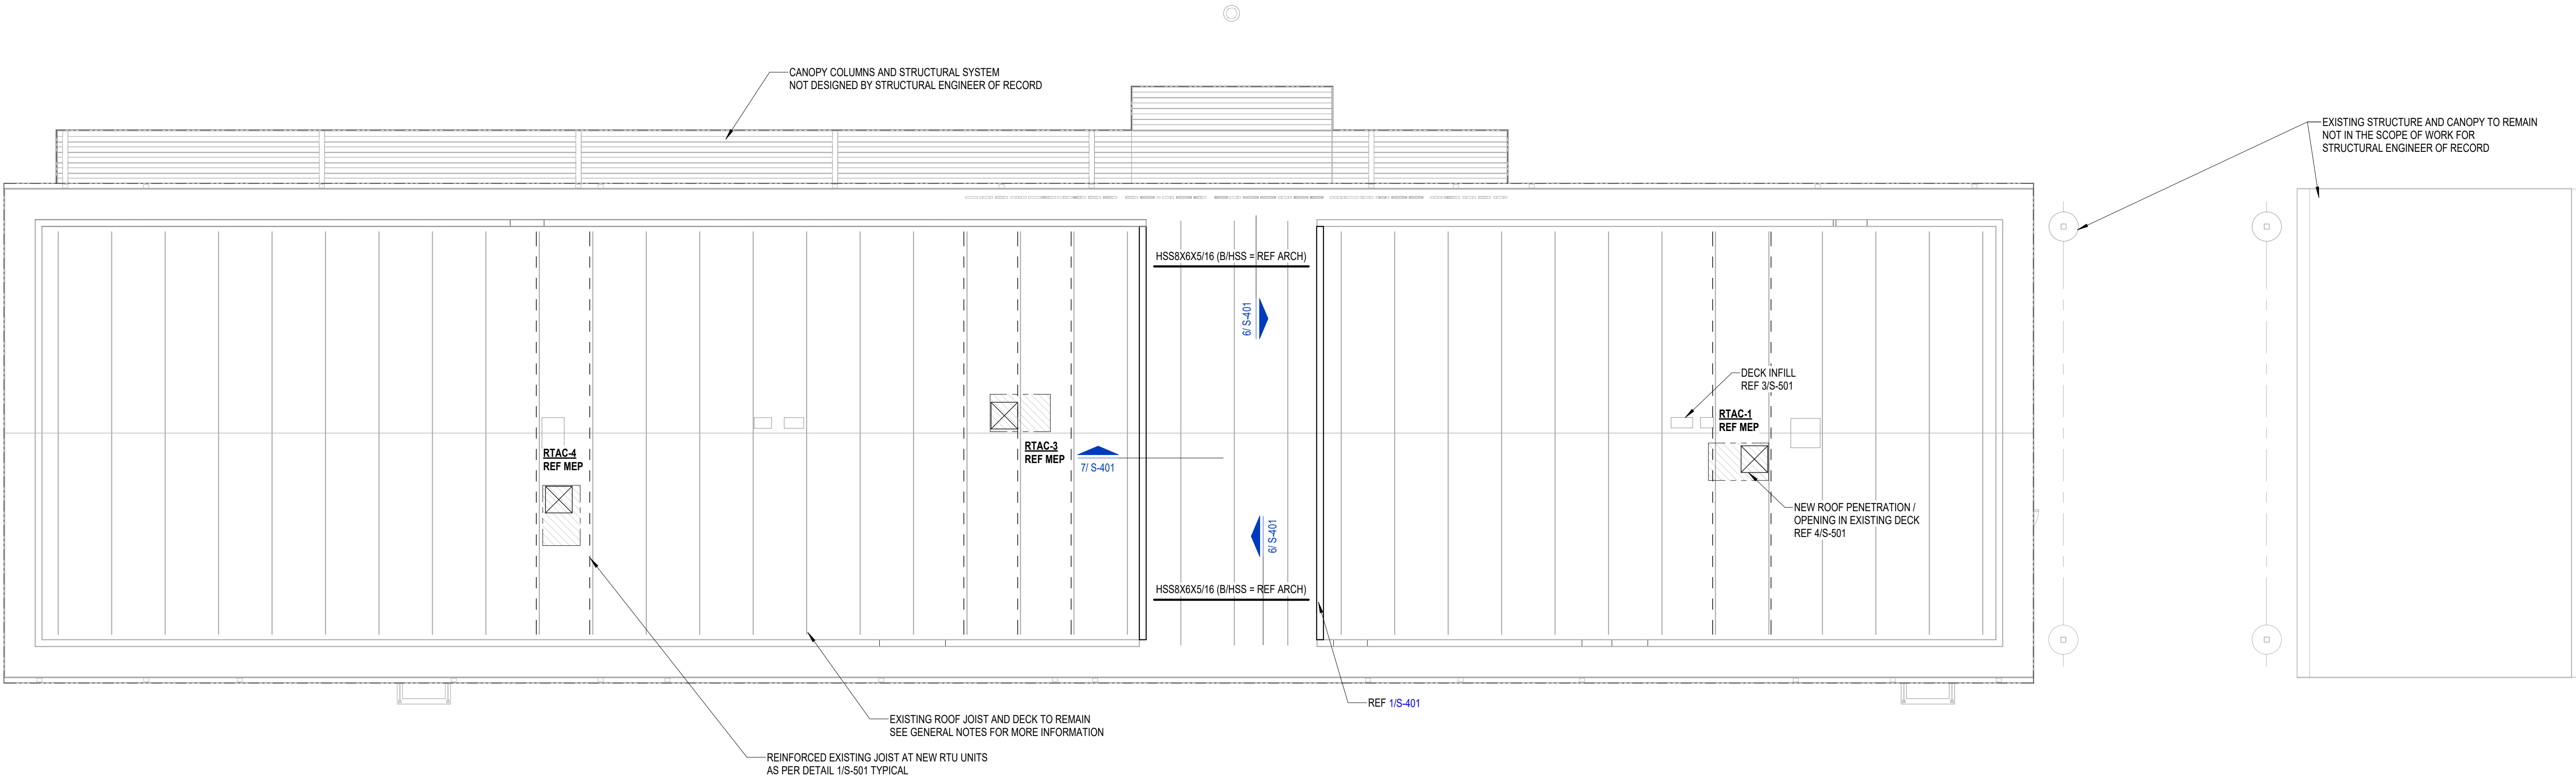

- GENERAL NOTES:
1. GC COORDINATE WITH MECHANICAL FOR LOCATIONS OF NEW RTUS AND ALERT STRUCTURAL EOR IF RTU'S FINAL LOCATION DIFFERS MORE THAN 3 FEET FROM WHAT IS SHOWN ON THIS PLAN.

2. GC COORDINATE WITH MECHANICAL FOR NEW ROOF ENETRATIONS, SIZES AND LOCATIONS. FIELD VERIFY EXACT INSTALL LOCATION TO AVOID CONFLICT OF OPENINGS WITH STRUCTURAL MEMBERS. DO NOT CUT JOIST/STRUCTURAL MEMBERS FOR OPENING TYP. NOTIFY EOR OF ANY SUCH CONFLICT. REF 4/S-501 FOR NEW PENETRATION/OPENING AT ROOF.

3. GC COORDINATE WITH MECHANICAL AND FIELD VERIFY EXACT LOCATION OF THE EXISTING PENETRATION TO BE INFILL TYP. REF 3/S-501 FOR INFILL DETAIL AT EXISTING MECHANICAL OPENING AT ROOF.

- ROOF PLAN NOTES
1. DETAILING OF ALL MEMBER CONNECTIONS TO THE SUPPORTS SHALL BE PERFORMED TO SATISFY LATEST OSHA ERECTION REQUIREMENTS.

2. TOS EL = BOTTOM OF DECK.

3. JOISTS OR FRAMING SHOWN ON PLAN ARE FOR REFERENCE ONLY. CONTRACTOR SHALL FIELD VERIFY EXACT JOIST LOCATION AND FRAMING CONDITIONS PRIOR TO INSTALLATION OF ANY RTU UNITS OR ROOF OPENINGS.

4. ALL STRUCTURAL STEEL THAT IS PERMANENTLY EXPOSED TO THE EXTERIOR OR IS PERMANENTLY IN UNCONDITIONED SPACE SHALL BE HOT-DIPPED GALVANIZED.

5. GC COORDINATE ALL PENETRATIONS WITH MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS. REFER TO TYPICAL DETAILS FOR ADDITIONAL REQUIREMENTS.

6. CONTRACTOR TO VERIFY ALL SLAB EDGE DIMENSIONS WITH ARCHITECTURAL DRAWINGS PRIOR TO CONSTRUCTION.

7. REF S-6XX SERIES DRAWINGS FOR GENERAL NOTES AND TYP DETAILS


8. S-6XX SERIES DRAWINGS FOR STEEL FRAMING DETAILS.

10. EXISTING ROOF DECK IS ASSUMED TO BE 1-1/2" TYPE B, 22 GA METAL DECK. CONTRACTOR SHALL FIELD VERIFY DECK PROFILE AND GAGE. NOTIFY ENGINEER OF RECORD IF FIELD CONDITIONS DIFFER PRIOR TO PROCEEDING WITH WORK.

11. PROVIDE 36/7 PATTERN 5/8" PUDDLE WELD W/3#10 TEK SCREW SIDE LAP (IF NEEDED) DECK ATTACHMENT TO ROOF FRAMING MEMBERS.

- EXISTING STEEL NOTES:
1. FIELD VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS PRIOR TO FABRICATION OF NEW STEEL. NOTIFY ARCHITECT / ENGINEER OF ANY DISCREPANCIES. ANY APPROVED CHANGES SHALL BE INCORPORATED INTO THE ERECTION / SHOP DRAWINGS PRIOR TO SUBMISSION.

2. EXISTING CHANNEL AND TUBE ROOF FRAMES ARE LIKELY TOO SMALL FOR NEW UNITS. IN ORDER TO PROPERLY ALIGN WITH THE CURBS, PROVIDE NEW ROOF FRAMES PER DETAIL 1/S-501 AS REQUIRED TO ENSURE NEW UNIT CURBS ARE SUPPORTED ON A ROOF FRAME. IF EXISTING FRAMES MATCH THE NEW CURBS, IT IS ACCEPTABLE TO USE THE EXISTING ROOF FRAMES.

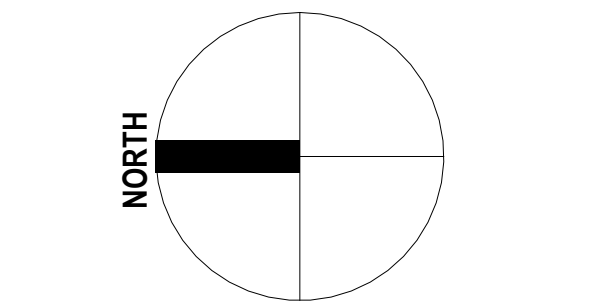

CLIENT		
DATE		PROJECT NUMBER
03 / 12 / 2026		250306
DRAWING HISTORY		
No.	Description	Date
CHECKED BY: SB		
DRAWN BY: SB		