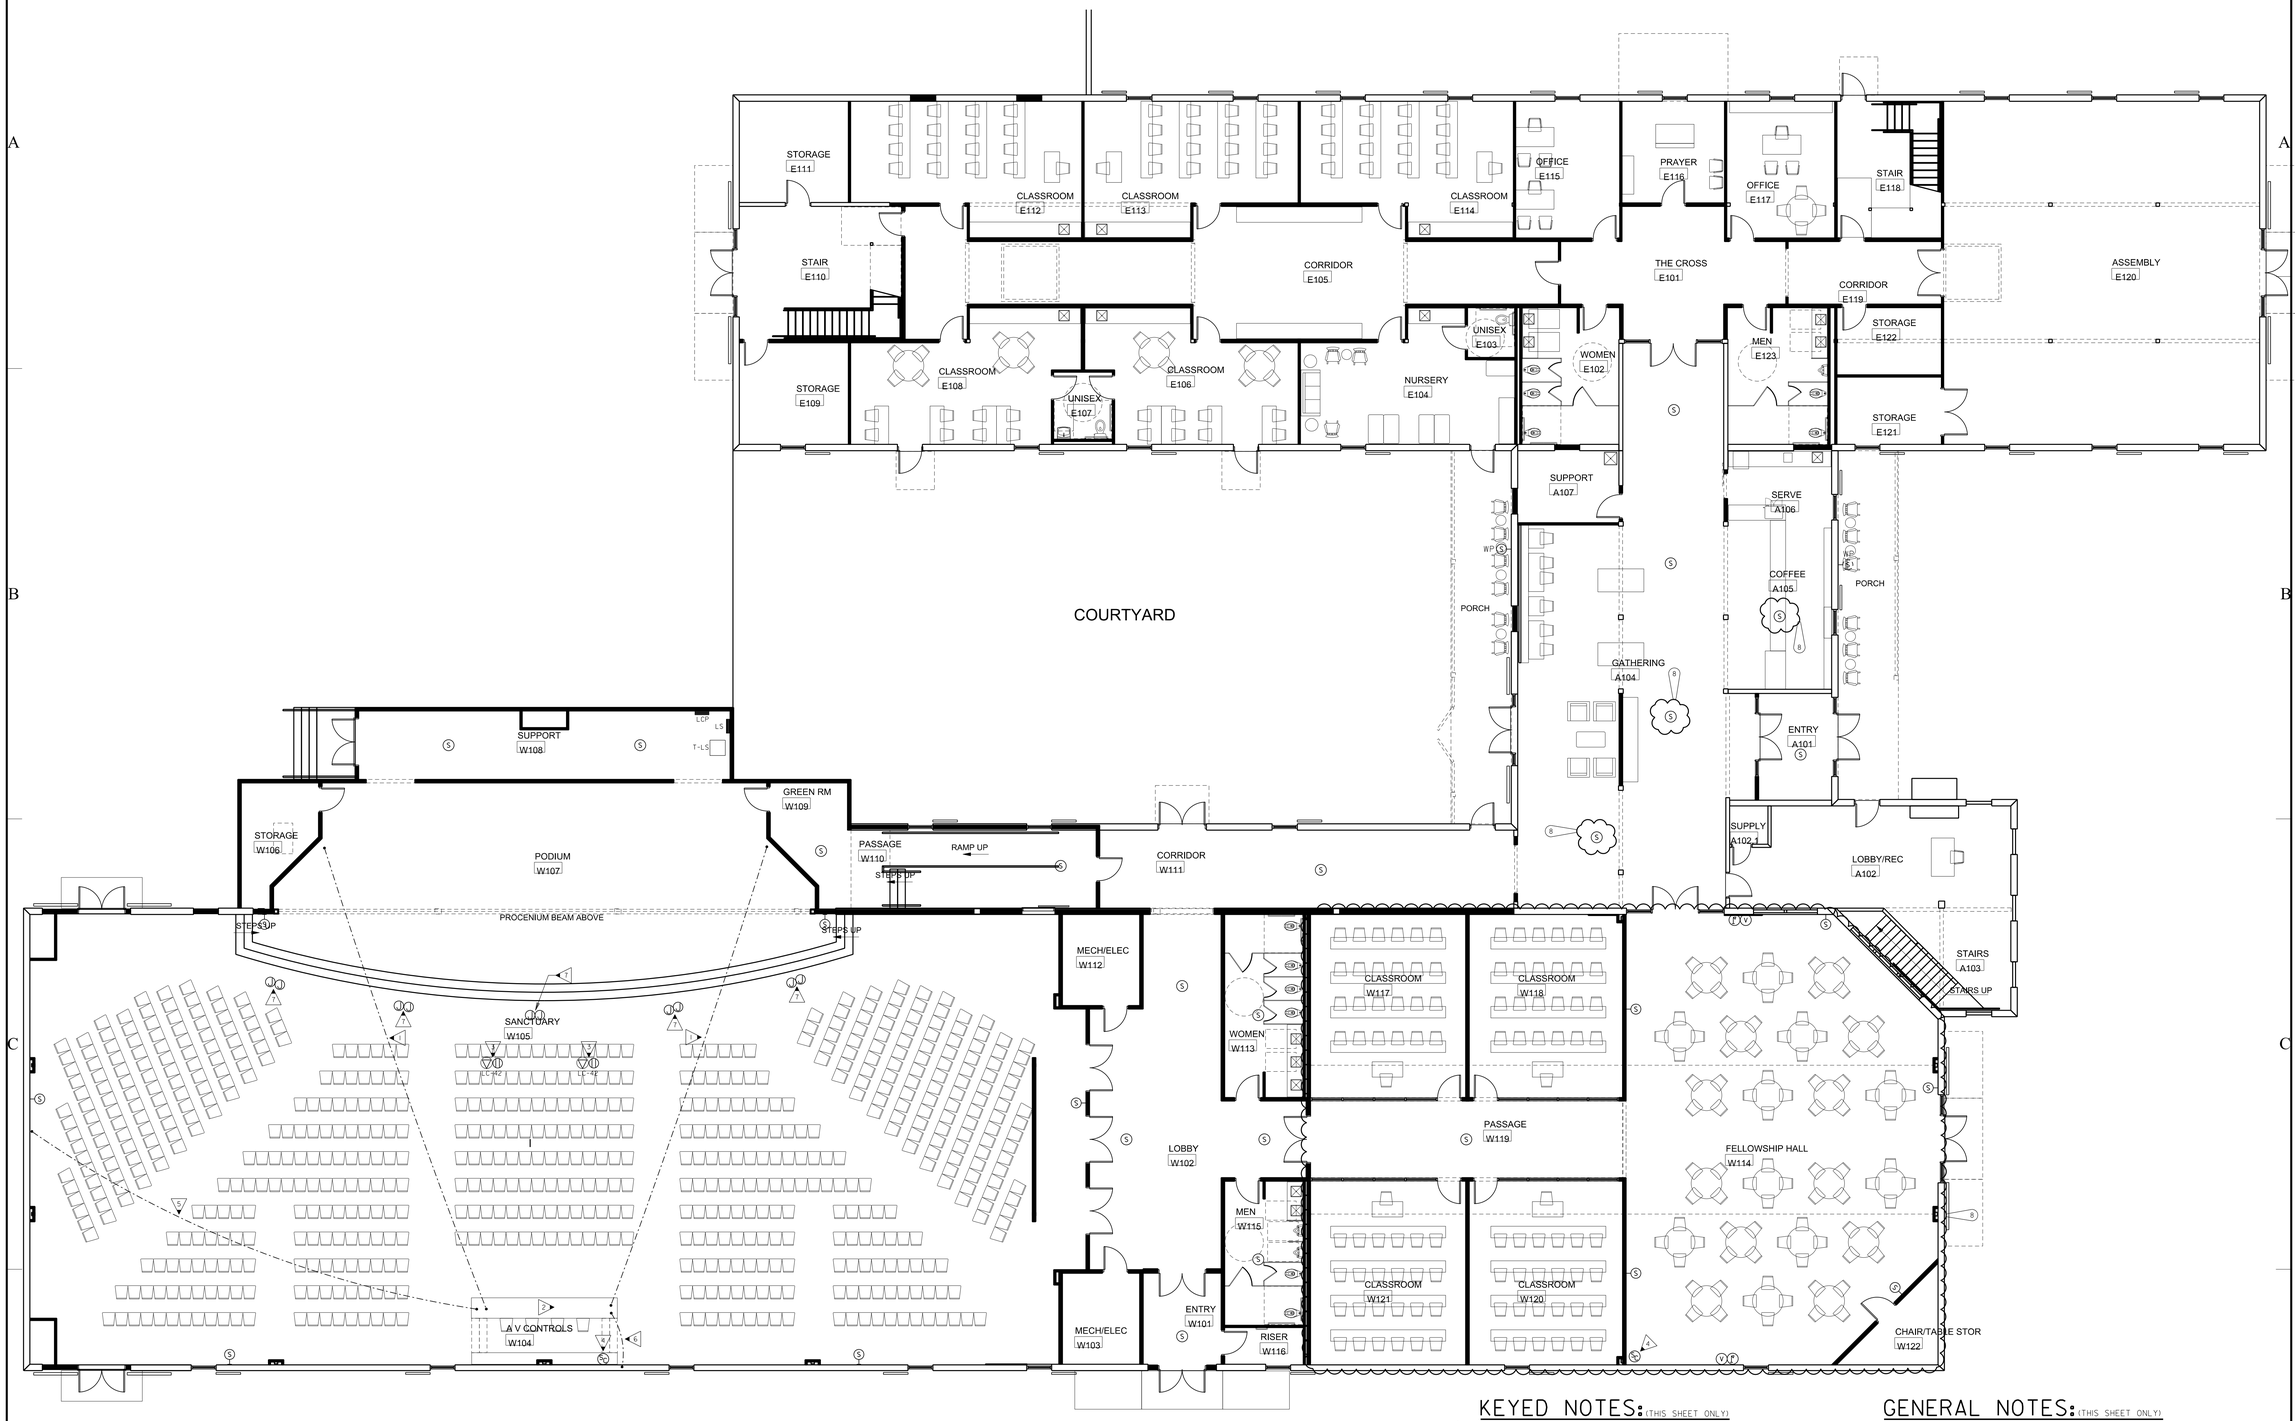

NOTE:
THERE IS NOT A SHEET E4.2. THERE IS NO NEW A/V WORK ON THE SECOND FLOOR.

1 E4.1 FIRST FLOOR PLAN - A/V SYSTEM

SCALE: 1/8"=1'-0"

0 4' 8'

PROVIDE ALL BRANCH CIRCUIT CONDUIT/CONDUCTORS AS NECESSARY TO CONNECT ALL DEVICES SHOWN ON THE CIRCUIT. PROVIDE DEDICATED NEUTRALS FOR ALL CIRCUITS. (STRIPED NEUTRAL WITH PHASE COLOR STRIPING)

KEYED NOTES: (THIS SHEET ONLY)

1. PROVIDE (2) 4 INCH CONDUITS FROM EACH SIDE OF THE A/V CONTROLS LOCATION TO UNDER RAISED FLOOR SYSTEM. COORDINATE WITH OWNER, ARCHITECT, AND A/V CONSULTANT PRIOR TO ROUGH-IN.
2. COORDINATE WITH OWNER'S A/V CONSULTANT FOR ADDITIONAL ELECTRICAL REQUIREMENTS NEEDED FOR SOUND AND AUDIO SYSTEMS PROVIDED. PROVIDE ALL POWER AND RACEWAY REQUIRED FOR SYSTEM INSTALLATION.
3. PROVIDE CEILING MOUNTED RECEPTACLE AND DATA OUTLET FOR CEILING PROJECTOR. COORDINATE EXACT LOCATION WITH OWNER, ARCHITECT, AND A/V CONSULTANT PRIOR TO ROUGH-IN.
4. COORDINATE EXACT LOCATION OF SOUND CONSOLE WITH A/V CONSULTANT AND OWNER PRIOR TO ROUGH-IN.
5. PROVIDE (2) 4 INCH CONDUITS FROM SIDE OF THE A/V CONTROLS LOCATION TO STUB UP LOCATION NEAR WALL. COORDINATE WITH OWNER, ARCHITECT, AND A/V CONSULTANT PRIOR TO ROUGH-IN. TEMPORARILY CAP ROUGHED IN CONDUIT.
6. PROVIDE (4) 2 INCH CONDUITS FROM SIDE OF THE A/V CONTROLS LOCATION TO STUB UP IN WALL AND FINALLY STUB OUT OF WALL AT CEILING STRUCTURE. COORDINATE WITH OWNER, ARCHITECT, AND A/V CONSULTANT PRIOR TO ROUGH-IN.
7. PROVIDE (2) J-BOXES FOR FUTURE THEATRICAL LIGHTING BY A/V CONSULTANT. (1) J-BOX FOR POWER AND (1) J-BOX FOR CONTROLS. PROVIDE 3/4 IN. C. FROM POWER J-BOX TO PANEL "LS". PROVIDE 3/4 IN. C. FROM CONTROLS BOX TO THEATER LIGHTING CONTROLS. COORDINATE EXACT REQUIREMENTS AND LOCATIONS WITH OWNER, ARCHITECT, AND A/V CONSULTANT PRIOR TO ROUGH-IN.

GENERAL NOTES: (THIS SHEET ONLY)

A. SEE SHEET E3.1 FOR GENERAL NOTES.

GM Architect
102 Sammy Court
WARNER ROBINS, GEORGIA 31088
glmarch@outlook.com
(478)-365-8976

ARCHITECT

STAMP INVALID UNLESS SIGNED

CONSULTANT

GEORGIA CERTIFICATE OF REGISTRATION PROFESSIONAL ENGINEER JEFFREY H. McGEE

STAMP INVALID UNLESS SIGNED

EDC ELECTRICAL DESIGN CONSULTANTS
ELECTRICAL ENGINEERS
MACON OFFICE - PROJECT #: M24085
edc1973.com

10641 HIGHWAY 36
COVINGTON, GA 30014
770.786.3031

FIRST FLOOR PLAN - A/V SYSTEM

Retrofit & Renovations for Madison Methodist Church

1091 Confederate Highway
Madison, Georgia 30650

JOB NO.:	02405
DRAWN BY:	TW
CHECKED BY:	JM
DESCRIPTION:	ISSUE
DATE:	07.24.2025
DESCRIPTION:	
DATE:	
DESCRIPTION:	
DATE:	
DESCRIPTION:	
DATE:	

REVISIONS:

1		8	02.09.26
2		9	
3		10	
4		11	
5		12	
6		13	
7		14	

THESE DRAWINGS ARE THE PROPERTY OF GMarchitect AND ARE NOT TO BE REPRODUCED OR REUSED WITHOUT PERMISSION AND CREDIT.
COPYRIGHT: © 2024

SHEET

E4.1

OF