

LEVEL 2 FRAMING PLAN

SCALE: 1/8" = 1'-0"

STEEL FLOOR FRAMING PLAN NOTES:

1. DENOTES 3 1/2" NORMAL WEIGHT CONCRETE ON 2"-20 GAUGE COMPOSITE METAL DECK (TOTAL THICKNESS = 5 1/2") REINFORCED W/ 4 PCY MACRO-SYNTHETIC FIBERS.
MINIMUM DECK PROPERTIES:
 $L_p = 0.417 \text{ IN}^2/\text{FT}$ $L_r = 0.412 \text{ IN}^2/\text{FT}$
 $S_{p+} = 0.342 \text{ IN}^3/\text{FT}$ $S_{p-} = 0.347 \text{ IN}^3/\text{FT}$
2. T/SLAB = SEE LEVEL SCHEDULE THIS SHEET.
3. T/STEEL = SEE LEVEL SCHEDULE THIS SHEET.
4. DENOTES THE AMOUNT OF CAMBER ON THE BEAM OR GIRDER.
DENOTES QUANTITY OF 3/4" DIA x 4" LG HEADED STUD ANCHORS WELDED TO TOP FLANGE OF STEEL BEAM (NC): DENOTES NON-COMPOSITE BEAM
DENOTES BEAM SIZE
TOP OF STEEL ELEVATION
(-) # - #"
(+) # - #"
5. FOR TYPICAL COMPOSITE STEEL FRAMING SECTIONS AND DETAILS SEE S511 - S512
6. GENERAL CONTRACTOR SHALL VERIFY ALL OPENING DIMENSIONS WITH ARCHITECTURAL AND MECHANICAL DRAWINGS.
7. V=#K DENOTES DESIGN SERVICE LEVEL (ALLOWABLE STRESS DESIGN) SHEAR REACTION. IF REACTION IS NOT SHOWN, DESIGN FOR 15 K.
8. M=#K-FT DENOTES MOMENT CONNECTION. DESIGN CONNECTIONS FOR FORCES INDICATED ON PLAN AND IN ELEVATIONS. FOR CONNECTION DETAIL - SEE S5501.
M=#K-FT DENOTES DESIGN SERVICE LEVEL (ALLOWABLE STRESS DESIGN) MOMENT REACTION (+ OR -). IF FORCE IS NOT SHOWN, DESIGN FOR 25 K-FT.
9. A=#K DENOTES DRAG CONNECTION. DESIGN CONNECTIONS FOR AXIAL FORCES INDICATED ON PLAN AND IN ELEVATIONS. DRAG CONNECTIONS TO HSS COLUMNS SHALL BE THRU-PLATES. UNO - SEE 2/S501
A=#K DENOTES DESIGN SERVICE LEVEL (ALLOWABLE STRESS DESIGN) AXIAL DRAG FORCE. IF FORCE IS NOT SHOWN, DESIGN FOR 5 K.
10. POST-UP DENOTES COLUMN POST UP PER DETAIL 1/S501.
11. INSTALL (3)-#4 BARS @ 6" OC AT MID-DEPTH OF SLAB CONTINUOUS AROUND ENTIRE PERIMETER OF SLAB AND AT ALL INTERIOR SLAB EDGES. LAP EDGE BARS 3'-0" AND EXTEND 4'-0" PAST ALL INSIDE CORNERS.

WOOD ROOF FRAMING PLAN NOTES:

1. (WR1) DENOTES 5/8" WOOD ROOF SHEATHING ON GABLED PRE-ENGINEERED WOOD ROOF TRUSSES AT 24" OC, UNLESS NOTED OTHERWISE.
2. TRUSS BEARING ELEVATION = 12' - 0", UNLESS NOTED OTHERWISE.
3. TG DENOTES PRE-ENGINEERED WOOD TRUSS GIRDER. PROVIDE A STUD PACK WITH ONE MORE STUD THAN THE NUMBER OF PLIES IN TRUSS GIRDER DOWN TO FOUNDATION.
4. HG DENOTES PRE-ENGINEERED WOOD TRUSS HIP GIRDER. PROVIDE A STUD PACK WITH ONE MORE STUD THAN THE NUMBER OF PLIES IN TRUSS GIRDER DOWN TO FOUNDATION.
5. ST DENOTES PRE-ENGINEERED WOOD SHEAR TRUSS TO ALIGN WITH SHEAR WALL BELOW. DESIGN FOR IN-PLANE SHEAR LOAD PER SHEAR WALL SCHEDULE. FASTEN SHEAR TRUSS TO TOP OF SHEAR WALL BELOW PER 4/S611
6. ALL ROOF TRUSSES SHALL HAVE UPLIFT TIES AT ALL BEARING POINTS PER ROOF TRUSS TIE DOWN SCHEDULE ON THIS SHEET. REACTIONS SHALL BE PROVIDED BY THE TRUSS ENGINEER IN THE FINAL, FOR CONSTRUCTION TRUSS SHOP DRAWINGS.
7. X# - # DENOTES WOOD BEAM - SEE SCHEDULE ON THIS SHEET.
NOMINAL BEAM DEPTH
NUMBER OF PLYS
D = DIMENSIONED LUMBER
L = LVL
8. ALL WOOD ROOF BEAMS BEARING ON WALLS SHALL HAVE UPLIFT TIES AT BEARING POINTS - SEE WOOD ROOF BEAM SCHEDULE ON THIS SHEET.
9. FOR TYPICAL ROOF DIAPHRAGM FASTENING - SEE DETAIL 2/S611, UNLESS NOTED OTHERWISE ON PLAN
10. SEE FLOOR LEVEL BELOW FOR SHEAR WALL LOCATIONS. PROVIDE SHEAR TRUSS OVER THESE LOCATIONS CAPABLE OF TRANSFERRING LOAD TO WALL NOTED ON SHEAR WALL SCHEDULE.
11. == == DENOTES LOAD-BEARING WALLS BELOW.

LEVEL SCHEDULE


NAME	ELEVATION
FFE	0"
LEVEL 2 - T/STL	12' - 6 1/2"
LEVEL 2 - T/SLAB	13' - 0"

WOOD BEAM SCHEDULE

BEAM TYPE	STUD PACKS	HANGER (WHERE REQUIRED)
(3) 1 3/4x9 1/4 LVL	SEE PLAN	-
(3) 1 3/4x22 LVL	SEE PLAN	-
(3) 2x10	(3) 2x6	SIMPSON (2) H2.5A

ROOF TRUSS TIE DOWN SCHEDULE

UPLIFT REACTION AT BEARING POINTS OF ROOF TRUSS (ASD)	SIMPSON TIE-ROOF @ EACH END OF BEAM	NAILS TO TRUSS	NAILS TO PL	SDS SCREWS TO TRUSS	THRU-BOLTS TO PL	REMARKS
< 540 LB	H2.5A SIMPSON TIE	0.131" x 1 1/2"	0.131" x 1 1/2"	-	-	-
540 LB ≤ REACTION < 1080 LB	(2) H2.5A SIMPSON TIES	0.131" x 1 1/2"	0.131" x 1 1/2"	-	-	-
1080 LB ≤ REACTION < 1420 LB	(2) H8 SIMPSON TIES	0.148" x 1 1/2"	0.148" x 1 1/2"	-	-	-
1420 LB ≤ REACTION < 3990 LB	(2) VGT/LR SIMPSON TIEDOWNS	-	-	1/4" x 3"	(2) 5/8" DIA	2 PLY MIN W/ HDU4 EA FACE BELOW TOP PL; 1/4" x 3" SQ WASHER PL
3990 LB ≤ REACTION < 6485 LB	HGT-2 SIMPSON TIEDOWN	0.148" x 3"	-	-	(2) 5/8" DIA	2 PLY W/ FULL-HEIGHT THREADED ROD; 1/4" x 3" SQ WASHER PL
6485 LB ≤ REACTION < 9035 LB	HGT-3 SIMPSON TIEDOWN	0.148" x 3"	-	-	(2) 5/8" DIA	3 PLY W/ FULL-HEIGHT THREADED ROD; 1/4" x 4" SQ WASHER PL

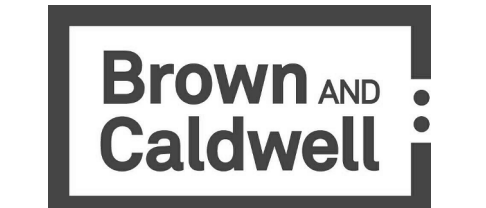

BROWN AND CALDWELL
900 HAMMOND DRIVE, SUITE 500
ATLANTA, GA 30328



THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

CONSTRUCTION DOCUMENTS



NCWSA OFFICE ADDITION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: Designer
DRAWN: Author
CHECKED: Checker
CHECKED:
APPROVED: Approver
FILENAME
BC PROJECT NUMBER
616202
CLIENT PROJECT NUMBER

LEVEL 2 FRAMING PLAN

DRAWING NUMBER
S102