


Plot Date: 4/27/2026 3:02:18 PM Path: Autodeskt_Docs\NCSWA_Admin Bldg_V251616202-NCSWA-PLG_V25.rvt

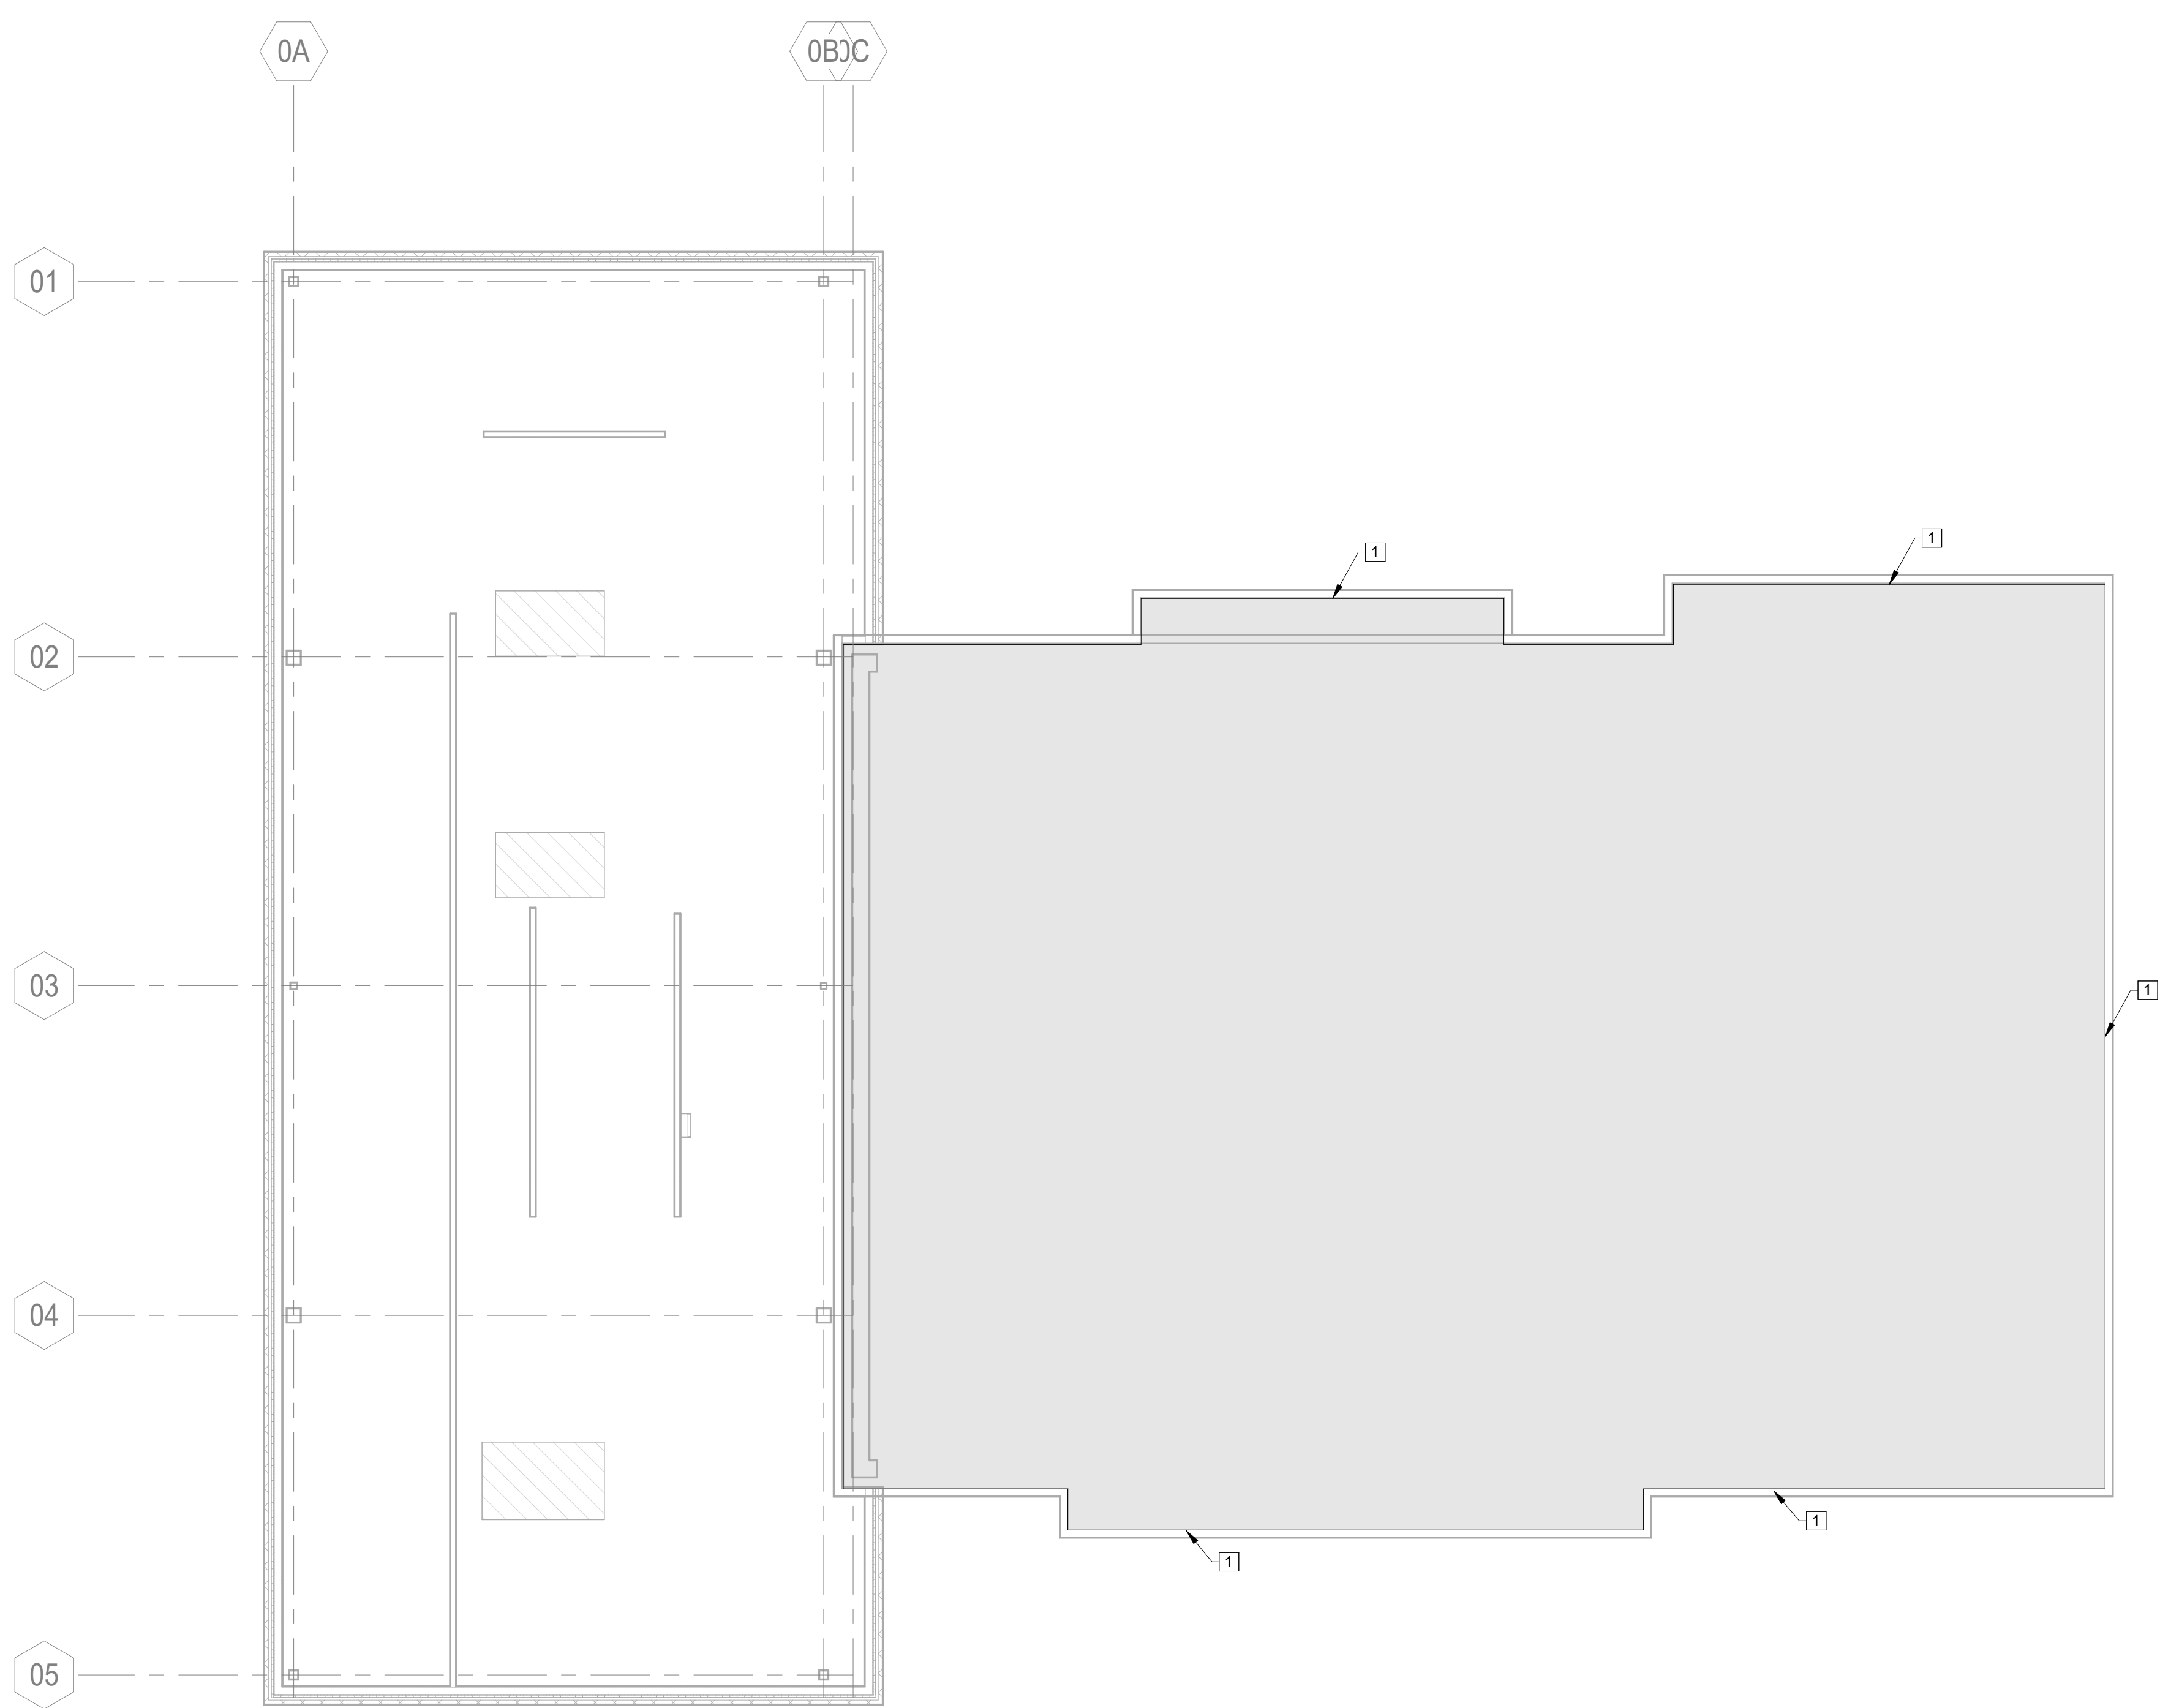

1 ATTIC FIRE PROTECTION PLAN
SCALE: 1/8" = 1'-0"

GENERAL NOTES:

- A. CONTRACTOR SHALL FIELD VERIFY AND CONFIRM EXISTING PIPING SIZES AND LOCATIONS. NOTIFY ENGINEER OF SIGNIFICANT DISCREPANCIES PRIOR TO COMMENCEMENT OF WORK.
- B. FIRE PROTECTION WORK IS TO BE A DELEGATED DESIGN. CONTRACTOR SHALL BE RESPONSIBLE FOR DESIGN AND INSTALLATION OF A COMPLETE AND OPERABLE NFPA 13 COMPLIANT SPRINKLER SYSTEM WITHIN THE AREA OF WORK SHOWN. REFER TO SPECIFICATIONS FOR FURTHER INFORMATION.
- C. COORDINATE ACTUAL ROUTE OF PIPING IN ATTIC WITH FRAMING MEMBERS.
- D. DRY SYSTEM AUXILIARY DRAINS SHALL BE PROVIDED AT ALL LOW POINTS OF THE SYSTEM TO CAPTURE CONDENSATION AND ALLOW FOR DRAINING OF TRAPPED SECTIONS OF WATER. NO POINT OF THE DRY SYSTEM SHALL TRAP ANY AMOUNT OF WATER.

CONSTRUCTION NOTES:

- 1. SHADED AREA OF WORK INDICATES THE ATTIC SPACE IN THE EXISTING BUILDING THAT IS TO BE PROVIDED WITH A DRY PIPE SPRINKLER SYSTEM. NEW LAYOUT IS TO PROVIDE COMPLETE PROTECTION OF THE EXISTING COMBUSTIBLE ATTIC SPACE. EXISTING DRY PIPE SPRINKLER SYSTEM SERVING THE SECOND FLOOR IS TO BE EXTENDED TO COVER ATTIC.



BROWN AND CALDWELL
900 HAMMOND DRIVE, SUITE 500
ATLANTA, GA 30328



THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

CONSTRUCTION DOCUMENTS



NCWSA OFFICE ADDITION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: NBN
DRAWN: NBN
CHECKED: RFJ
CHECKED:
APPROVED: RFJ

FILENAME
BC PROJECT NUMBER 616202
CLIENT PROJECT NUMBER

ATTIC PLAN

DRAWING NUMBER
FP103