

1

2

3

4

5


6

D

C

B

A

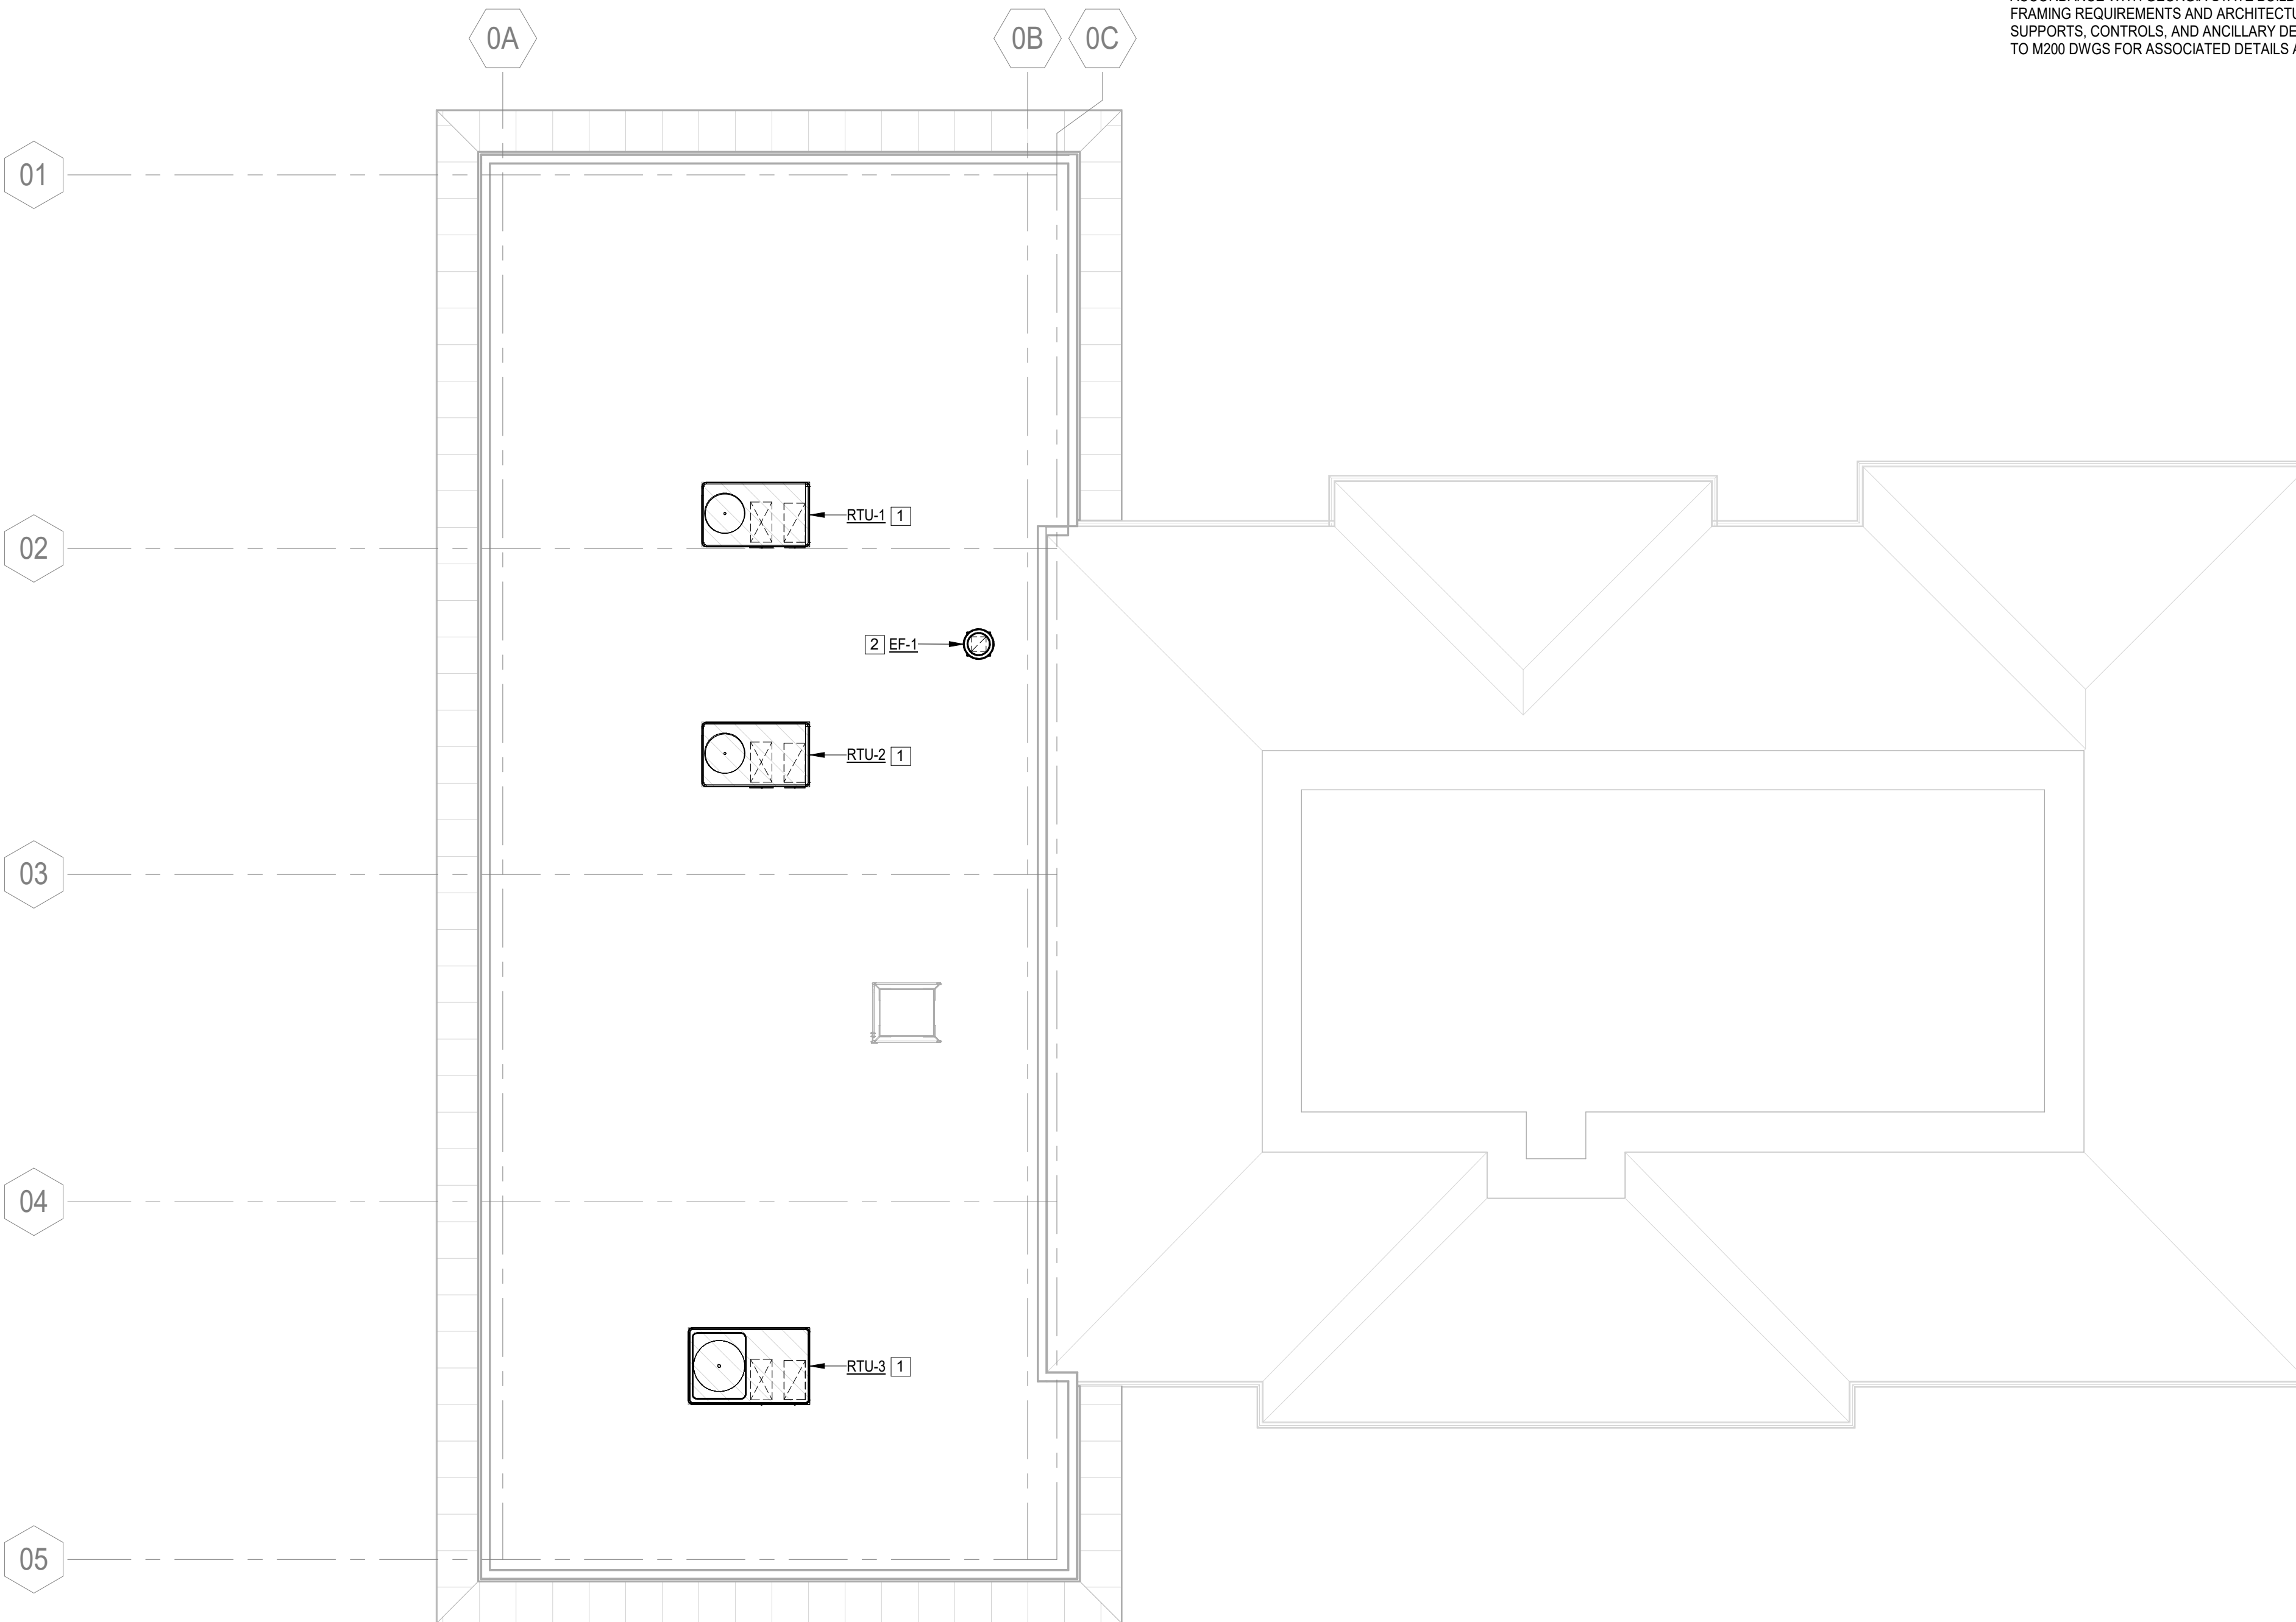

**1 ROOF PLAN**  
SCALE: 1/8" = 1'-0"

**CONSTRUCTION NOTES:**

1. PROVIDE ROOFTOP UNIT AND 24" TALL WIND RATED ROOF CURB IN ITS ENTIRETY. SECURE CURB TO STRUCTURE IN ACCORDANCE WITH GEORGIA STATE BUILDING CODE AND ASCE 7. COORDINATE WITH STRUCTURAL DWGS FOR FRAMING REQUIREMENTS AND ARCHITECTURAL DWGS FOR FLASHING REQUIREMENTS. PROVIDE ALL ASSOCIATED SUPPORTS, CONTROLS, AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM. REFER TO M200 DWGS FOR ASSOCIATED DETAILS AND M300 DWGS FOR SCHEDULED CAPACITY.
2. PROVIDE EXHAUST FAN AND 24" TALL WIND RATED ROOF CURB IN ITS ENTIRETY. SECURE CURB TO STRUCTURE IN ACCORDANCE WITH GEORGIA STATE BUILDING CODE AND ASCE 7. COORDINATE WITH STRUCTURAL DWGS FOR FRAMING REQUIREMENTS AND ARCHITECTURAL DWGS FOR FLASHING REQUIREMENTS. PROVIDE ALL ASSOCIATED SUPPORTS, CONTROLS, AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM. REFER TO M200 DWGS FOR ASSOCIATED DETAILS AND M300 DWGS FOR SCHEDULED CAPACITY.



**BROWN AND CALDWELL**  
900 HAMMOND DRIVE, SUITE 500  
ATLANTA, GA 30328



THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

**CONSTRUCTION DOCUMENTS**



**NCWSA OFFICE ADDITION**

**REVISIONS**

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: CJP  
DRAWN: CJP  
CHECKED: NBN  
CHECKED:  
APPROVED: RFJ

FILENAME  
BC PROJECT NUMBER  
Project Number  
CLIENT PROJECT NUMBER

**ROOF PLAN**

DRAWING NUMBER  
**M103**

1

2

3

4

5

6