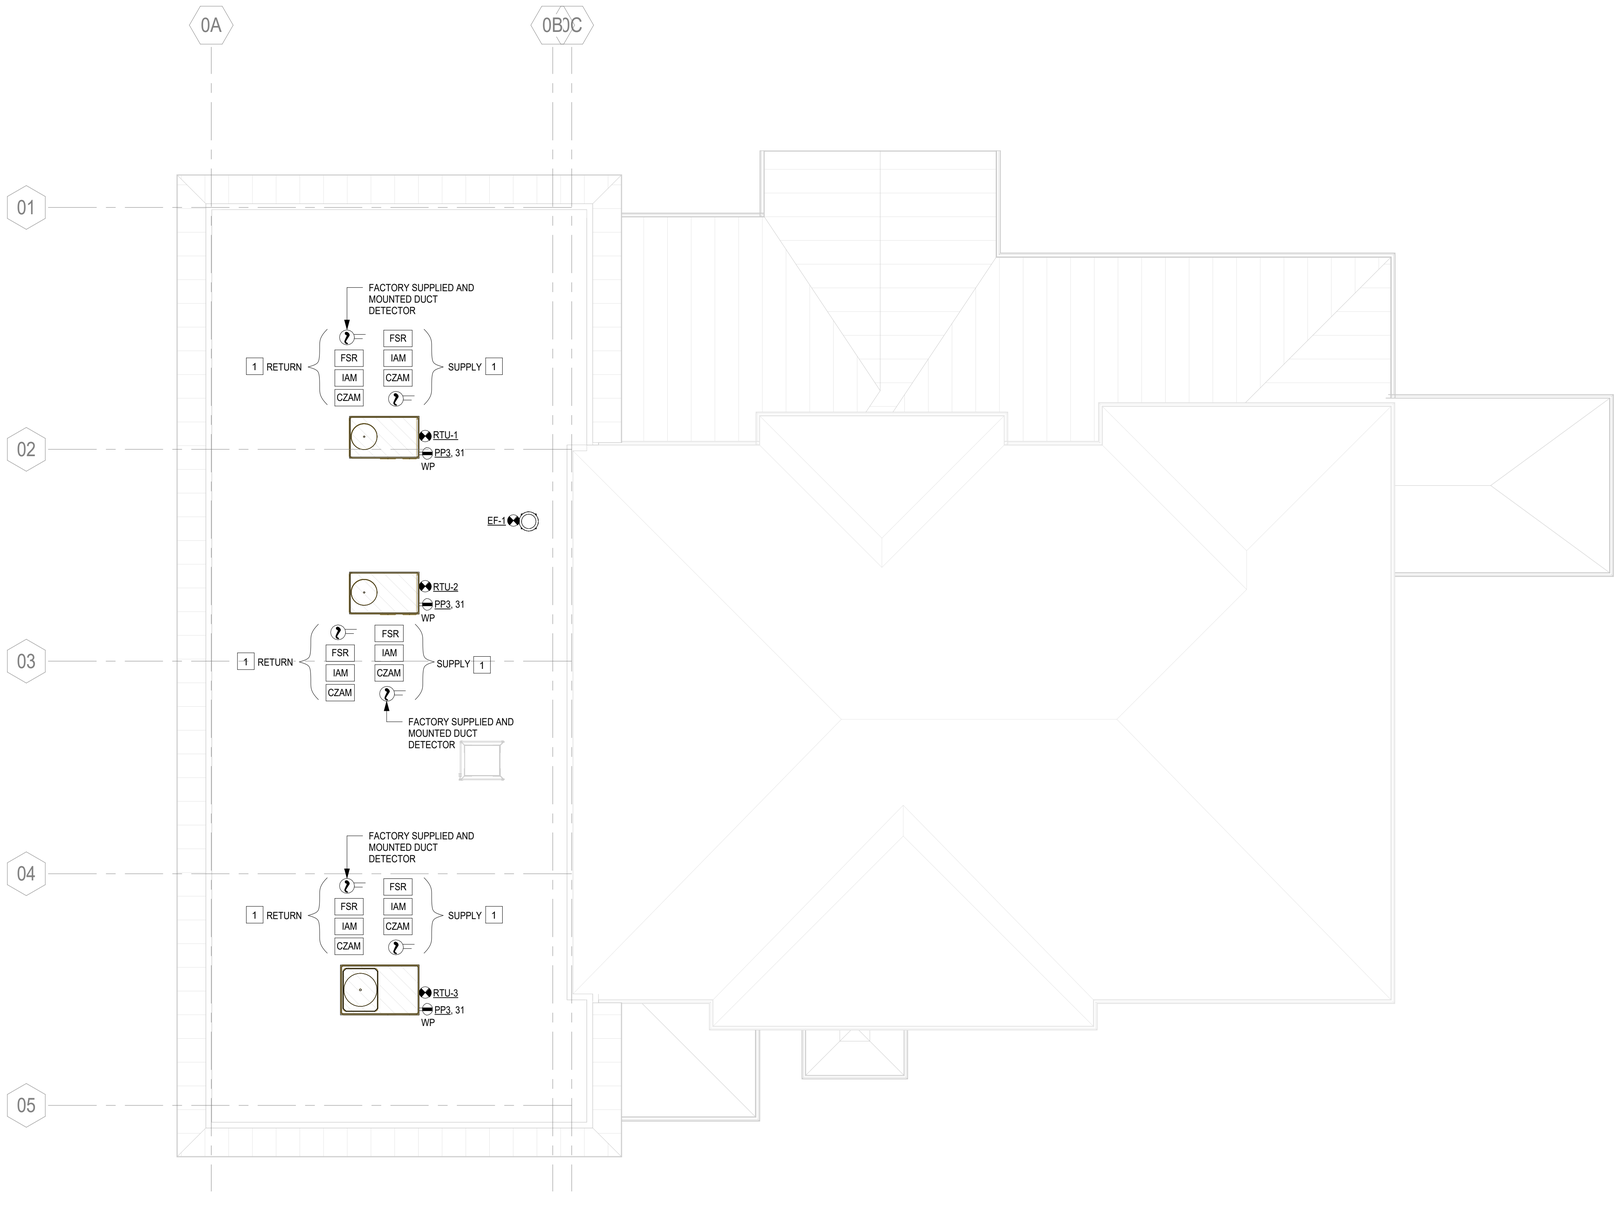


1 ROOF POWER & SYSTEMS PLAN - NEW WORK
SCALE: 1/8" = 1'-0"

## GENERAL NOTES:

B. REFER TO SHEET E502 FOR INFORMATION ON WIRING REQUIREMENTS FOR MECHANICAL EQUIPMENT SHOWN ON THIS SHEET.

## # CONSTRUCTION NOTES:

1. PROVIDE INDIVIDUAL ADDRESSABLE MODULE (IAM) REMOTELY MOUNTED IN CONDITIONED ENVIRONMENT. THE IAM WILL BE CONNECTED TO THE FACTORY SUPPLIED / INSTALLED DUCT MOUNTED DETECTORS TO PROVIDE THE NOTIFICATION OF ALARM TO THE FIRE ALARM CONTROL PANEL. THE FIRE ALARM CONTROL PANEL WILL SIGNAL THE CONTROL ZONE ADDRESSABLE MODULE (CZAM) OF ALARM CONDITION. THE CZAM WILL CONTROL THE FAN SHUTDOWN RELAY (FSR) TO SHUTDOWN THE UNIT. COORDINATE FINAL MOUNTING LOCATION WITH MECHANICAL CONTRACTOR BEFORE INTALLATION.


Brown AND Caldwell
BROWN AND CALDWELL
900 HAMMOND DRIVE, SUITE 500
ATLANTA, GA 30328
wendel


THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

60% DESIGN DOCUMENTS

NCWSA OFFICE ADDITION

REVISIONS

| REV | DATE | DESCRIPTION |
|---|---|---|
| | | |

LINE IS 2 INCHES AT FULL SIZE

| | |
|---|---|
| DESIGNED: | MAP |
| DRAWN: | MAP |
| CHECKED: | JFW |
| CHECKED: | |
| APPROVED: | |

FILENAME

BC PROJECT NUMBER
616202
CLIENT PROJECT NUMBER

ROOF POWER & SYSTEMS PLAN - NEW WORK

DRAWING NUMBER
E105


Plot Date: 4/27/2026 10:18:55 PM Path: Autodesk Docs://NCWSA Admin Bldg_ V25/616202-NCWSA-ELEC_V25.rvt