




1. JOIST SEAT DEPTHS AND CONNECTIONS INDICATED IN THIS DETAIL ARE TYPICAL UNO ON PLANS AND SPECIFIC DETAILS.
2. SLOPED OR BEVELED SEATS ARE REQUIRED WHERE ROOF SLOPE EXCEEDS 14"/FT. COMPLY WITH SJI SPECIFICATIONS AND SEE PLANS FOR JOIST SEAT DEPTHS.
3. BOLTED CONNECTIONS ARE REQUIRED AT LOCATIONS INDICATED BY THE JOIST SUPPLIER.
4. IF BOLTS CANNOT BE INSTALLED AT CONNECTIONS INDICATED AS BOLTED, NOTIFY THE JOIST SUPPLIER AND SUBMIT PROPOSED CONNECTION MODIFICATION TO ARCH/SEOR FOR REVIEW. WELDS INDICATED IN THIS DETAIL SHALL NOT BE SUBSTITUTED FOR BOLTS.

SCALE: 1" = 1'-0"

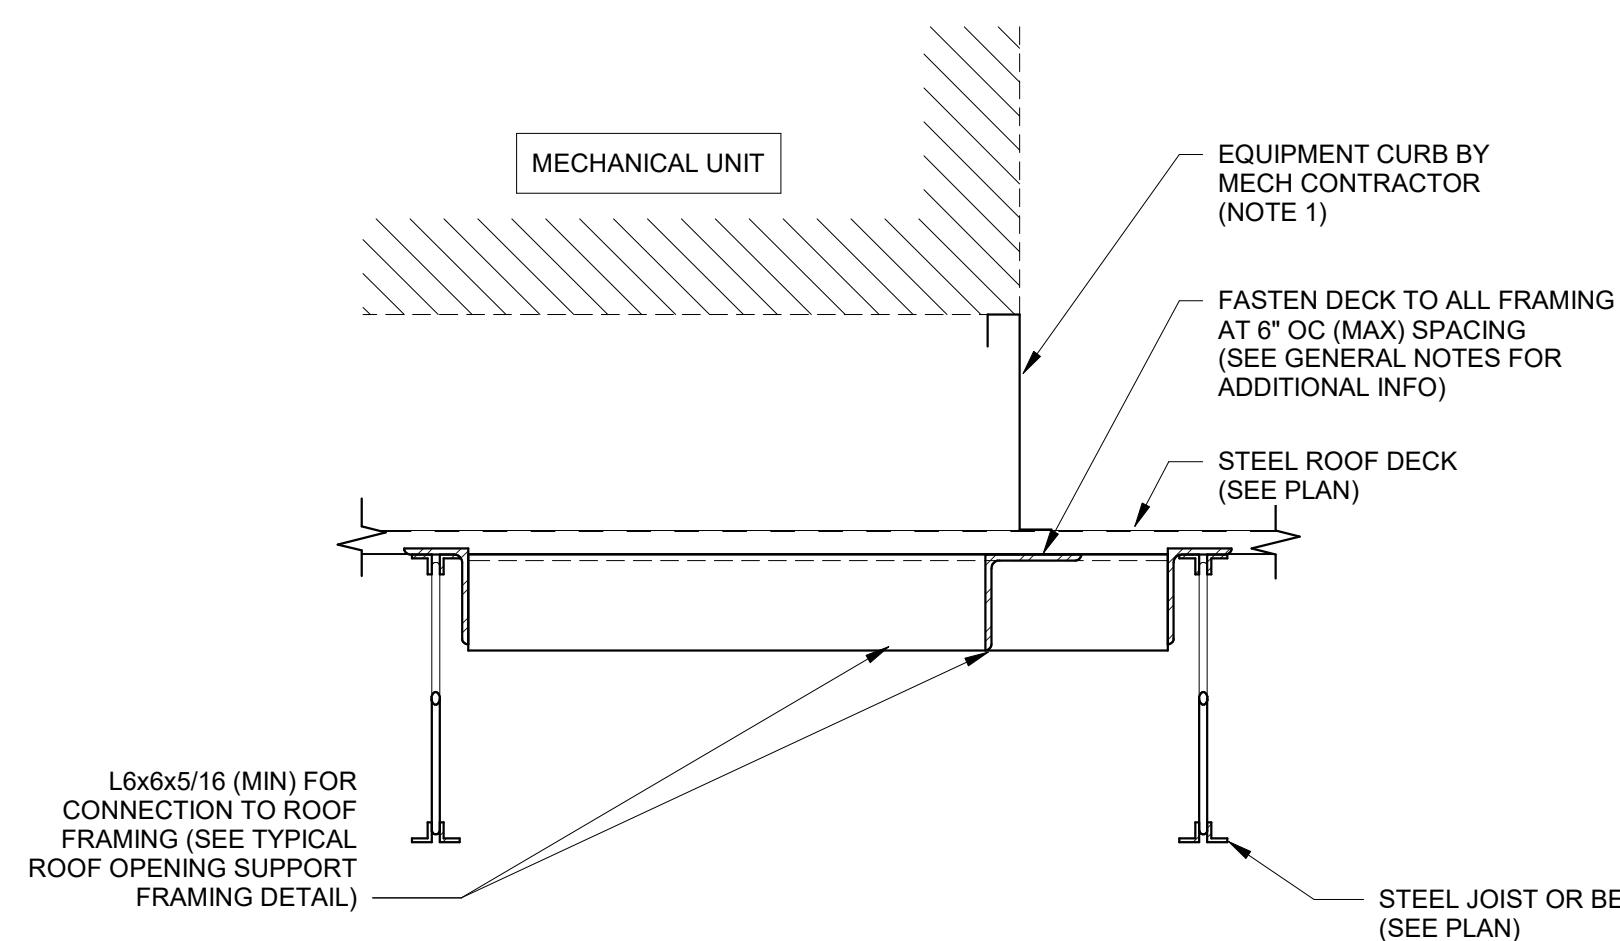

1. COORDINATE SIZE AND LOCATION OF EQUIPMENT CURB WITH MECHANICAL CONTRACTOR. CURB SHALL BE SUPPORTED ON ALL SIDES.
2. ANCHOR EQUIPMENT AND CURB TO MISCELLANEOUS FRAMING SHOWN AS REQUIRED FOR WIND AND/OR SEISMIC FORCES. COORDINATE WITH EQUIPMENT/CURB MANUFACTURER (CONNECTION DESIGN NOT BY PES STRUCTURAL ENGINEERS).
3. NOTIFY SEQR IF EQUIPMENT SIZE AND/OR WEIGHT (INCLUDING CURB) EXCEEDS WEIGHT NOTED ON PLANS.
4. IN ADDITION TO CURB SUPPORT FRAMING, INSTALL TRIGGER ROD OF OPENING FRAME TO SUPPORT DECK AT PERIPHERY OF OPENINGS. SEE TYPICAL ROOF OPENING FRAME DETAIL FOR ADDITIONAL INFORMATION.
5. PROVIDE LARGER FRAMING MEMBERS AS REQUIRED FOR ANCHORAGE OF EQUIPMENT CURB.

SCALE: 1" = 1'-0"

S522

ADDRESS 1852 Century Place NE, Suite 201, Atlanta Georgia 30345
PHONE 770.457.5923 **WEB** www.pesengineers.com
PES PROJECT NUMBER: 0250683
PES GEORGIA LICENSE NUMBER: PEF000799
EXPIRATION DATE: 6/30/2028