


Plot Date: 6/26/2026 10:07:41 AM Path: Autodeskt Docs\NCWSA Admin Bldg_V25\616202-NCWSA-MECH_V25.rvt

GENERAL NOTES:

- A. PROVIDE TURNING VANES AT ALL RECTANGULAR SUPPLY ELBOWS

CONSTRUCTION NOTES:

1. PROVIDE VARIABLE AIR VOLUME (VAV) AS SCHEDULED. PROVIDE ALL ASSOCIATED SUPPORTS AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM. REFER TO DRAWING M202 FOR ASSOCIATED DETAIL AND DRAWING M301 FOR SCHEDULED CAPACITY.
2. PROVIDE DUCTWORK AS SHOWN IN ITS ENTIRETY. PROVIDE ALL REQUIRED SUPPORTS, INSULATION, AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM.
3. PROVIDE AIR TERMINAL DEVICES AS INDICATED ON PLAN. REFER TO M200 DWGS FOR ASSOCIATED DETAILS AND M300 DWG FOR SCHEDULED CAPACITIES.
4. LIGHTING FIXTURES IN BOARD ROOM 143 SHALL HAVE RETURN AIR CAPABILITY. TOTAL AIR FLOW SHALL EQUAL THE 2400 CFM. REFER TO ELECTRICAL DRAWINGS FOR COORDINATION.

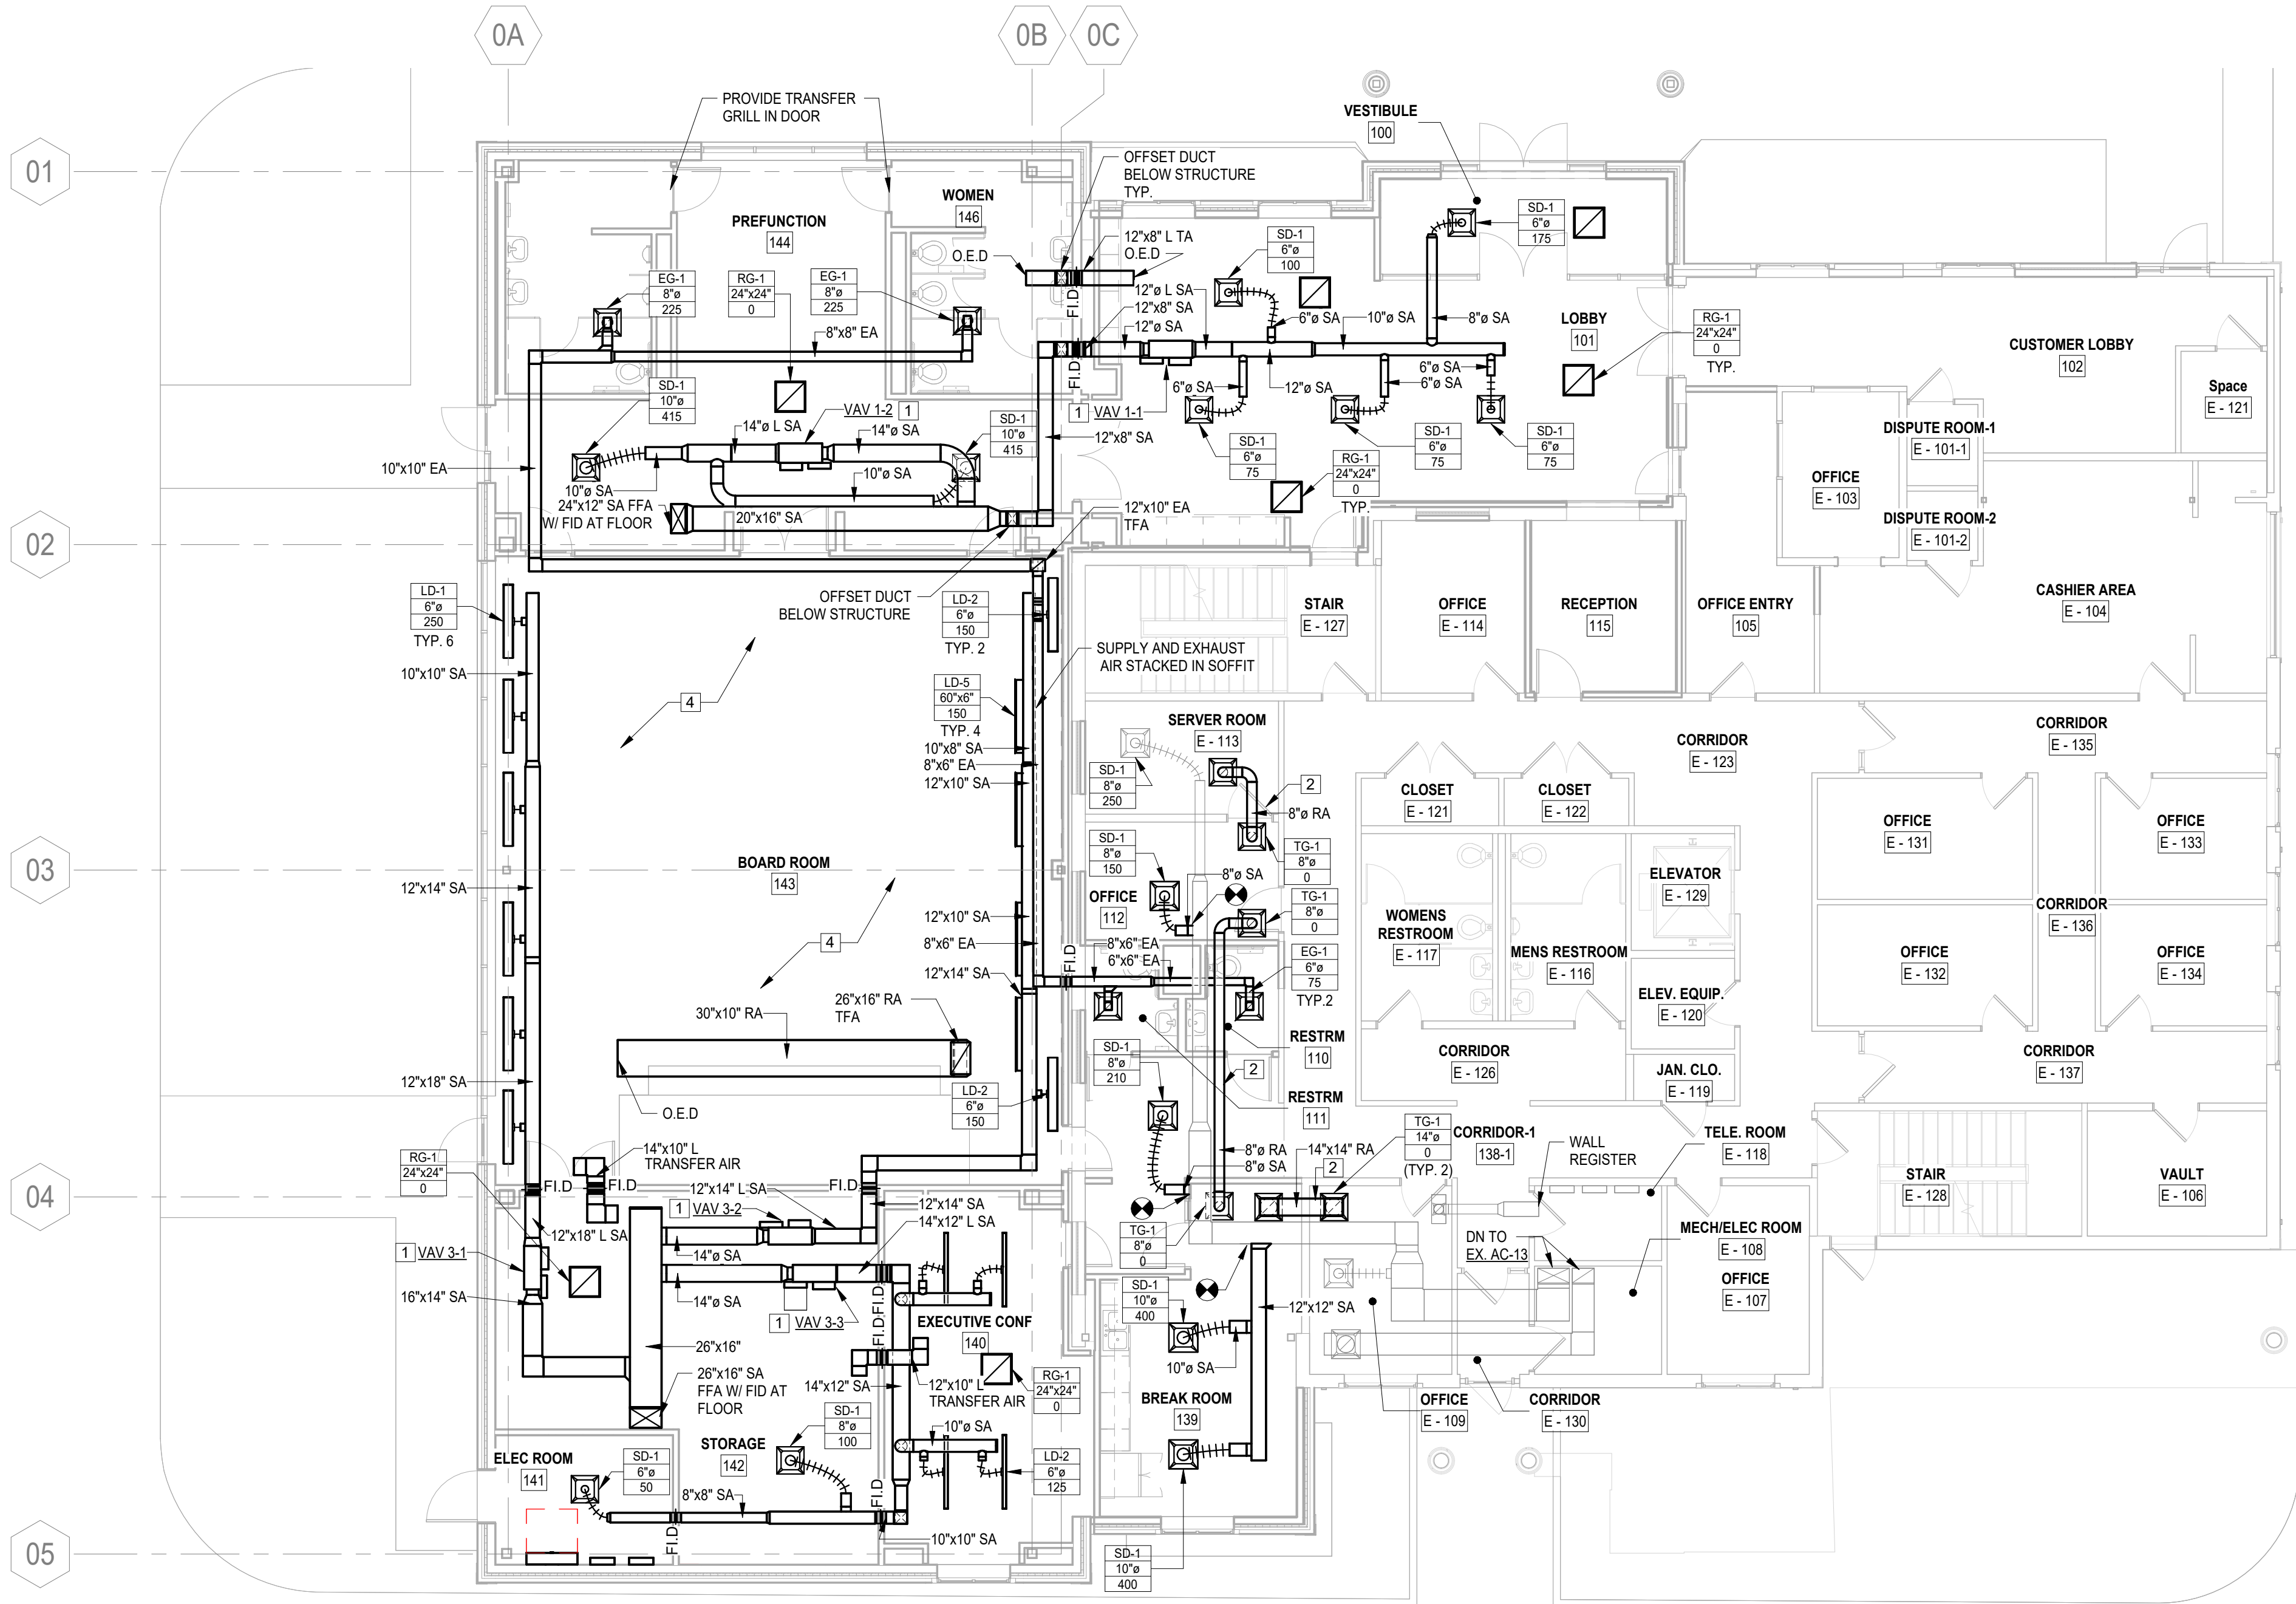

1 FIRST FLOOR NEW WORK PLAN
SCALE: 1/8" = 1'-0"



BROWN AND CALDWELL
900 HAMMOND DRIVE, SUITE 500
ATLANTA, GA 30328



CONSTRUCTION DOCUMENTS
7/1/26



NCWSA OFFICE ADDITION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: CJP

DRAWN: CJP

CHECKED: NBN

CHECKED:

APPROVED: RFJ

FILENAME

BC PROJECT NUMBER

616202

CLIENT PROJECT NUMBER

FIRST FLOOR NEW
WORK PLAN

DRAWING NUMBER

M101