


Plot Date: 6/26/2026 10:07:43 AM Path: Autodeskt Docs\NCWSA Admin Bldg_ V25\616202-NCWSA-MECH_ V25.rvt

1 ROOF PLAN

SCALE: 1/8" = 1'-0"

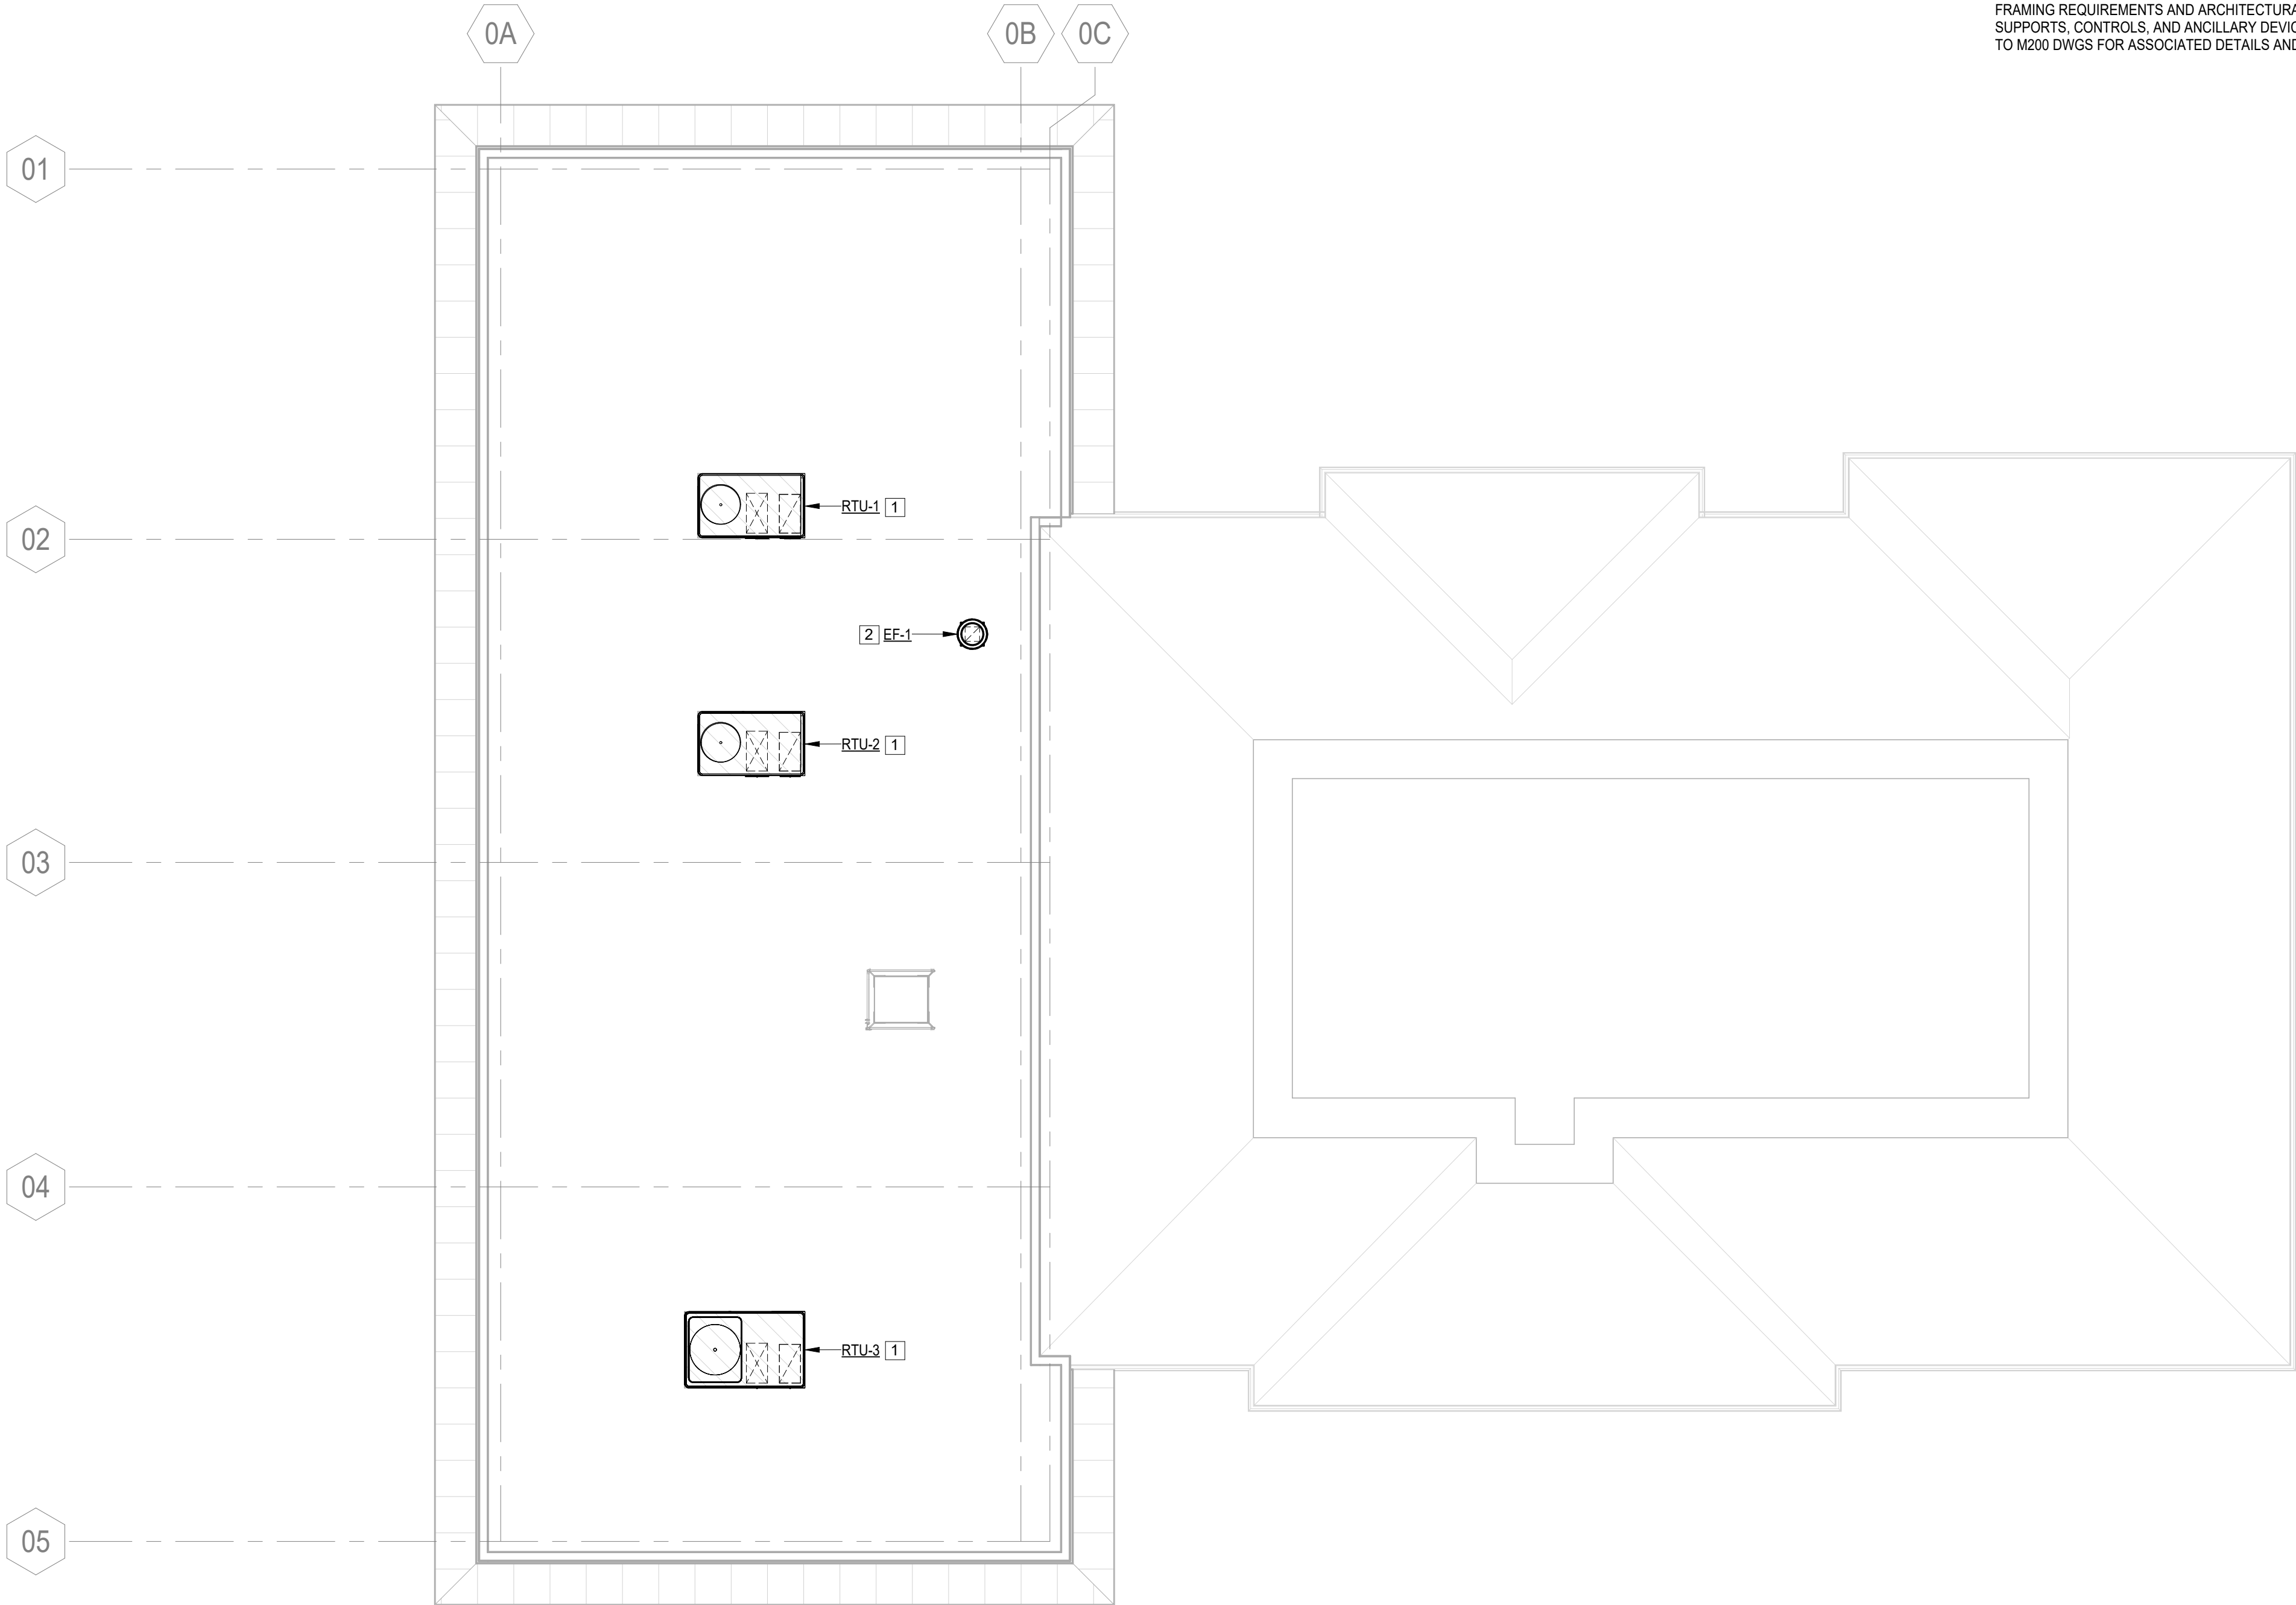

CONSTRUCTION NOTES:

1. PROVIDE ROOFTOP UNIT AND 24" TALL WIND RATED ROOF CURB IN ITS ENTIRETY. SECURE CURB TO STRUCTURE IN ACCORDANCE WITH GEORGIA STATE BUILDING CODE AND ASCE 7. COORDINATE WITH STRUCTURAL DWGS FOR FRAMING REQUIREMENTS AND ARCHITECTURAL DWGS FOR FLASHING REQUIREMENTS. PROVIDE ALL ASSOCIATED SUPPORTS, CONTROLS, AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM. REFER TO M200 DWGS FOR ASSOCIATED DETAILS AND M300 DWGS FOR SCHEDULED CAPACITY.
2. PROVIDE EXHAUST FAN AND 24" TALL WIND RATED ROOF CURB IN ITS ENTIRETY. SECURE CURB TO STRUCTURE IN ACCORDANCE WITH GEORGIA STATE BUILDING CODE AND ASCE 7. COORDINATE WITH STRUCTURAL DWGS FOR FRAMING REQUIREMENTS AND ARCHITECTURAL DWGS FOR FLASHING REQUIREMENTS. PROVIDE ALL ASSOCIATED SUPPORTS, CONTROLS, AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM. REFER TO M200 DWGS FOR ASSOCIATED DETAILS AND M300 DWGS FOR SCHEDULED CAPACITY.



BROWN AND CALDWELL
900 HAMMOND DRIVE, SUITE 500
ATLANTA, GA 30328



7/1/26

CONSTRUCTION DOCUMENTS

7/1/26



NCWSA OFFICE ADDITION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: CJP

DRAWN: CJP

CHECKED: NBN

APPROVED: RFJ

FILENAME

BC PROJECT NUMBER

616202

CLIENT PROJECT NUMBER

ROOF PLAN

DRAWING NUMBER

M103