



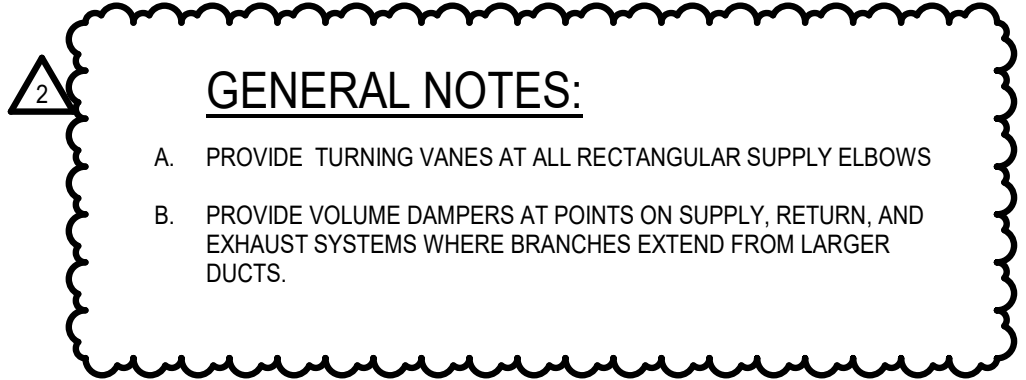

- X CONSTRUCTION NOTES:**

 1. PROVIDE VARIABLE AIR VOLUME (VAV) AS SCHEDULED. PROVIDE ALL ASSOCIATED SUPPORTS AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM. REFER TO DRAWING M202 FOR ASSOCIATED DETAIL AND DRAWING M301 FOR SCHEDULED CAPACITY.
 2. PROVIDE DUCTWORK AS SHOWN IN ITS ENTIRETY. PROVIDE ALL REQUIRED SUPPORTS, INSULATION, AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM.
 3. PROVIDE AIR TERMINAL DEVICES AS INDICATED ON PLAN. REFER TO M200 DWGS FOR ASSOCIATED DETAILS AND M300 DWG FOR SCHEDULED CAPACITIES.
 4. LIGHTING FIXTURES IN BOARD ROOM 143 SHALL HAVE RETURN AIR CAPABILITY. TOTAL AIR FLOW SHALL EQUAL THE 2400 CFM. REFER TO ELECTRICAL DRAWINGS FOR COORDINATION.

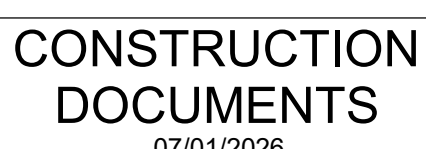

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: CJP
DRAWN: CJP
CHECKED: NBN
CHECKED:
APPROVED: RFJ
FILENAME
BC PROJECT NUMBER
Project Number
CLIENT PROJECT NUMBER

FIRST FLOOR NEW WORK PLAN

DRAWING NUMBER
M101