CONSTRUCTION NOTES:

1. PROVIDE ROOFTOP UNIT AND 24" TALL WIND RATED ROOF CURB IN ITS ENTIRETY. SECURE CURB TO STRUCTURE IN ACCORDANCE WITH GEORGIA STATE BUILDING CODE AND ASCE 7. COORDINATE WITH STRUCTURAL DWGS FOR FRAMING REQUIREMENTS AND ARCHITECTURAL DWGS FOR FLASHING REQUIREMENTS. PROVIDE ALL ASSOCIATED SUPPORTS, CONTROLS, AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM. REFER TO M200 DWGS FOR ASSOCIATED DETAILS AND M300 DWGS FOR SCHEDULED CAPACITY.
2. PROVIDE EXHAUST FAN AND 24" TALL WIND RATED ROOF CURB IN ITS ENTIRETY. SECURE CURB TO STRUCTURE IN ACCORDANCE WITH GEORGIA STATE BUILDING CODE AND ASCE 7. COORDINATE WITH STRUCTURAL DWGS FOR FRAMING REQUIREMENTS AND ARCHITECTURAL DWGS FOR FLASHING REQUIREMENTS. PROVIDE ALL ASSOCIATED SUPPORTS, CONTROLS, AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM. REFER TO M200 DWGS FOR ASSOCIATED DETAILS AND M300 DWGS FOR SCHEDULED CAPACITY.

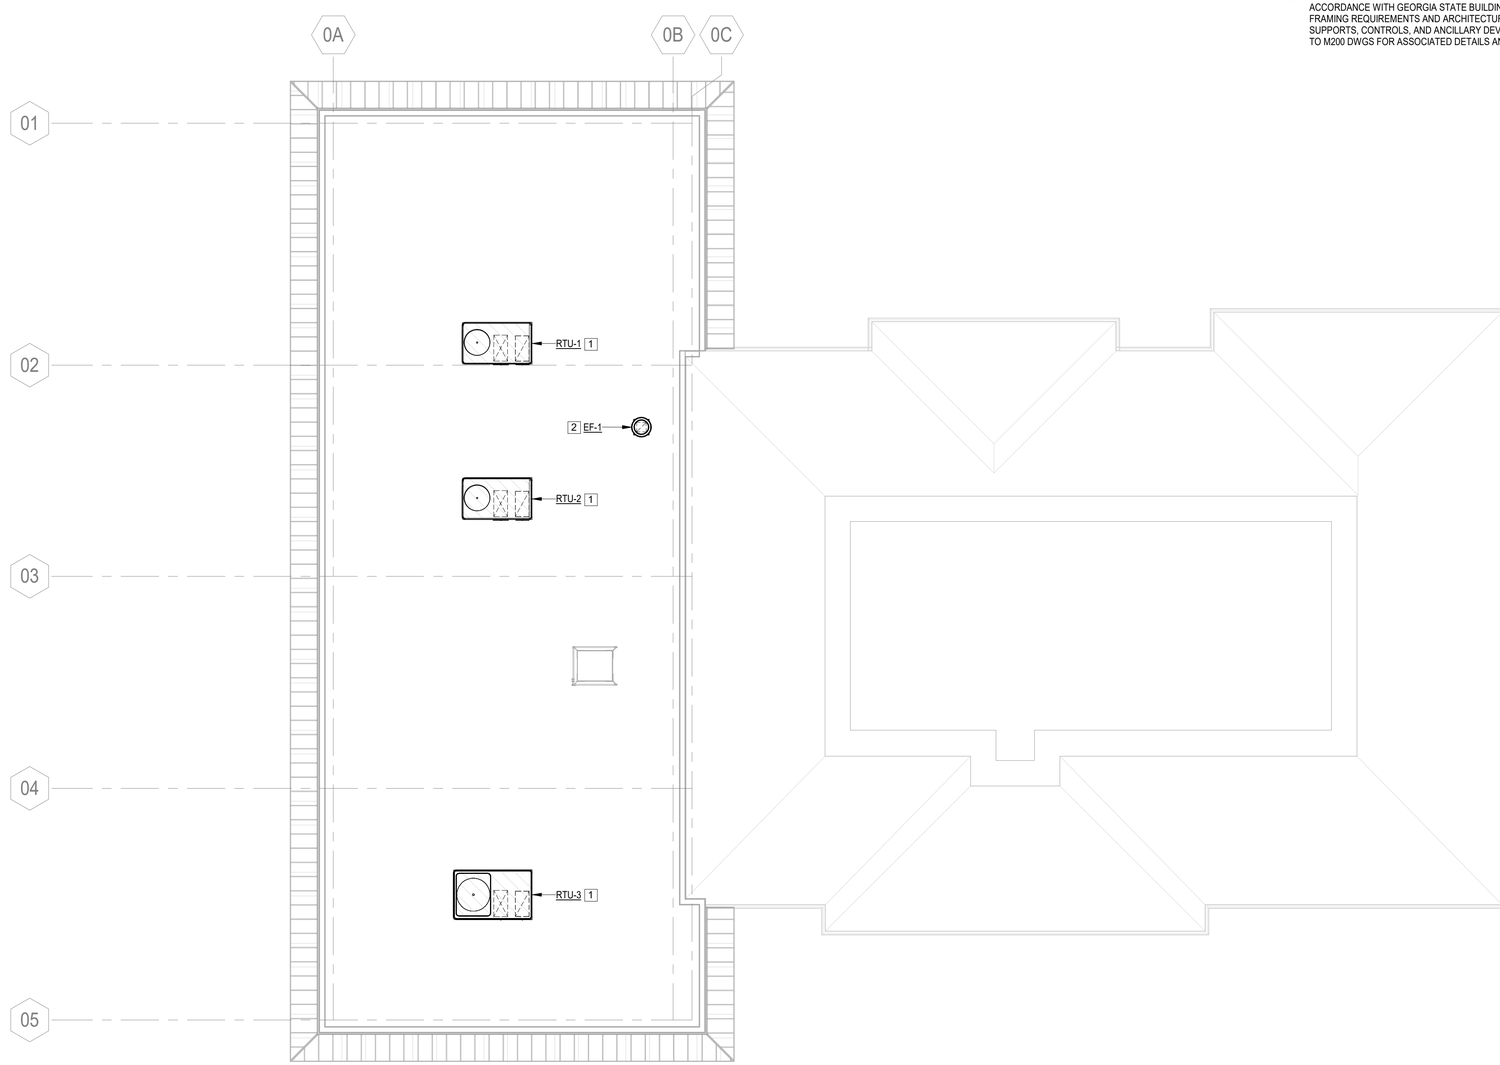

1 ROOF PLAN
SCALE: 1/8" = 1'-0"

Brown AND Caldwell
BROWN AND CALDWELL
900 HAMMOND DRIVE, SUITE 500
ATLANTA, GA 30328

wendel

GEORGIA REGISTERED PROFESSIONAL ENGINEER No. PE038409 RAYMOND F. JOHNSON, II 8/20/26

CONSTRUCTION DOCUMENTS
07/01/2026

NCWSA NEWTON COUNTY WATER & SEWERAGE AUTHORITY

NCWSA OFFICE ADDITION

REVISIONS

REV	DATE	DESCRIPTION
1	7/1/26	PERMIT SET

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: CJP
DRAWN: CJP
CHECKED: NBN
CHECKED:
APPROVED: RFJ
FILENAME

BC PROJECT NUMBER
Project Number
CLIENT PROJECT NUMBER

ROOF PLAN

DRAWING NUMBER
M103

Plot Date: 8/19/2026 2:26:55 PM Path: Autodesk Docs://NCWSA Admin Bldg_ V25/616202-NCWSA-MECH_V25.rvt