


123456


**GENERAL NOTES:**

A. EXACT DEVICE LOCATIONS SHALL BE VERIFIED WITH THE ARCHITECTURAL PLANS & ELEVATIONS PRIOR TO ROUGH-IN TO ACCOMMODATE CASEWORK FURNITURE, WINDOWS, EQUIPMENT, ETC.


B. DEVICES & EQUIPMENT SHALL BE CENTERED IN A COMMON VERTICAL PLANE. HEIGHT SHALL BE MEASURED FROM FINISHED FLOOR TO CENTERLINE OF DEVICE, UNLESS OTHERWISE SHOWN OR INDICATED.

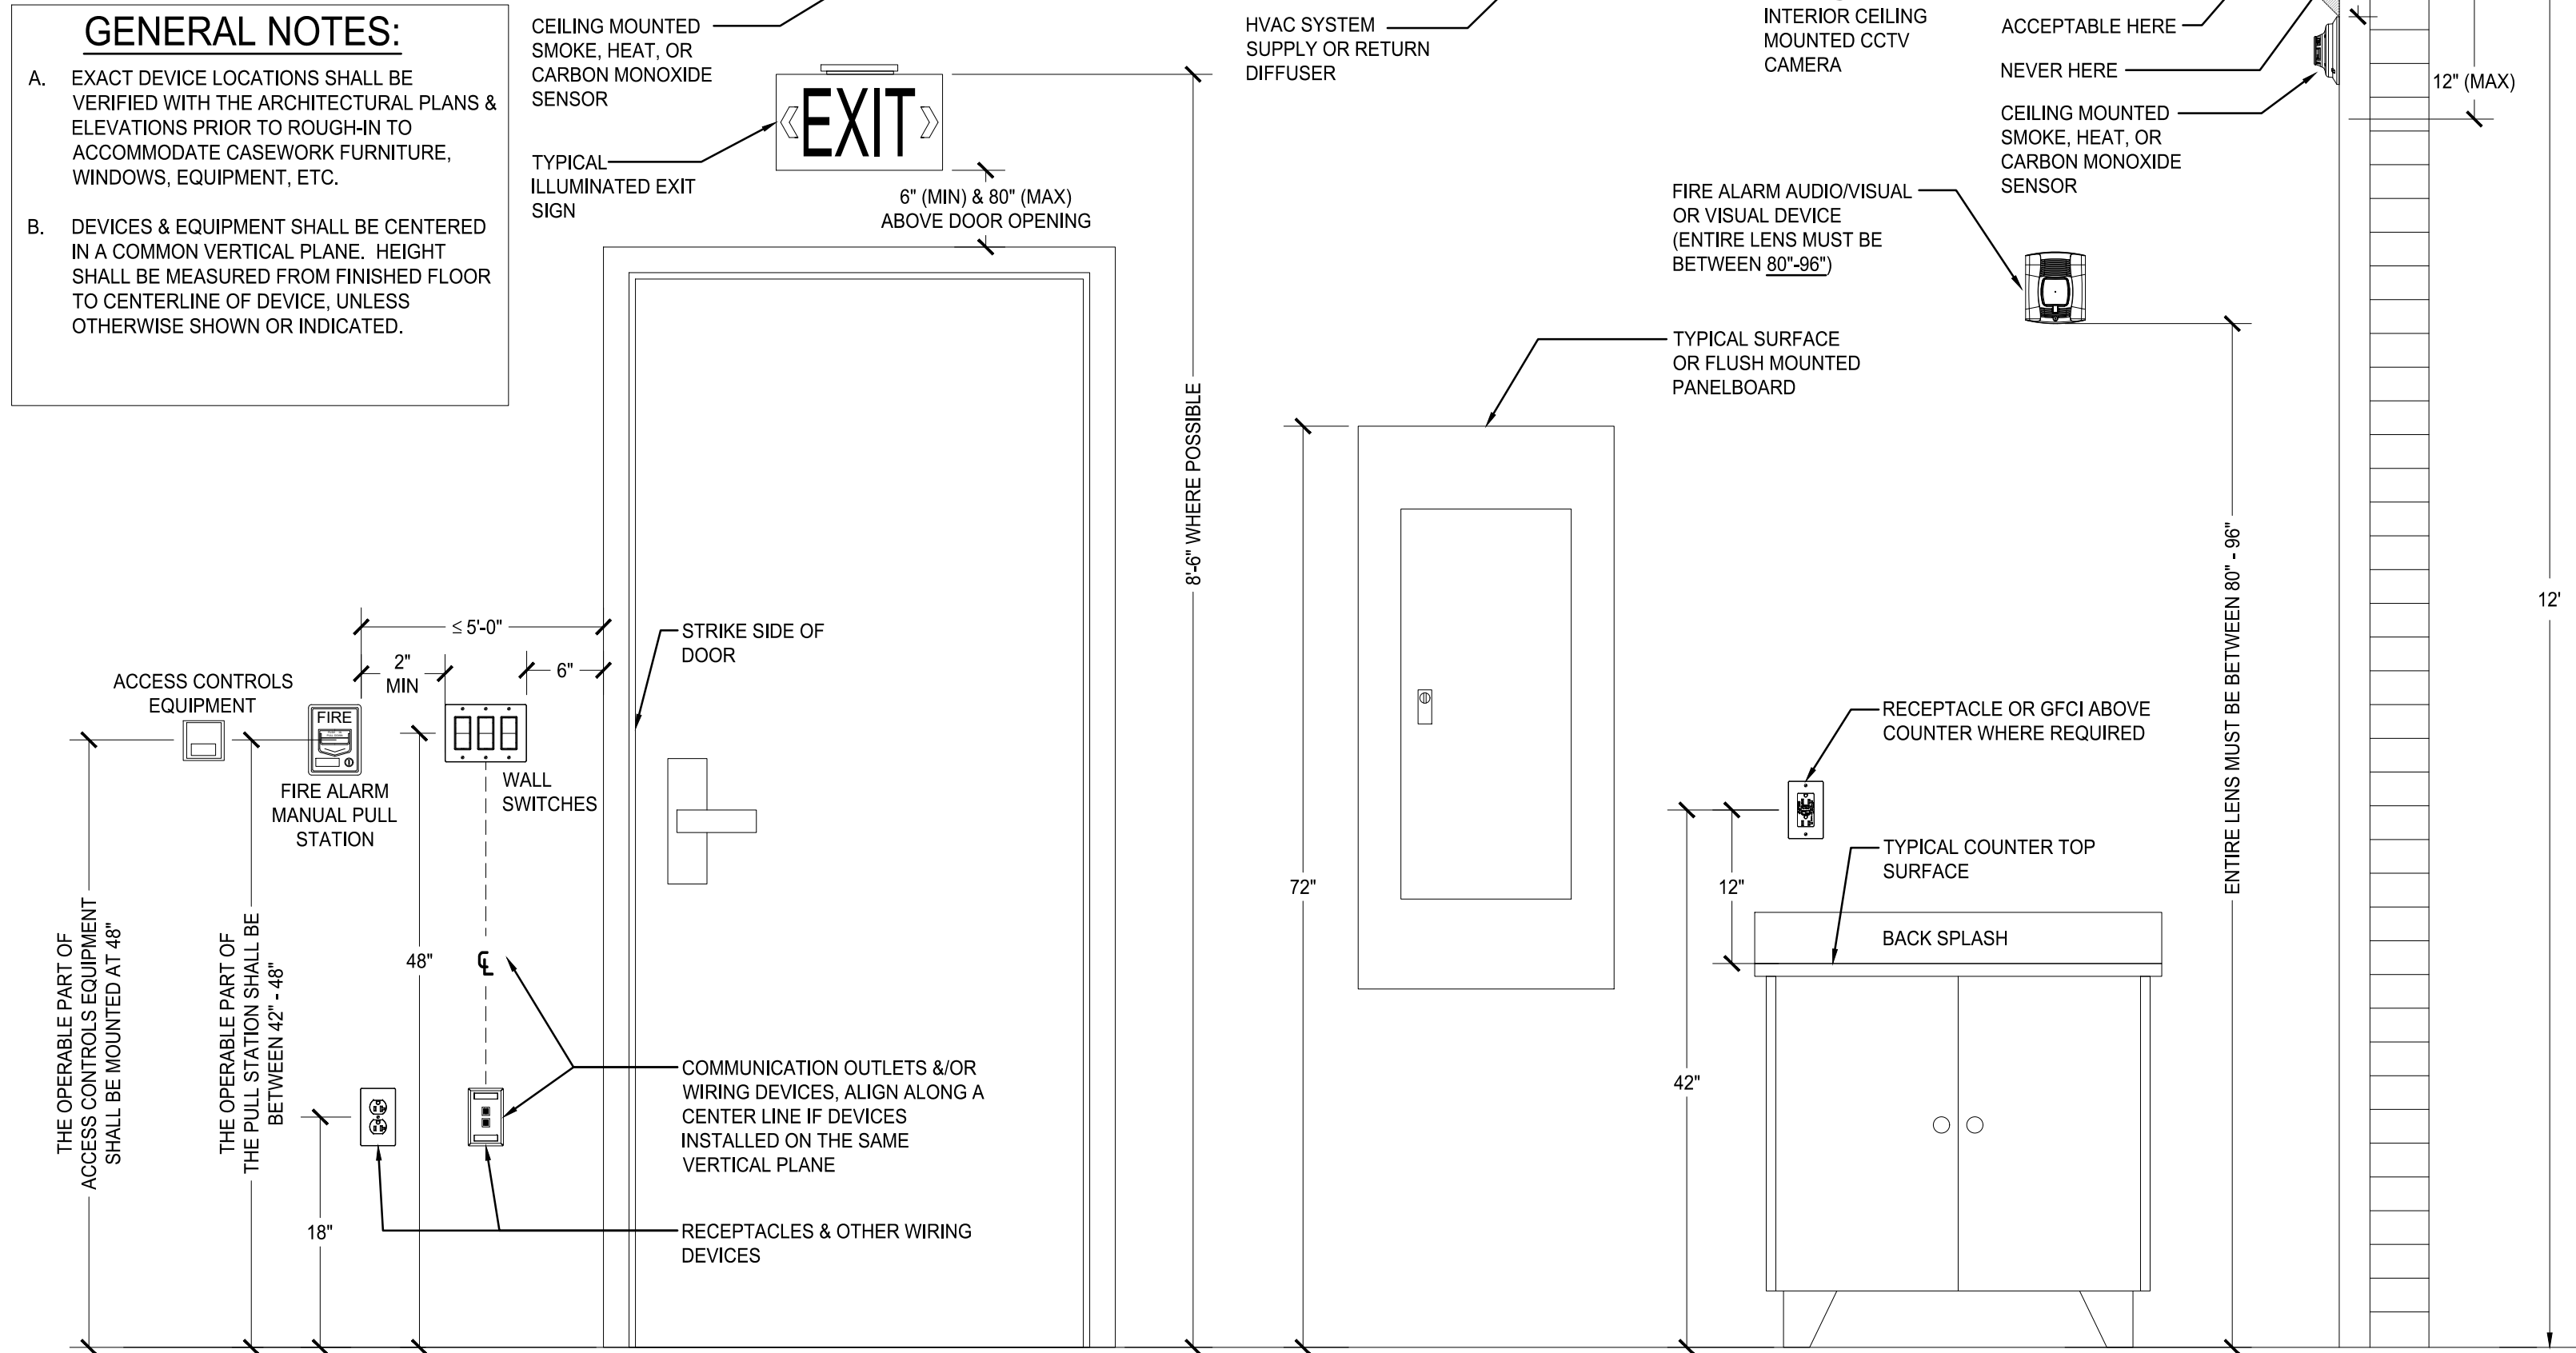


1 TYPICAL DEVICE & EQUIPMENT INSTALLATION HEIGHTS  
SCALE: NONE

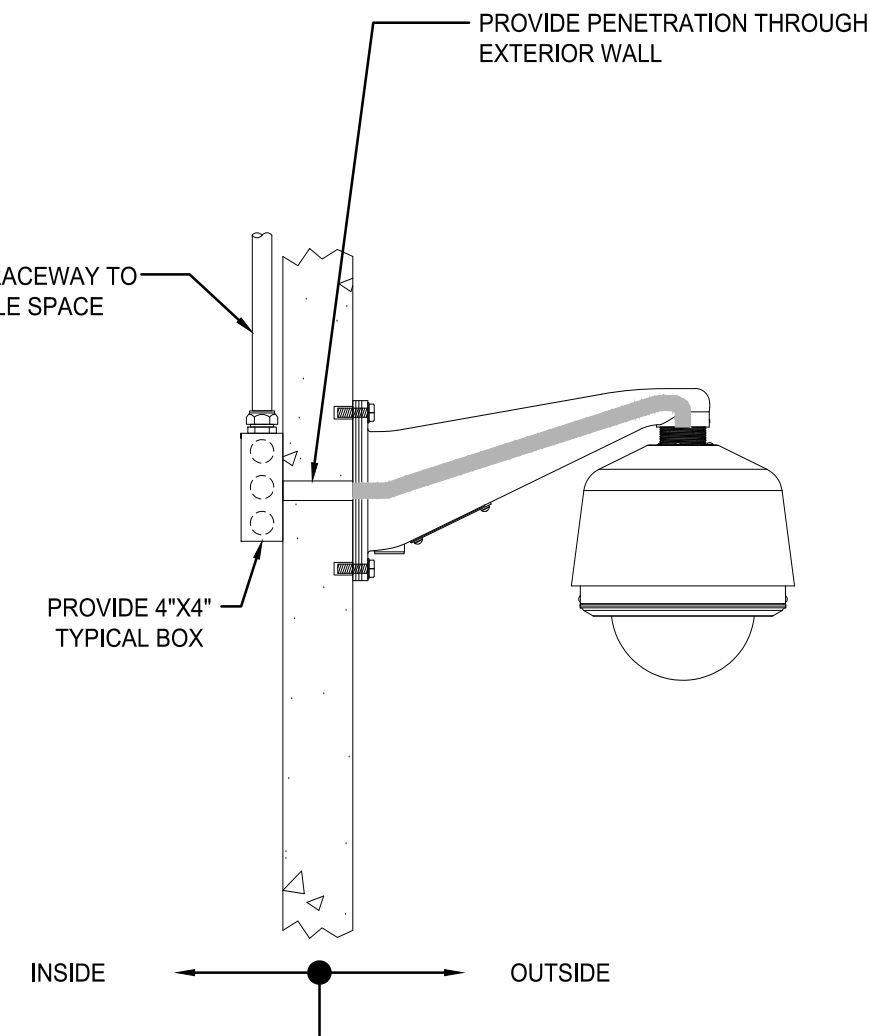

4 EXTERIOR WALL MOUNTED TYPICAL CCTV CAMERA DETAIL  
SCALE: NONE

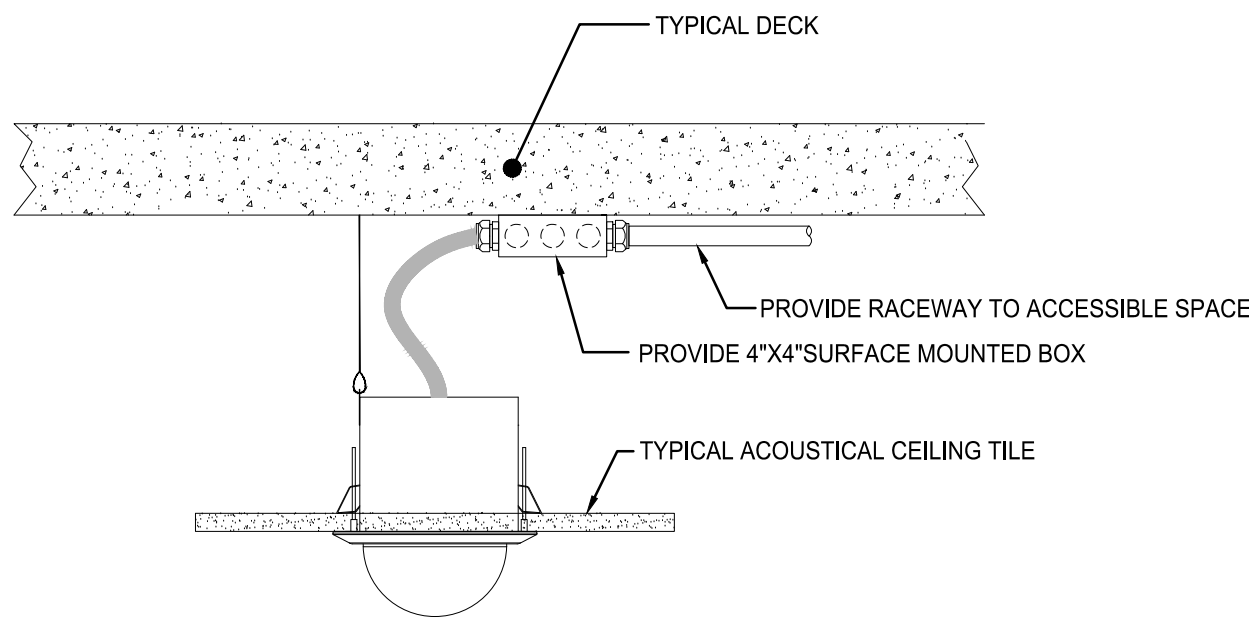


5 INTERIOR FLUSH CEILING MOUNTED TYPICAL CCTV CAMERA DETAIL  
SCALE: NONE

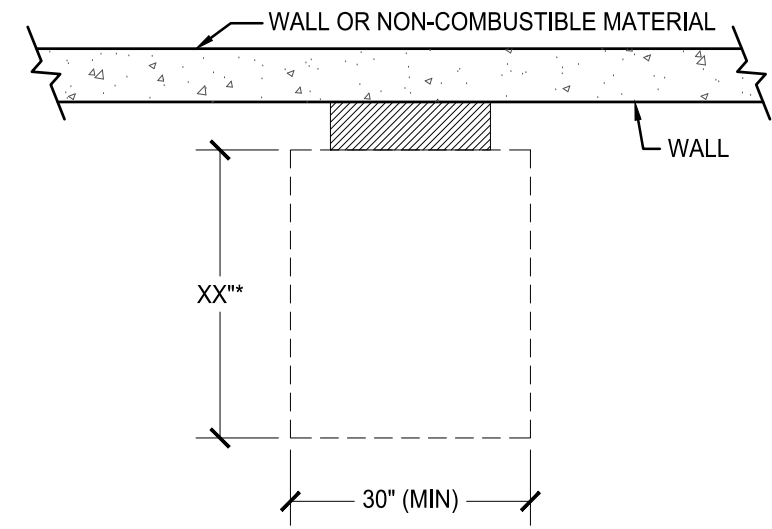


WALL MOUNTED PANELS  
(INCLUDING POWER PANELS, CONTRACTORS, CONTROL CABINETS, DISCONNECT SWITCHES, MOTOR STARTERS, TIME CLOCK & SIMILAR ELECTRICAL EQUIPMENT)

- NOTES:**
- A. XX" IDENTIFIES MINIMUM WORKING SPACE CLEARANCE REQUIREMENTS [IN THE DIRECTION OF ACCESS TO LIVE PARTS AS REQUIRED PER NFPA 70, SECTION 110.26(a)]
- 36" FOR 0-150V PHASE TO GROUND ELECTRIC EQUIPMENT.
  - 42" FOR 150-600V PHASE TO GROUND EQUIPMENT (CONDITION 2 "LIVE TO GROUND")
  - 48" FOR 150-600V PHASE TO GROUND EQUIPMENT (CONDITION 3 "BETWEEN LIVE EQUIPMENT")
- B. MINIMUM WORKING SPACE HEAD ROOM SHALL BE 78" AFF.

2 TYPICAL ELECTRICAL EQUIPMENT CLEARANCES  
SCALE: NONE

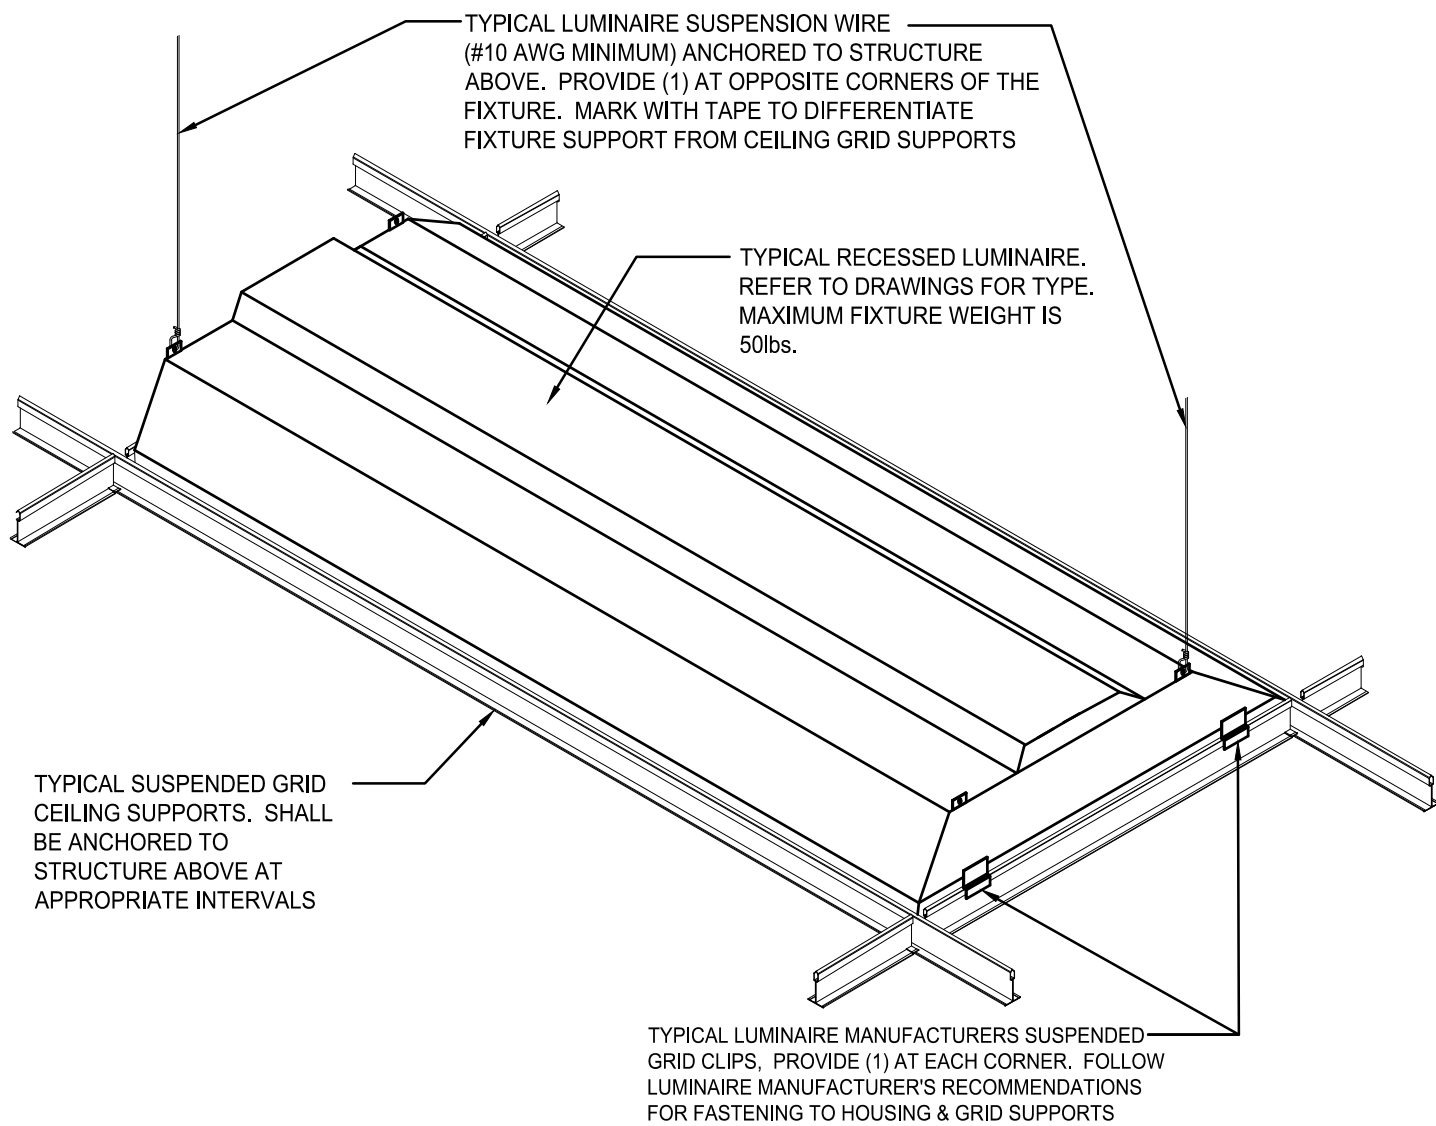

3 TYPICAL TROFFER INSTALLATION DETAIL  
SCALE: NONE

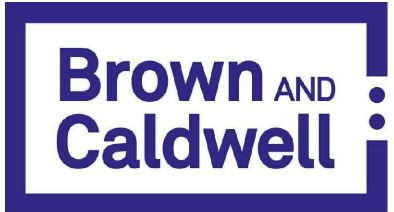

BROWN AND CALDWELL  
900 HAMMOND DRIVE, SUITE 500  
ATLANTA, GA 30328



THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL



CONSTRUCTION DOCUMENTS  
07/01/2026



NCWSA OFFICE ADDITION

REVISIONS

| REV | DATE | DESCRIPTION |
|-----|------|-------------|
|     |      |             |
|     |      |             |
|     |      |             |
|     |      |             |
|     |      |             |
|     |      |             |
|     |      |             |
|     |      |             |
|     |      |             |

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: MAP

DRAWN: MAP

CHECKED: JFW

CHECKED:

APPROVED:

FILENAME

BC PROJECT NUMBER

616202

CLIENT PROJECT NUMBER

ELECTRICAL  
DETAILS

DRAWING NUMBER

E401

123456