



LOAD MAP KEY						
LOAD MARK	OCCUPANCY OR USE	SUPERIMPOSED DEAD LOAD (PSF)	LIVE LOAD (PSF)	LIVE LOAD REDUCTION	CONCENTRATED LIVE LOAD (LB)	REMARKS
ME	MECHANICAL/ELECTRICAL	20	125	NO	-	-
OCL	OFFICES, CORRIDORS, LOBBIES	20	100	NO	2000	-
RO-S	STEEL ROOF	20	20	YES	300	-
RO-W	WOOD ROOF	TOP CHORD DL = 10 PSF BOTTOM CHORD DL = 10 PSF	TOP CHORD LL = 20 PSF	YES	300	TRUSS SELF WEIGHT = 3 PSF (ASSUMED)
ST	LIGHT STORAGE	20	125	NO	-	-

- LOAD MAP NOTES:**
- FOR DESIGN LOAD CRITERIA, SEE S002.
 - SUPERIMPOSED DEAD LOADS ARE IN ADDITION TO THE SELF-WEIGHT OF THE STEEL COMPOSITE STRUCTURE.
 - SEE FRAMING PLANS FOR DESIGN LOADS OF SPECIFIC ITEMS SUCH AS MECHANICAL EQUIPMENT.
 - LIVE LOAD REDUCTION SHALL BE IN ACCORDANCE WITH THE REFERENCED BUILDING CODE.
 - ALL LOADS ARE UNFACTORED FOR USE IN THE APPLICABLE LOAD COMBINATIONS OF THE REFERENCED BUILDING CODE, UNO.

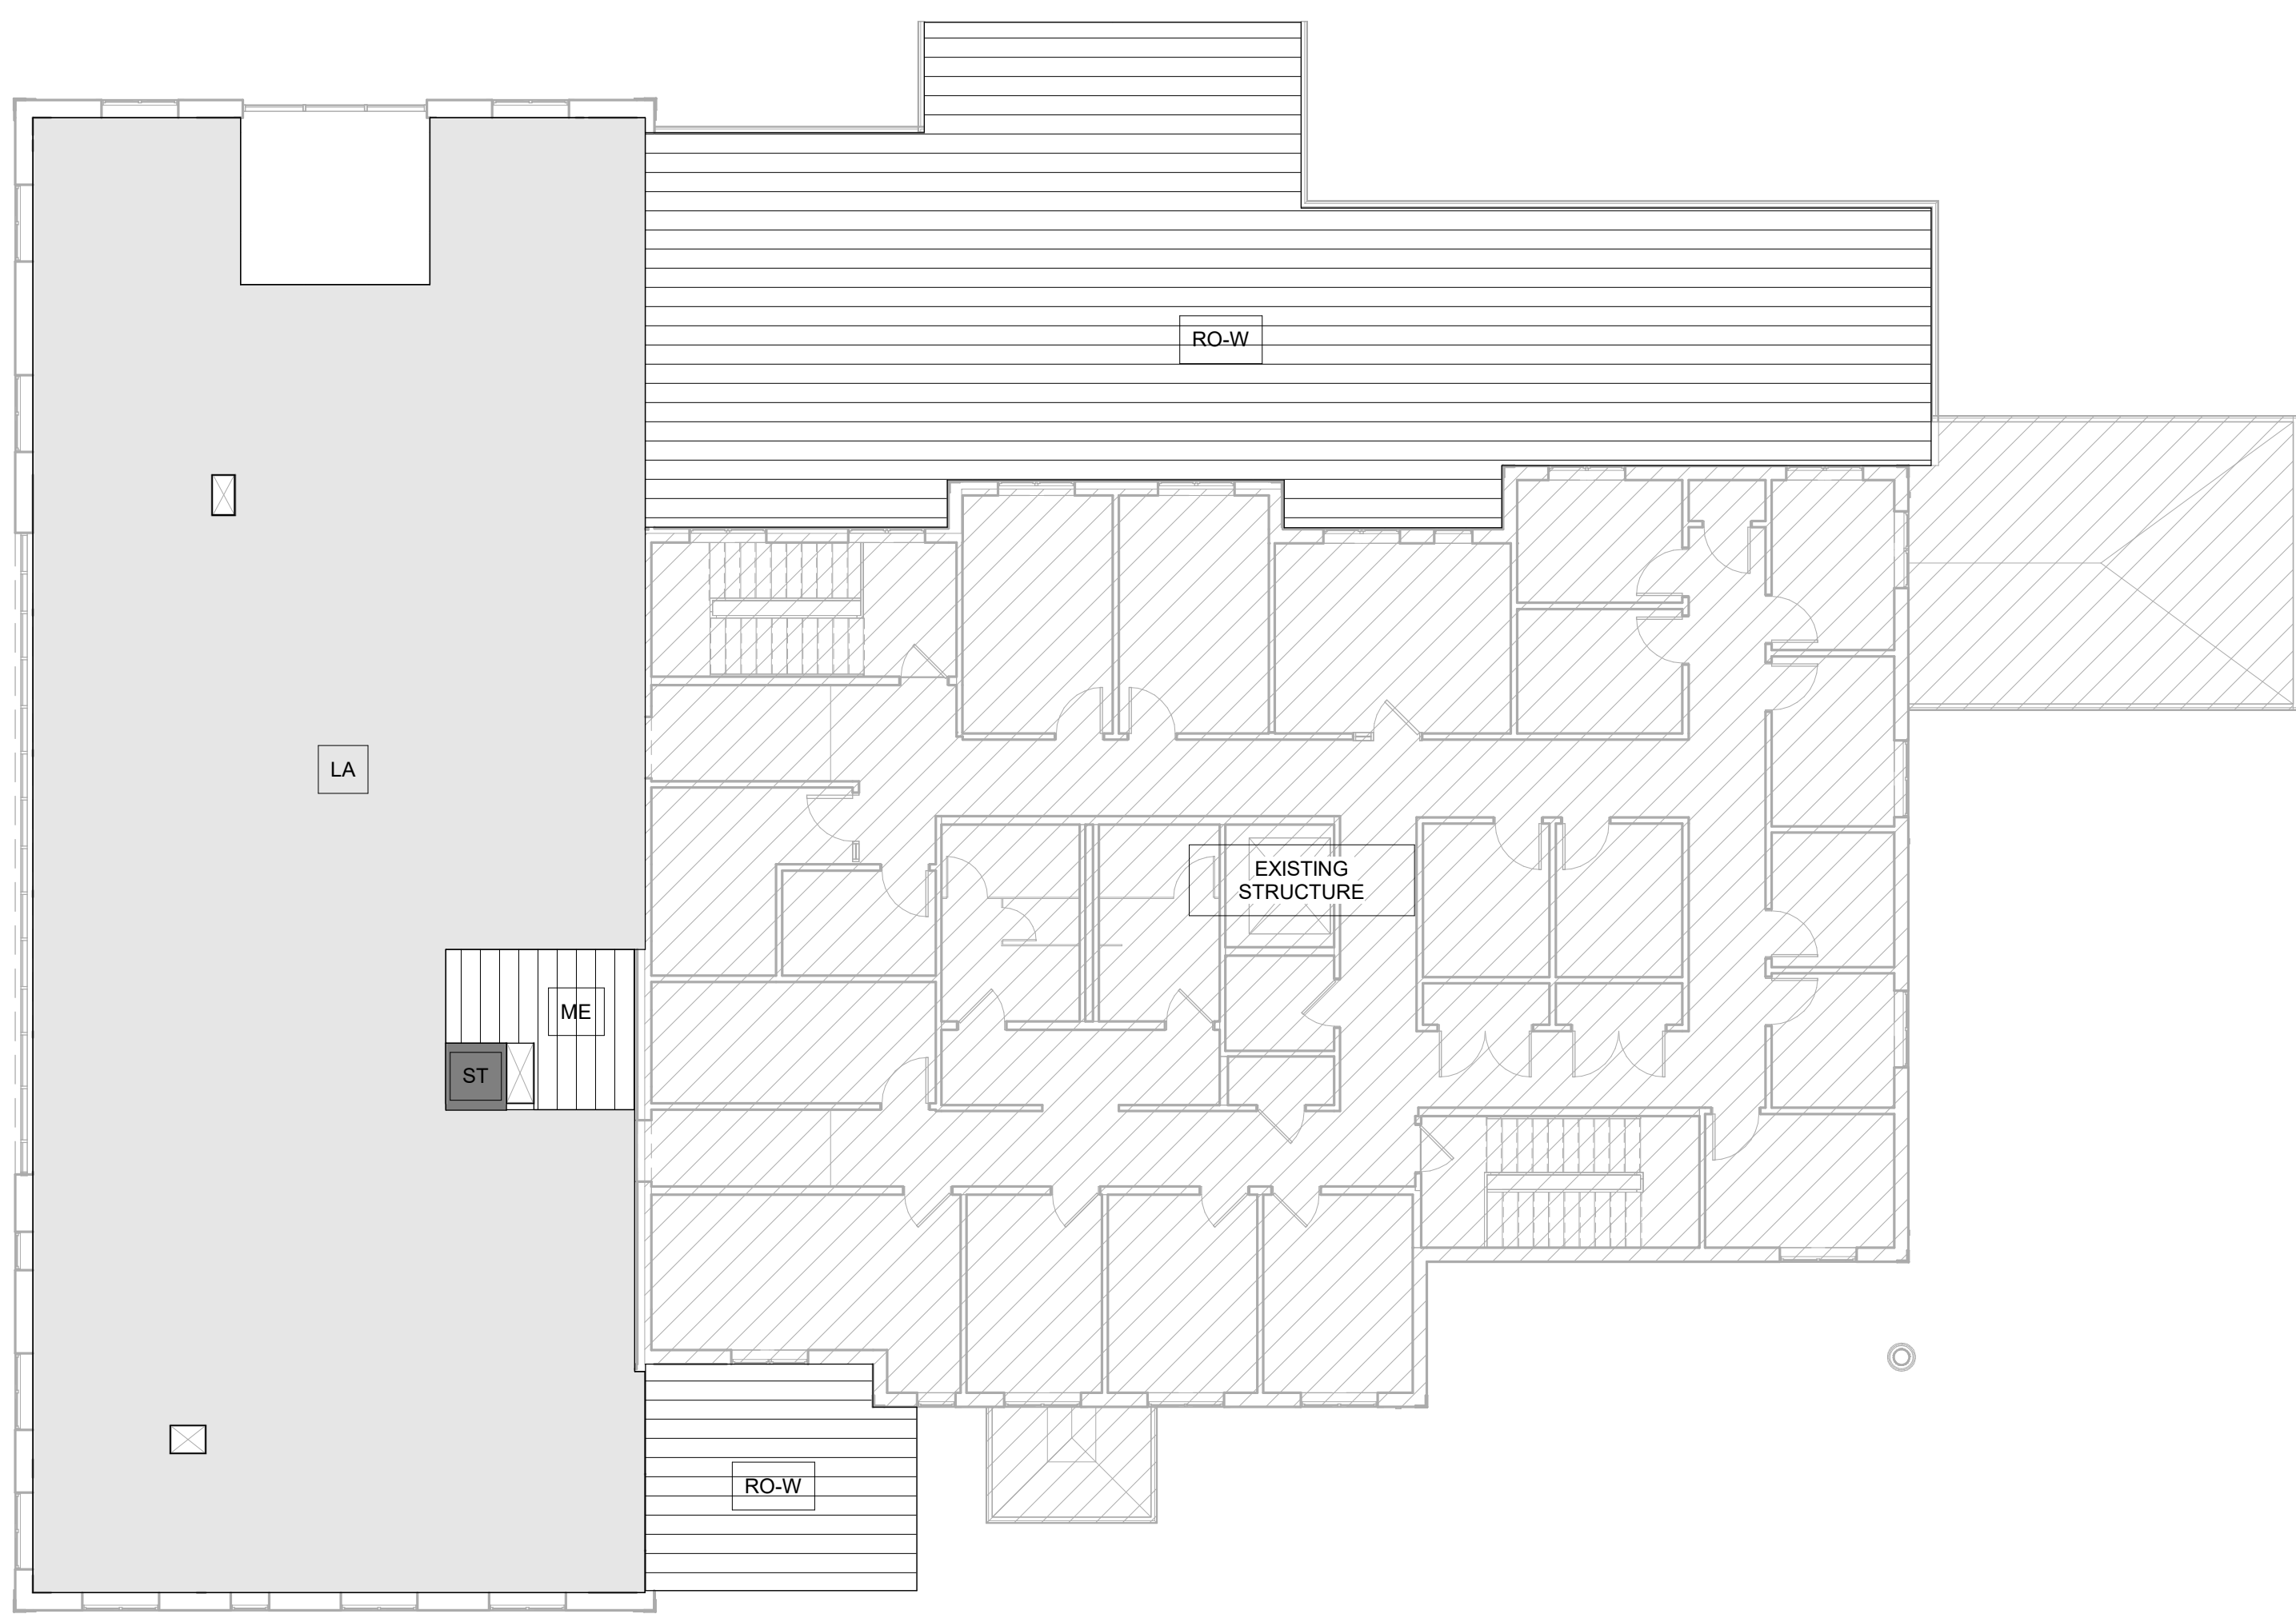

LEVEL 2 LOAD MAP
SCALE: 1" = 10'-0"
1
S002A

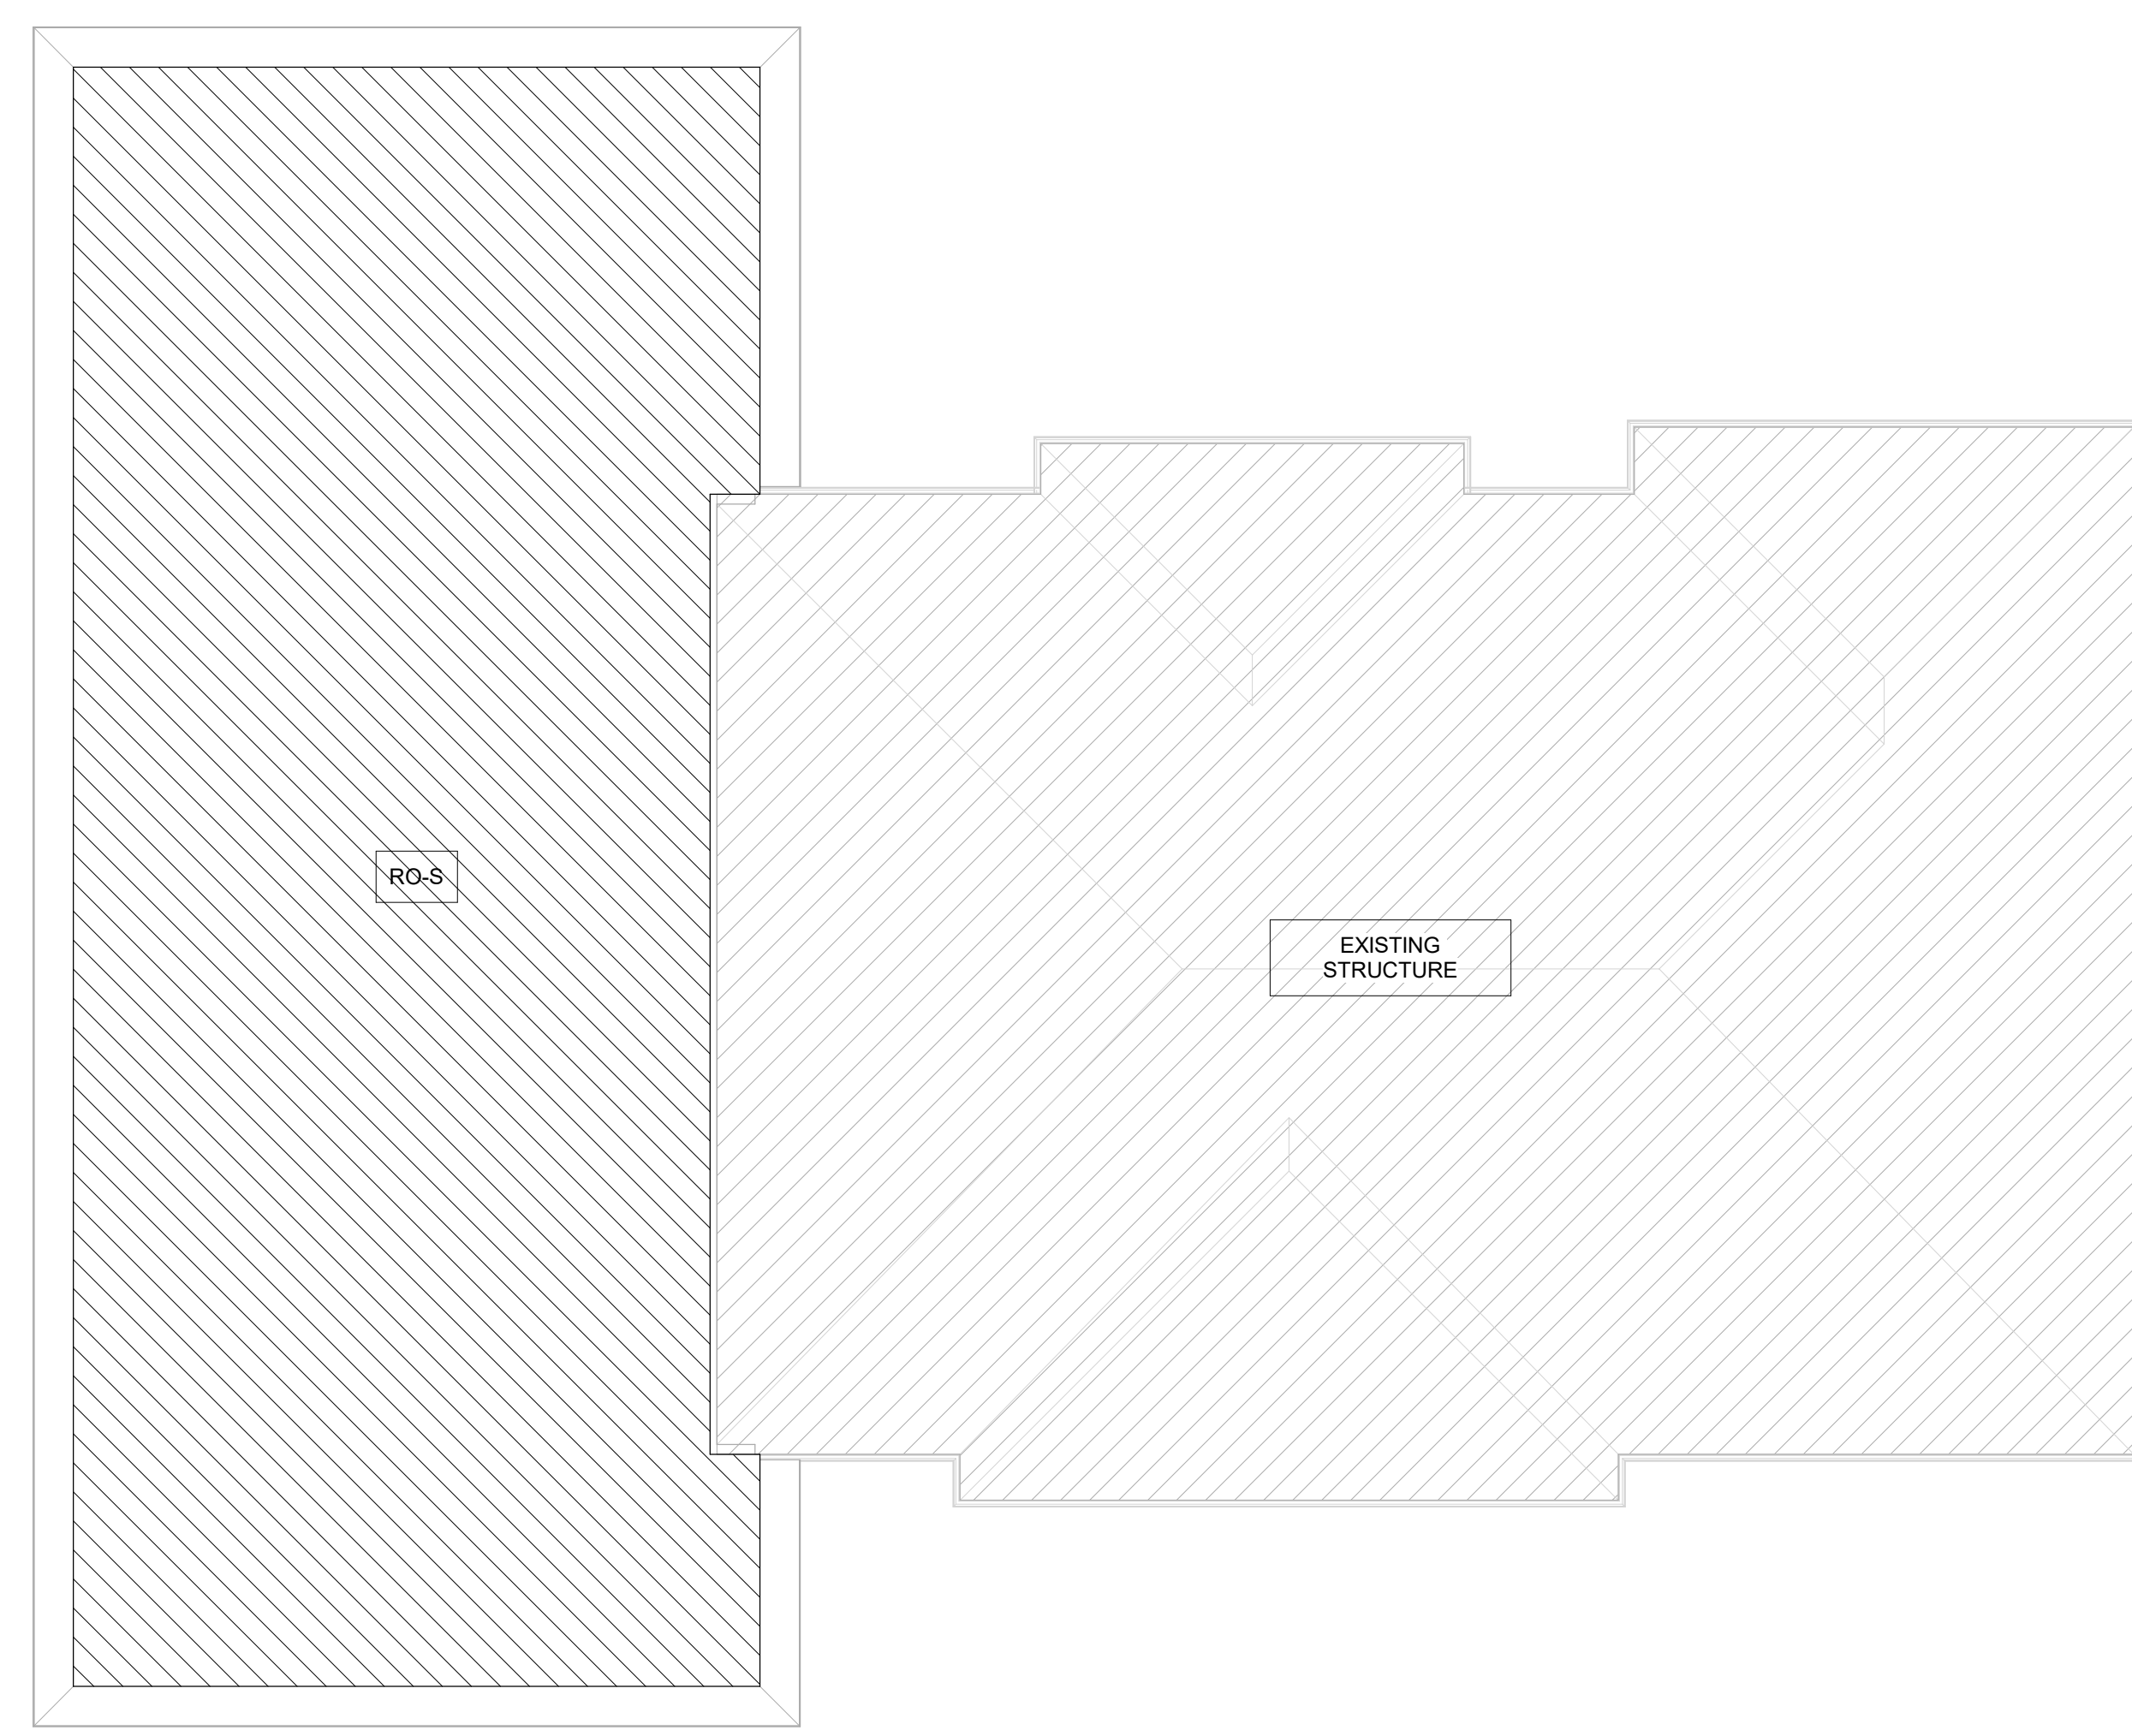

ROOF LOAD MAP
SCALE: 1" = 10'-0"
2
S002A



BROWN AND CALDWELL
900 HAMMOND DRIVE, SUITE 500
ATLANTA, GA 30328



Project Status



Project Name

REVISIONS		
REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: Designer
DRAWN: Author
CHECKED: Checker
CHECKED:
APPROVED: Approver
FILENAME

BC PROJECT NUMBER
Project Number
CLIENT PROJECT NUMBER

LOAD MAPS

DRAWING NUMBER
S002A

Plot Date: 3/12/2026 12:24:09 AM Path: Autodeskt Doss://NCWSA Admin Bldg._V25/02506663-NCWSA Office Addition-R25-STRUCT.rvt