GENERAL NOTES:

A. PROVIDE TURNING VANES AT ALL RECTANGULAR SUPPLY ELBOWS

[X] CONSTRUCTION NOTES:

1. PROVIDE VARIABLE AIR VOLUME (VAV) AS SCHEDULED. PROVIDE ALL ASSOCIATED SUPPORTS AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM. REFER TO DRAWING M202 FOR ASSOCIATED DETAIL AND DRAWING M301 FOR SCHEDULED CAPACITY.
2. PROVIDE DUCTWORK AS SHOWN IN ITS ENTIRETY. PROVIDE ALL REQUIRED SUPPORTS, INSULATION, AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM.
3. PROVIDE AIR TERMINAL DEVICES AS INDICATED ON PLAN. REFER TO M200 DWGS FOR ASSOCIATED DETAILS AND M300 DWG FOR SCHEDULED CAPACITIES.
4. LIGHTING FIXTURES IN BOARD ROOM 143 SHALL HAVE RETURN AIR CAPABILITY. TOTAL AIR FLOW SHALL EQUAL THE 1500 CFM. REFER TO ELECTRICAL DRAWINGS FOR COORDINATION.

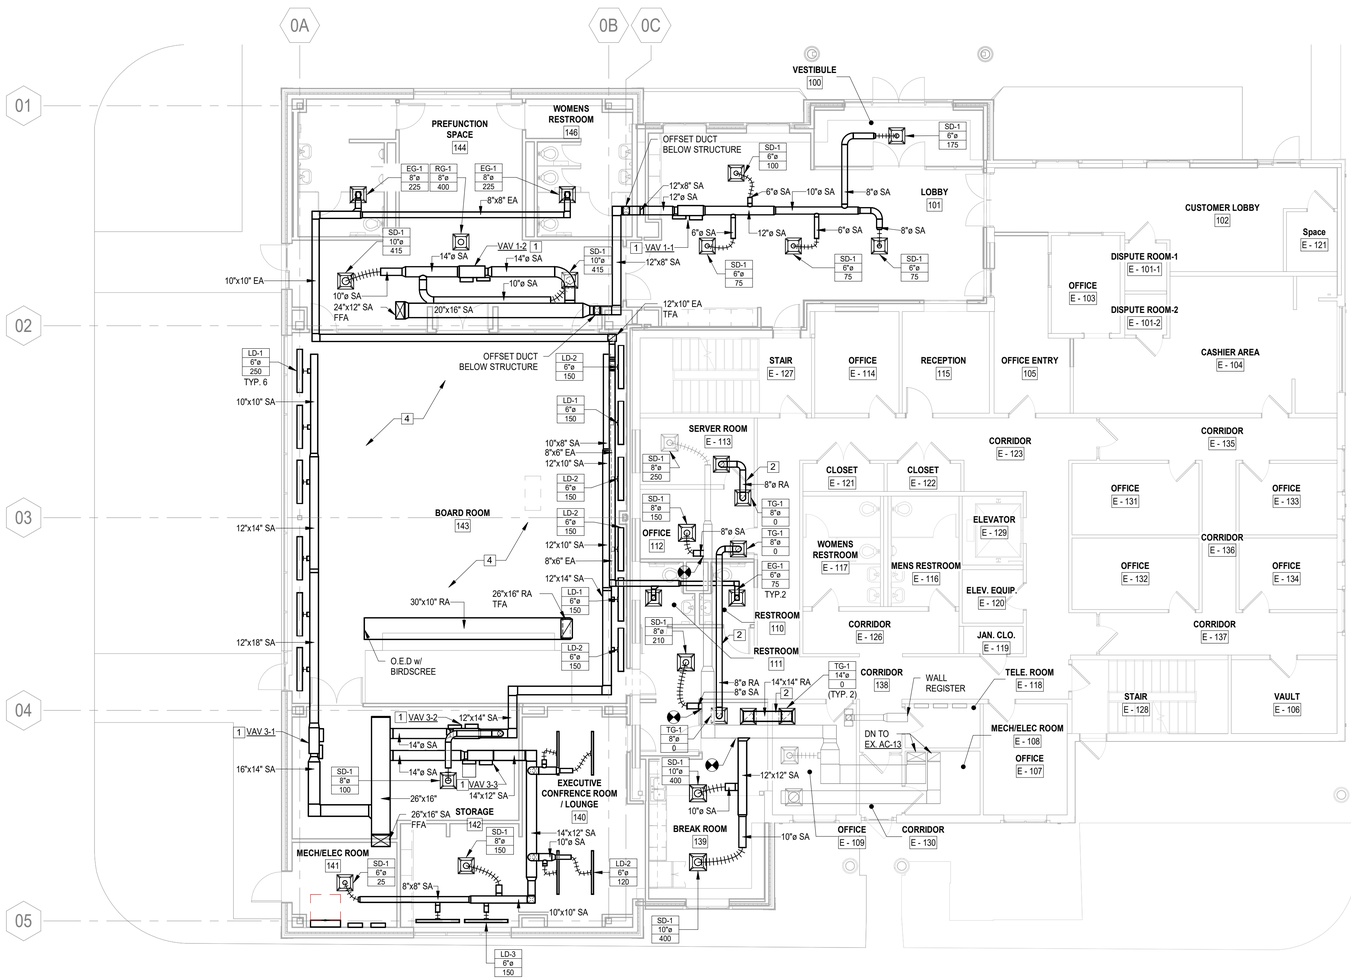

1 FIRST FLOOR NEW WORK PLAN
SCALE: 1/8" = 1'-0"

Brown AND Caldwell
BROWN AND CALDWELL
900 HAMMOND DRIVE, SUITE 500
ATLANTA, GA 30328

wendel

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

60% DESIGN DOCUMENTS

NCWSA NEWTON COUNTY WATER & SEWERAGE AUTHORITY

NCWSA OFFICE ADDITION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: CJP
DRAWN: CJP
CHECKED: NBN
CHECKED:
APPROVED: RFJ

FILENAME

BC PROJECT NUMBER
Project Number
CLIENT PROJECT NUMBER

FIRST FLOOR NEW WORK PLAN

DRAWING NUMBER
M101

Path: Autodesk Docs://NCWSA Admin Bldg_ V25/616202-NCWSA-MECH_V25.rvt
Plot Date: 3/23/2026 4:00:12 PM