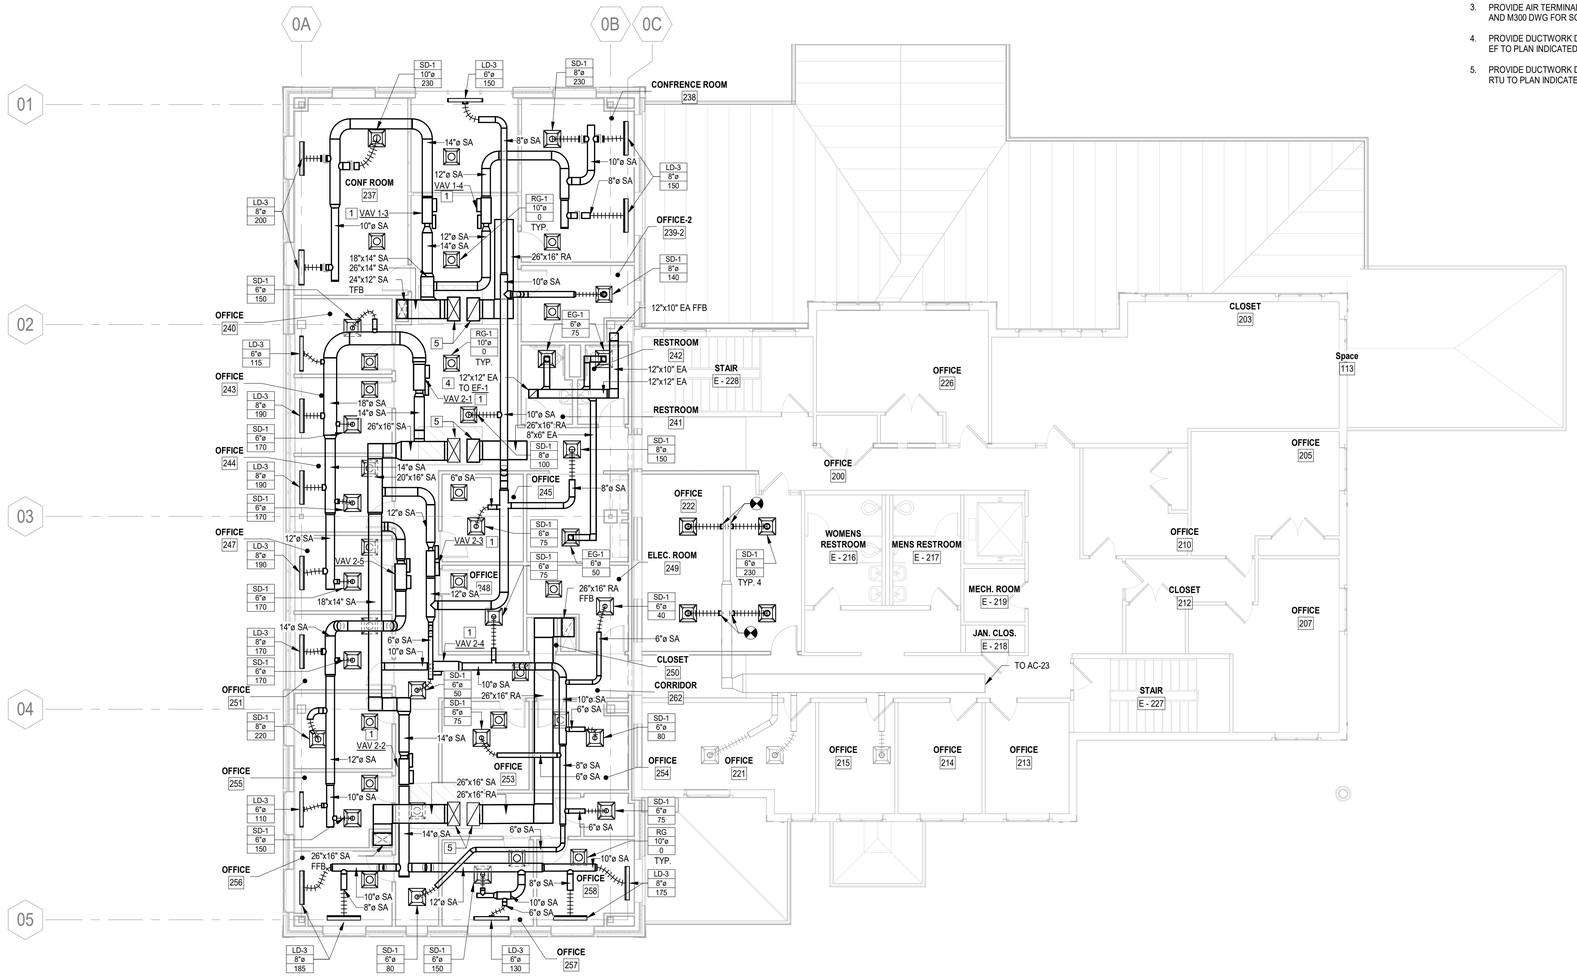

1 SECOND FLOOR NEW WORK PLAN
SCALE: 1/8" = 1'-0"

X CONSTRUCTION NOTES:

1. PROVIDE VARIABLE AIR VOLUME (VAV) AS SCHEDULED. PROVIDE ALL ASSOCIATED SUPPORTS AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM. REFER TO DRAWING M202 FOR ASSOCIATED DETAIL AND DRAWING M301 FOR SCHEDULED CAPACITY.
2. PROVIDE DUCTWORK AS SHOWN IN ITS ENTIRETY. PROVIDE ALL REQUIRED SUPPORTS, INSULATION, AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM.
3. PROVIDE AIR TERMINAL DEVICES AS INDICATED ON PLAN. REFER TO M200 DWGS FOR ASSOCIATED DETAILS AND M300 DWG FOR SCHEDULED CAPACITIES
4. PROVIDE DUCTWORK DROP FROM EXHAUST FAN (EF) ABOVE. PROVIDE ALL REQUIRED TRANSITIONS FROM EF TO PLAN INDICATED DIMENSIONS. PROVIDE INSULATED MOTORIZED DAMPER AT THE BUILDING ENVELOPE
5. PROVIDE DUCTWORK DROP FROM ROOF TOP UNIT (RTU) ABOVE. PROVIDE ALL REQUIRED TRANSITIONS FROM RTU TO PLAN INDICATED DIMENSIONS. PROVIDE INSULATED MOTORIZED DAMPER AT THE BUILDING ENVELOPE

Brown AND Caldwell
BROWN AND CALDWELL
900 HAMMOND DRIVE, SUITE 500
ATLANTA, GA 30328
wendel

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

60% DESIGN DOCUMENTS

NCWSA NEWTON COUNTY WATER & SEWERAGE AUTHORITY

NCWSA OFFICE ADDITION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: CJP
DRAWN: CJP
CHECKED: NBN
CHECKED:
APPROVED: RFJ
FILENAME
BC PROJECT NUMBER
Project Number
CLIENT PROJECT NUMBER

SECOND FLOOR NEW WORK PLAN

DRAWING NUMBER
M102

Plot Date: 3/23/2026 4:00:17 PM
Path: Autodesk Docs://NCWSA Admin Bldg_ V25/616202-NCWSA-MECH_V25.rvt