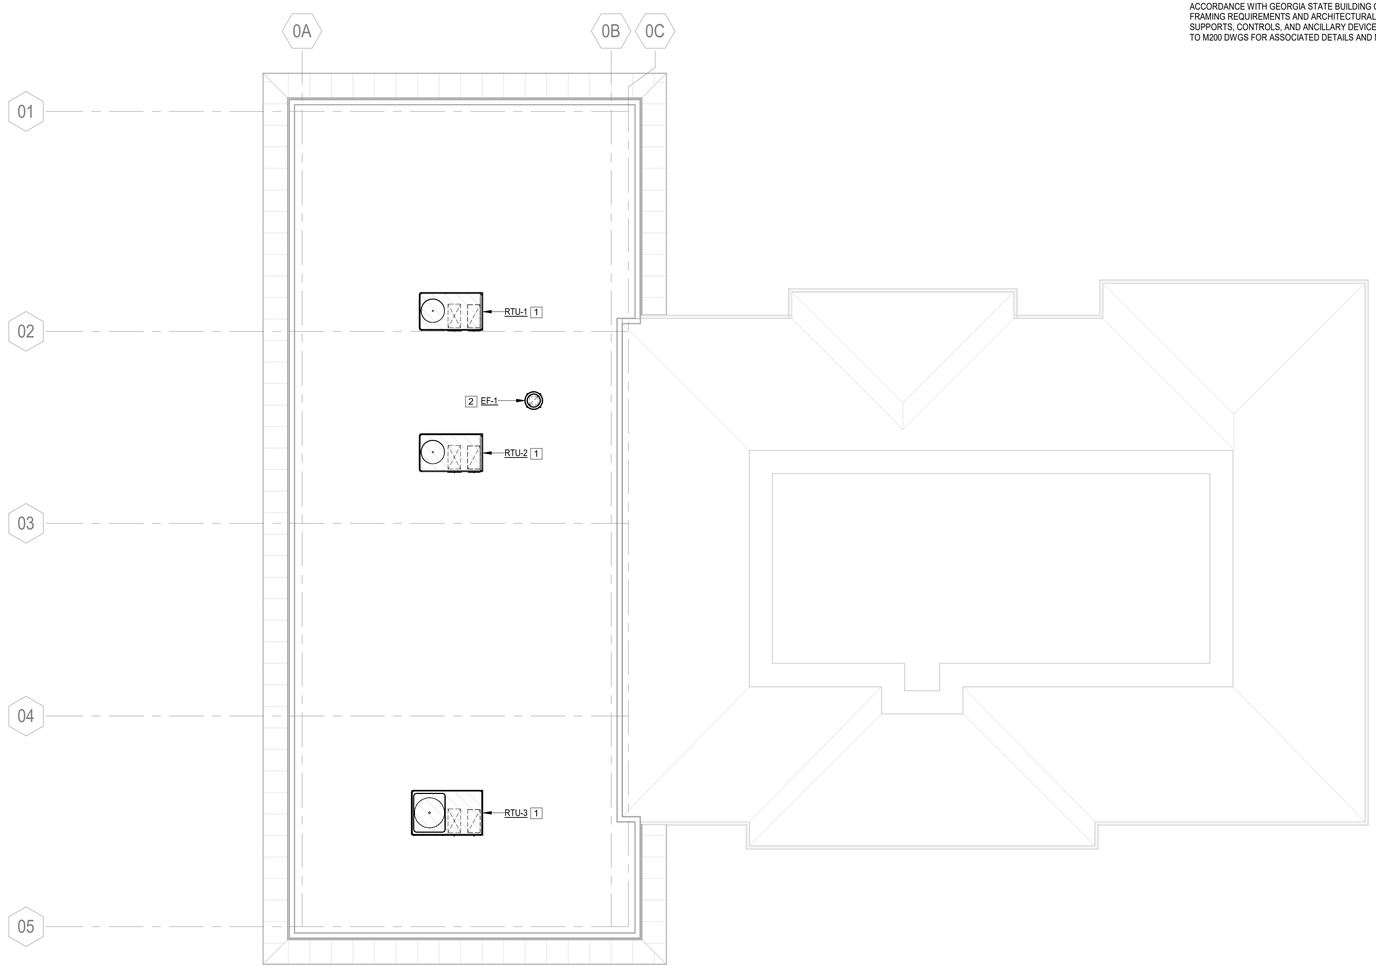

1 ROOF PLAN
SCALE: 1/8" = 1'-0"

X CONSTRUCTION NOTES:

1. PROVIDE ROOFTOP UNIT AND X" TALL WIND RATED ROOF CURB IN ITS ENTIRETY. SECURE CURB TO STRUCTURE IN ACCORDANCE WITH GEORGIA STATE BUILDING CODE AND ASCE 7. COORDINATE WITH STRUCTURAL DWGS FOR FRAMING REQUIREMENTS AND ARCHITECTURAL DWGS FOR FLASHING REQUIREMENTS. PROVIDE ALL ASSOCIATED SUPPORTS, CONTROLS, AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM. REFER TO M200 DWGS FOR ASSOCIATED DETAILS AND M300 DWGS FOR SCHEDULED CAPACITY.
2. PROVIDE EXHAUST FAN AND X" TALL WIND RATED ROOF CURB IN ITS ENTIRETY. SECURE CURB TO STRUCTURE IN ACCORDANCE WITH GEORGIA STATE BUILDING CODE AND ASCE 7. COORDINATE WITH STRUCTURAL DWGS FOR FRAMING REQUIREMENTS AND ARCHITECTURAL DWGS FOR FLASHING REQUIREMENTS. PROVIDE ALL ASSOCIATED SUPPORTS, CONTROLS, AND ANCILLARY DEVICES AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM. REFER TO M200 DWGS FOR ASSOCIATED DETAILS AND M300 DWGS FOR SCHEDULED CAPACITY.

Brown AND Caldwell
BROWN AND CALDWELL
900 HAMMOND DRIVE, SUITE 500
ATLANTA, GA 30328

wendel

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

60% DESIGN DOCUMENTS

NCWSA NEWTON COUNTY WATER & SEWERAGE AUTHORITY

NCWSA OFFICE ADDITION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: CJP
DRAWN: CJP
CHECKED: NBN
CHECKED:
APPROVED: RFJ
FILENAME

BC PROJECT NUMBER
Project Number
CLIENT PROJECT NUMBER

ROOF PLAN

DRAWING NUMBER
M103

Path: Autodesk Docs://NCWSA Admin Bldg_ V25/616202-NCWSA-MECH_V25.rvt
Plot Date: 3/23/2026 4:00:20 PM