


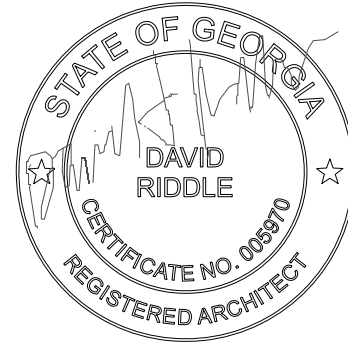


REVISIONS

#	DATE

A NEW
EMS
FACILITY
FOR:

OCONEE
COUNTY

WATKINSVILLE,
GEORGIA

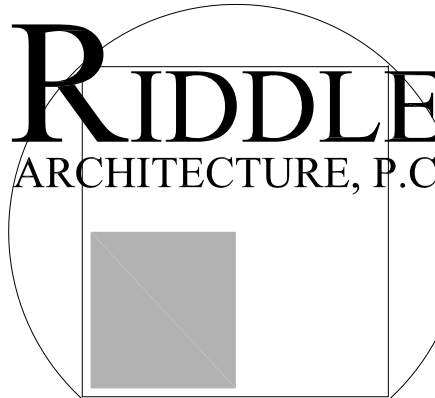

497 BROOMSEDGE COURT
BOLIVIA, NC
28422
(404) 285-8646

TITLE: FLOOR
PLAN

JOB #: 2502

DATE: 09.11.26

SHEET #

A1

Model 1384-B



**Superior Fire Suppression
for Commercial Occupancies
Where Residential Style
Appliances Are in Use**

Over 400,000 systems installed
and supported by our distributors
worldwide since 1985



Specifications:

Model 1384-B

Operation: Mechanical

Coverage:
Electric and Gas Ranges may not exceed a
width of 36" wide x 24" deep or 864 sqi.

Hood:
Any standard residential hood with a single
light and fan in the center that meets the same
range size requirements. The bottom of the
hood cannot exceed 30" from the range top.

Nozzles:
The nozzle tip must be at least 18" above the
range with a maximum of 28".

Fusible Links:
Distance from the detection links to the range
top shall not exceed 26 1/2". Globe "B" links
are used.

Fuel Shutoff:
Each system is UL Listed with a gas or electric
fuel shutoff.

Pre-Assembled • Pre-Engineered


When a fire occurs, one or more of the four
fusible links will separate, releasing the cable
tension, which discharges the system.

Selective code officials recommend and
accept the Guardian System for commercial
occupancies where residential appliances are
in use.



www.guardianssi.com



UL Subject 300A, UL 299, UL 864, NFPA 10
See ICC-ES Listing, No. 1166 at www.icc-es-pmg.org

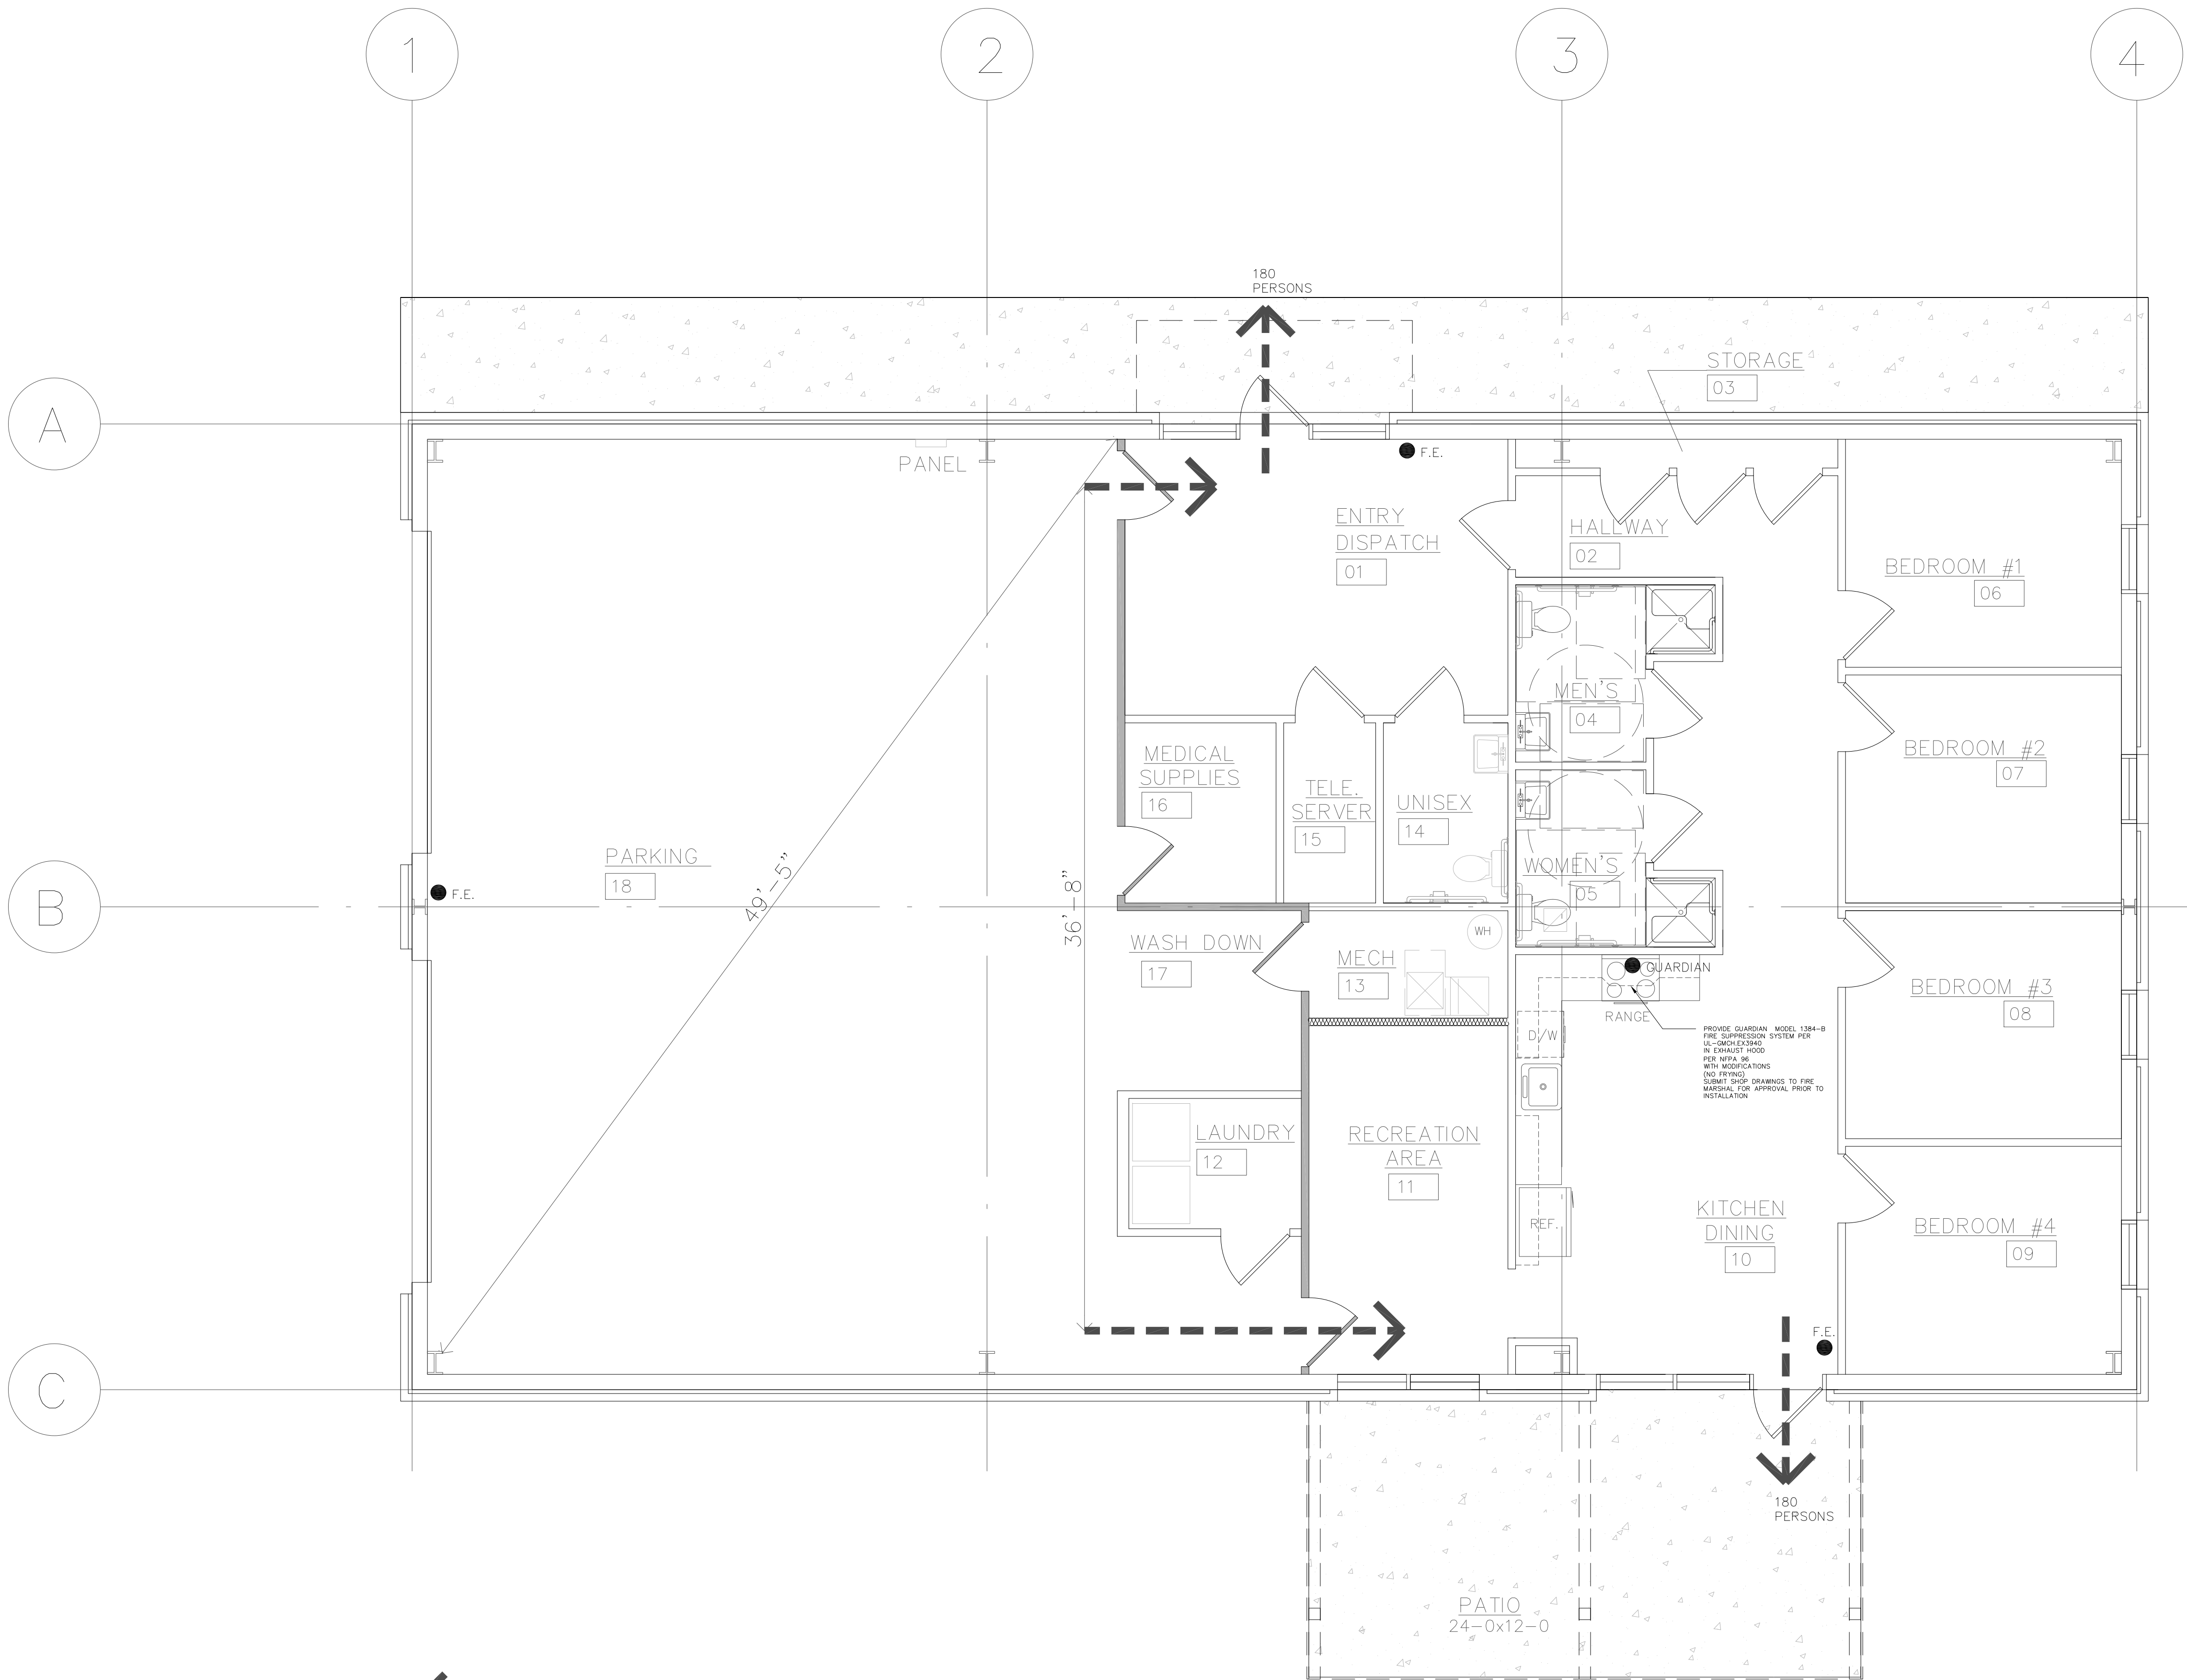

PROJECT NORTH



LIFE SAFETY PLAN

SCALE: 1/4"= 1'-0"

SEE E-1 FOR EMERGENCY LIGHTING LOCATIONS

● F.E. DENOTES PORTABLE FIRE EXTINGUISHER PER NFPA 10. LOCATIONS PER FIRE DEPT.