KEY NOTES:

1. EMERGENCY LIGHT FIXTURES SHALL BE UNSWITCHED.
2. EXTERIOR LIGHTS SHALL BE CONTROLELD VIA PE CELL AND TIME–CLOCK.

B&L
BRANHAM & LLOYD,LLC
CONSULTING ENGINEERS
3345 HUTCHINSON ROAD
SUITE E, CUMMING, GA 30040
PHONE: (470) 436-0803
EMAIL: INFO@BRANHAMLLOYD.COM

09/11/2026

GEORGIA REGISTERED No. PE034794 PROFESSIONAL ENGINEER BRANHAM

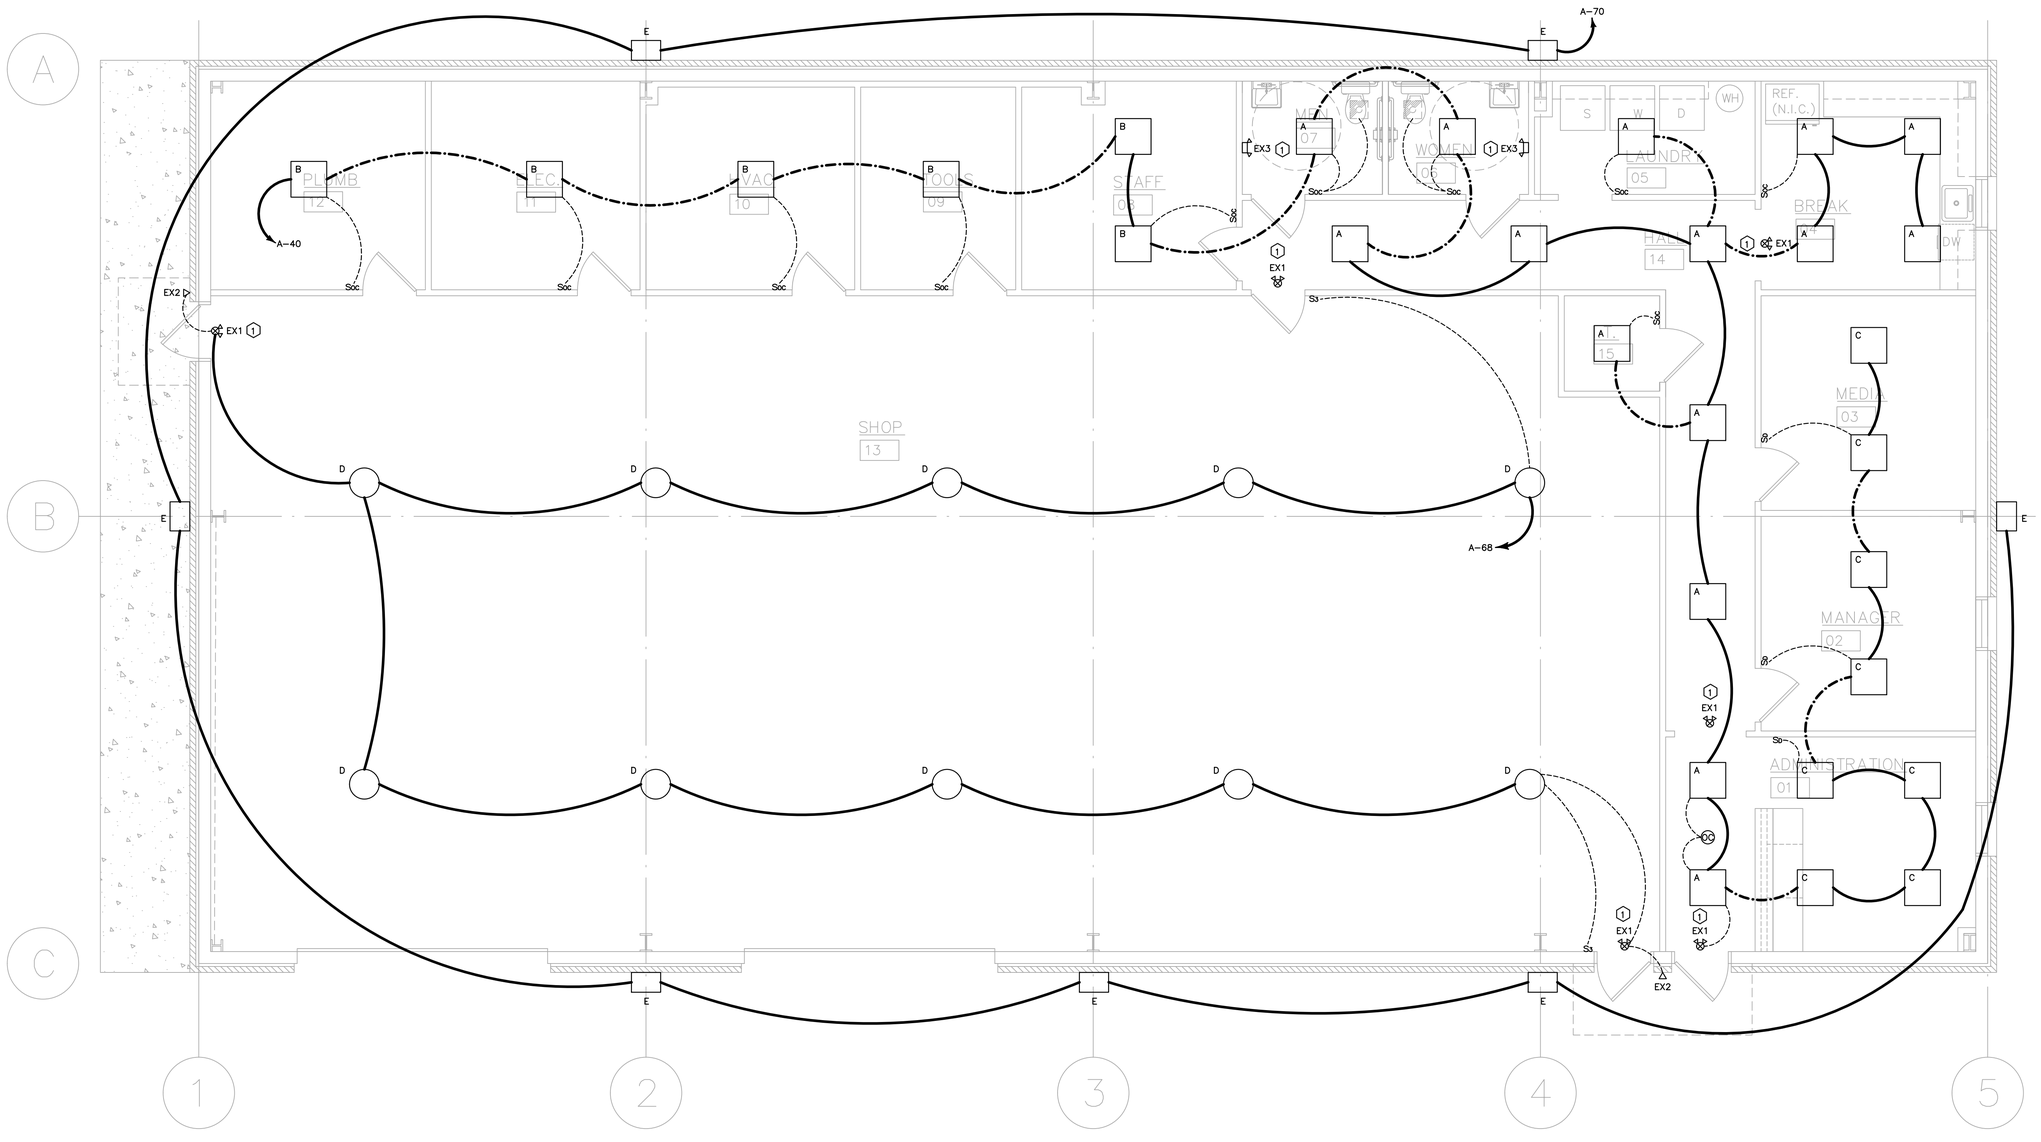

1 / E1 FLOOR PLAN – LIGHTING

SCALE: 1/4"= 1'–0"

REVISIONS

#	DATE

A NEW FACILITIES SHOP FOR:

OCONEE COUNTY

WATKINSVILLE, GEORGIA

RIDDLE ARCHITECTURE, P.C

AMERICAN INSTITUTE OF ARCHITECTS

497 BROOMSEDGE COURT
BOLIVIA, NC
28422
(404) 285-8646

TITLE: FLOOR PLAN - LIGHTING

JOB #: 2501

DATE: 09.11.26

SHEET #

E1