


Table with columns: REVISIONS, NO., DATE, ISSUE.

PEACH STATE CONSTRUCTION COMPANY OFFICE

FLOOR PLAN - LIGHTING

E-201

PRICING ONLY

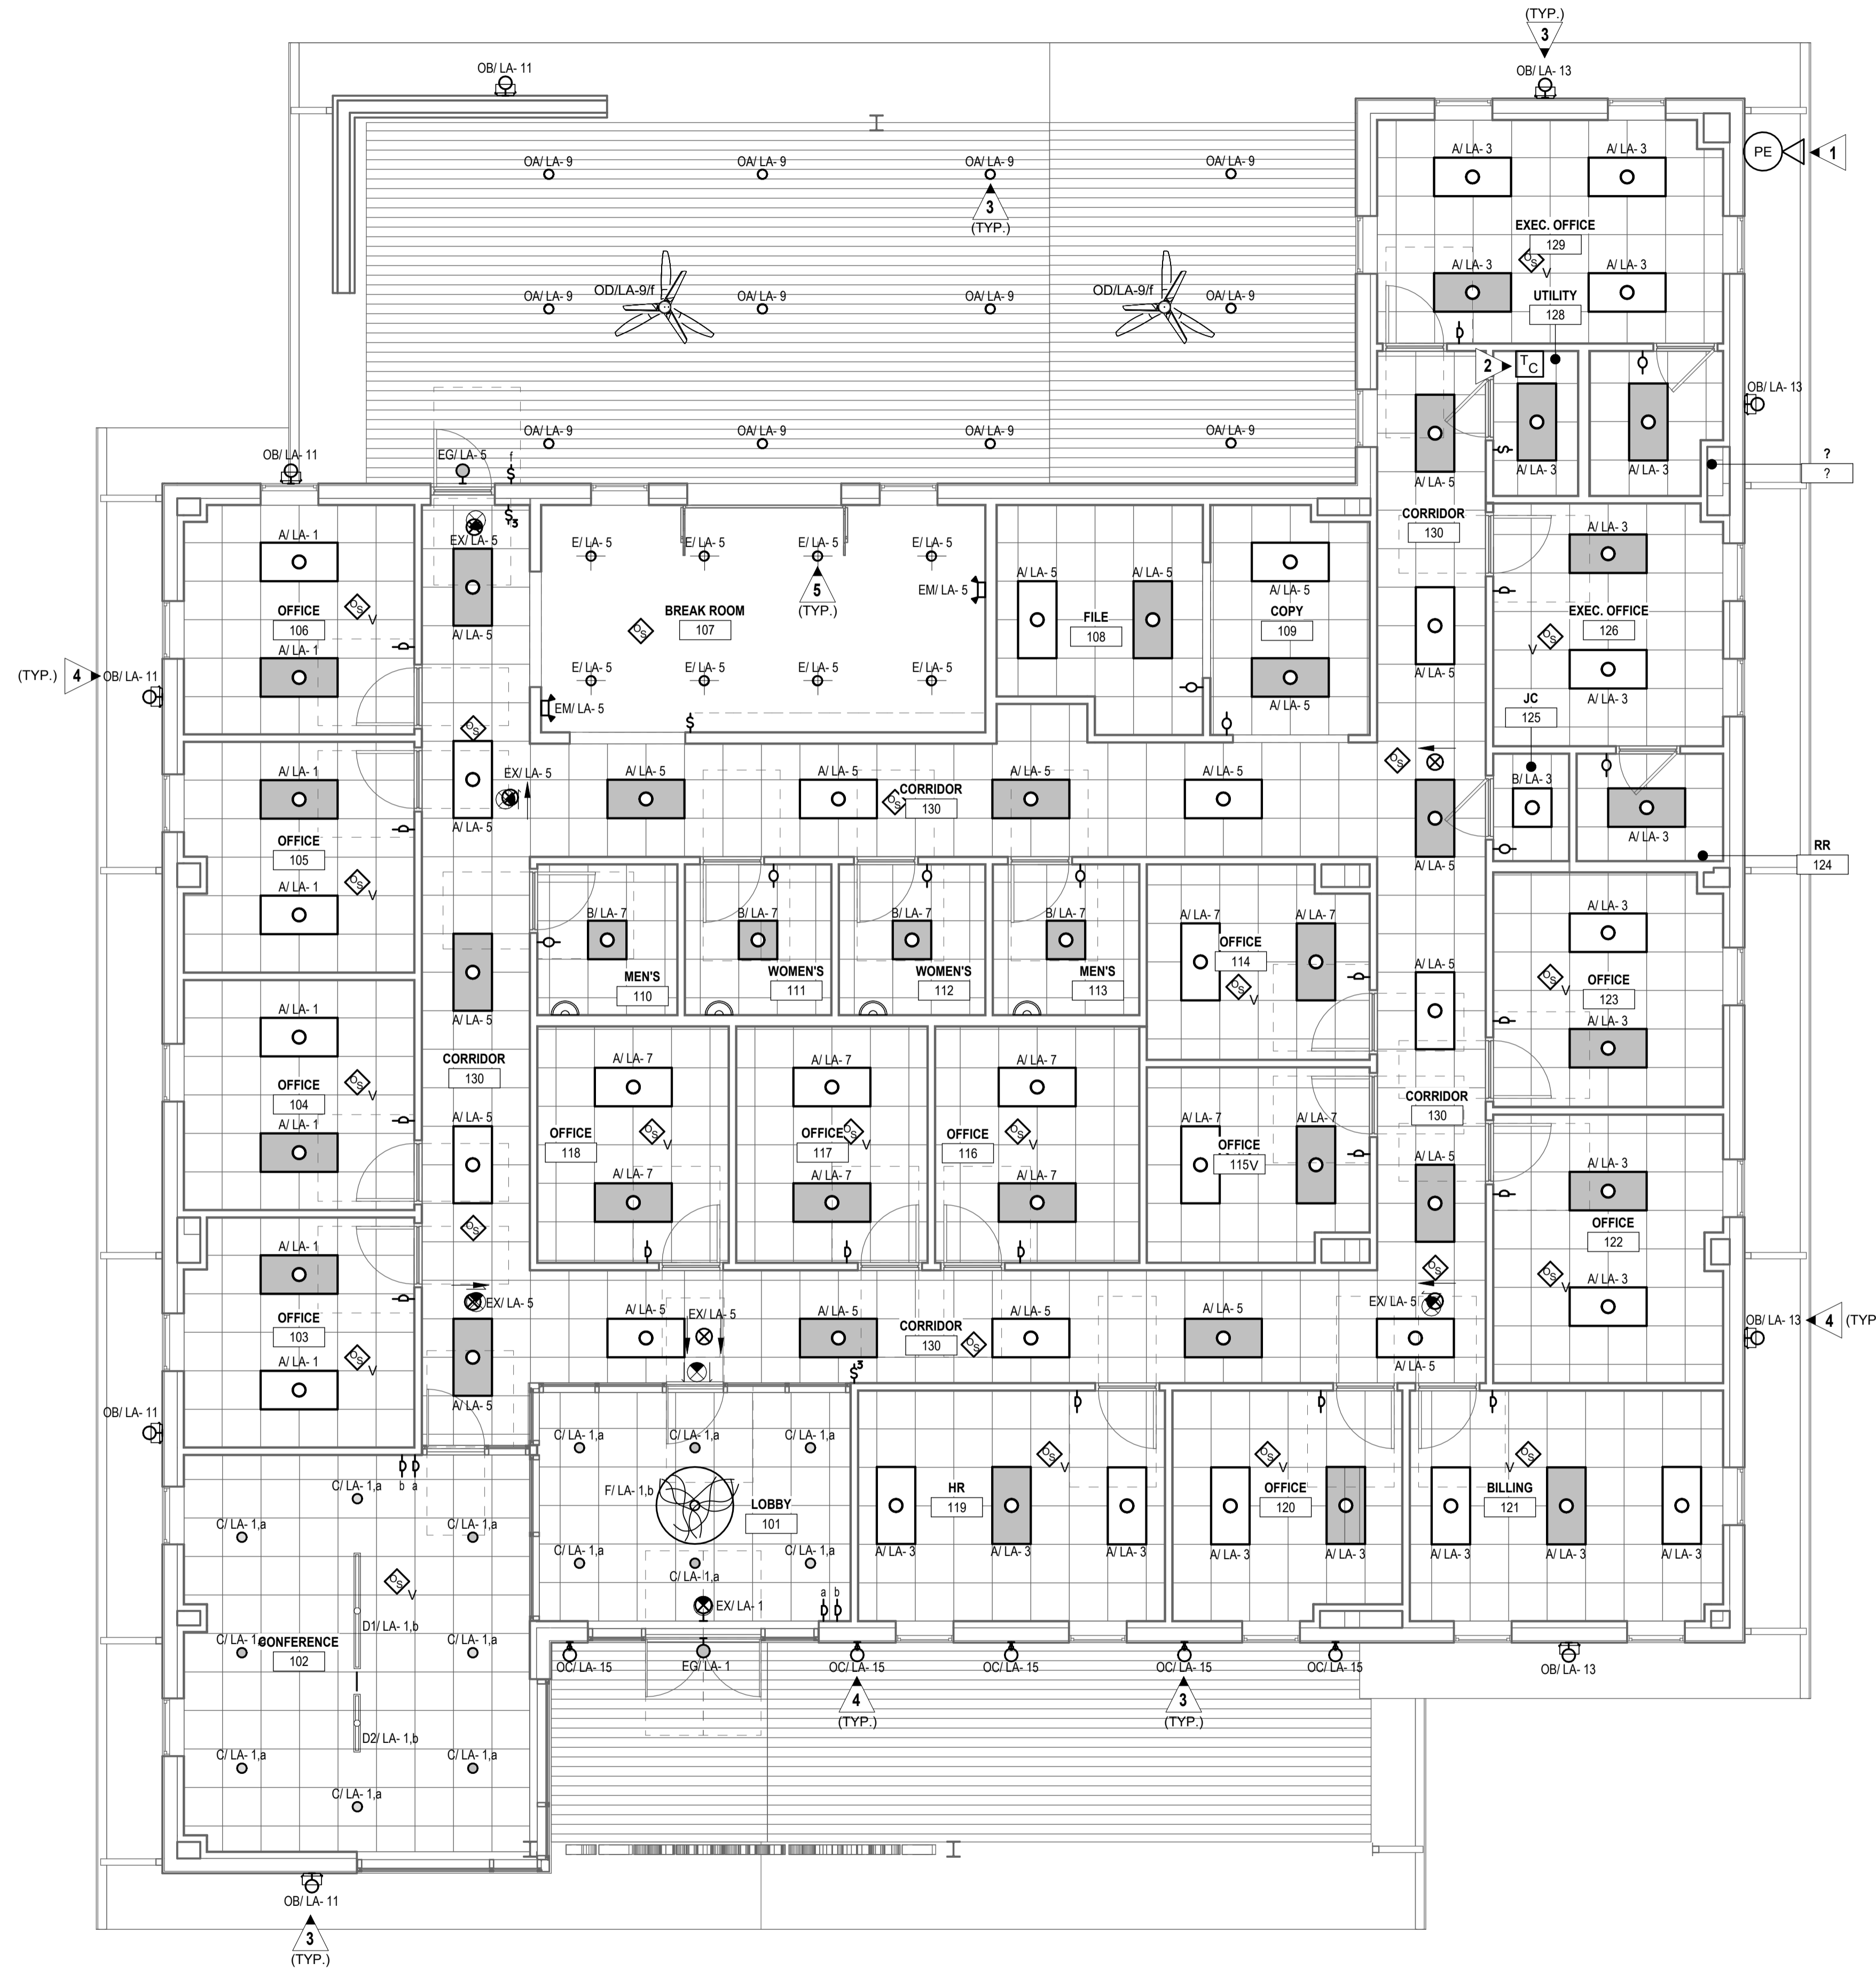


1 FLOOR PLAN - LIGHTING E-201 SCALE: 3/16" = 1'-0"

GENERAL NOTES:

- 1. LOWER CASE LETTERS AT SWITCHES AND LIGHT FIXTURES ON THIS SHEET ARE SHOWN TO CLARIFY THE FIXTURES BEING CONTROLLED BY THE ASSOCIATED SWITCHES.
2. THIS PLAN INDICATES AREAS TO BE CONTROLLED BY MOTION SENSORS...
3. PROVIDE UN-SWITCHED "HOT" CONDUCTOR TO EACH EXIT SIGN, EMERGENCY FIXTURE, AND NIGHT LIGHT FIXTURE.
4. PROVIDE NEUTRAL CONDUCTOR TO ALL WALL MOUNTED OCCUPANCY SENSORS...
5. CONTRACTOR SHALL PROVIDE CLASS 2, 600 VOLT RATED, 0-10 VOLT CONTROL WIRING FOR ALL L.E.D. FIXTURES...
6. FOR ALL CONDUIT INSTALLATIONS, CONTRACTOR SHALL PULL #18 AWG TFN SOLID COPPER CONTROL WIRING...
7. THERE ARE NO SWITCHPACKS SHOWN ON THIS PLAN...
8. CEILING SENSORS ARE TO BE MOUNTED AWAY FROM ANY STRONG AIRFLOW...
9. ALL SENSORS SHALL BE CEILING MOUNTED EXCEPT WHERE CEILING HEIGHTS EXCEED 15 FT.-0 IN...
10. EXIT SIGN MOUNTING IS TO BE WITH BOTTOM OF FIXTURE A MAXIMUM OF 48" ABOVE INDICATING DOOR OR PATH.

KEYED NOTES:

- 1. LOCATE P.E. CELL FACING NORTH, CLEAR OF MAN MADE LIGHT SOURCES...
2. PROVIDE 365 DAY DIGITAL PROGRAMMABLE TYPE ELECTRONIC CONTROL TIME CLOCK WITH MINIMUM 6 CONTACTS...
3. ROUTE VIA 6 POLE EXTERIOR LIGHTING CONTACTOR/TIME CLOCK LOCATED ADJACENT PANELS...
4. COORDINATE EXACT MOUNTING HEIGHT WITH ARCHITECTURAL PRIOR TO ROUGH-IN.
5. COORDINATE EXACT PENDANT SUSPENSION HEIGHT WITH ARCHITECTURAL PRIOR TO ROUGH-IN.

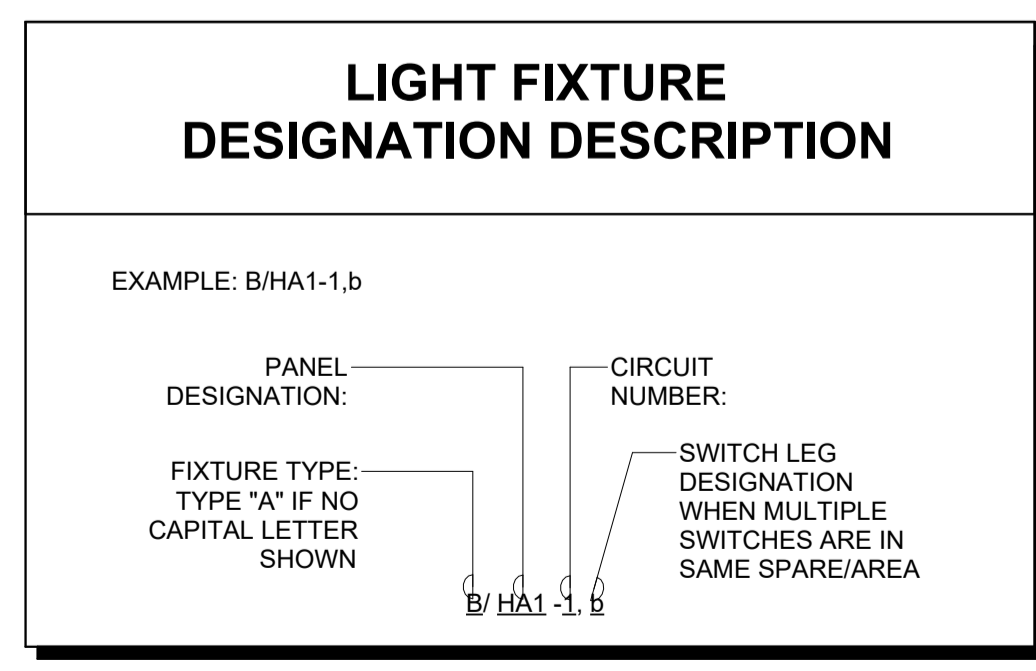

PROVIDE ALL BRANCH CIRCUIT CONDUIT/CONDUCTORS AS NECESSARY TO CONNECT ALL DEVICES SHOWN ON THE CIRCUIT. PROVIDE DEDICATED NEUTRALS FOR ALL CIRCUITS.

