LEGEND NOTES: (THIS SHEET ONLY)

1. DUPLEX RECEPTACLE FLUSH IN CEILING FOR CONNECTION TO GARAGE DOOR OPENERS.
2. WHITE (NOT IVORY) DUPLEX RECEPTACLE FLUSH IN CEILING.
3. PROVIDE WALER #2 DUCT WITHOUT PRESETS. PROVIDE AFTERSET WITH FLUSH CARPET COVERPLATE #829PS-BLK.
4. PROVIDE WALKER #2 ELBOW UP TO 6" X 6" JUNCTION BOX IN WALL OF SOUND MIXING ROOM (BOX AT 18" AFF).
5. PROVIDE FLUSH BOX WITH DUPLEX ISOLATED GROUND RECEPTACLE WITH HINGED DOORS.
6. TWO GANG, FLUSH BOX WITH (1) DUPLEX RECEPTACLE. PROVIDE BLACK CARPET COVERPLATE WITH COMMUNICATIONS ACCESS.
7. 3/4" C. TO ABOVE CEILING FOR DATA/TELEPHONE CABLE.
8. FLUSH ONE-GANG BOX WITH DUPLEX RECEPTACLE.
9. PROVIDE 24 VOLT BELL AT BOTTOM OF JOISTS. CONNECT TO WP DOOR BELL BUTTON.

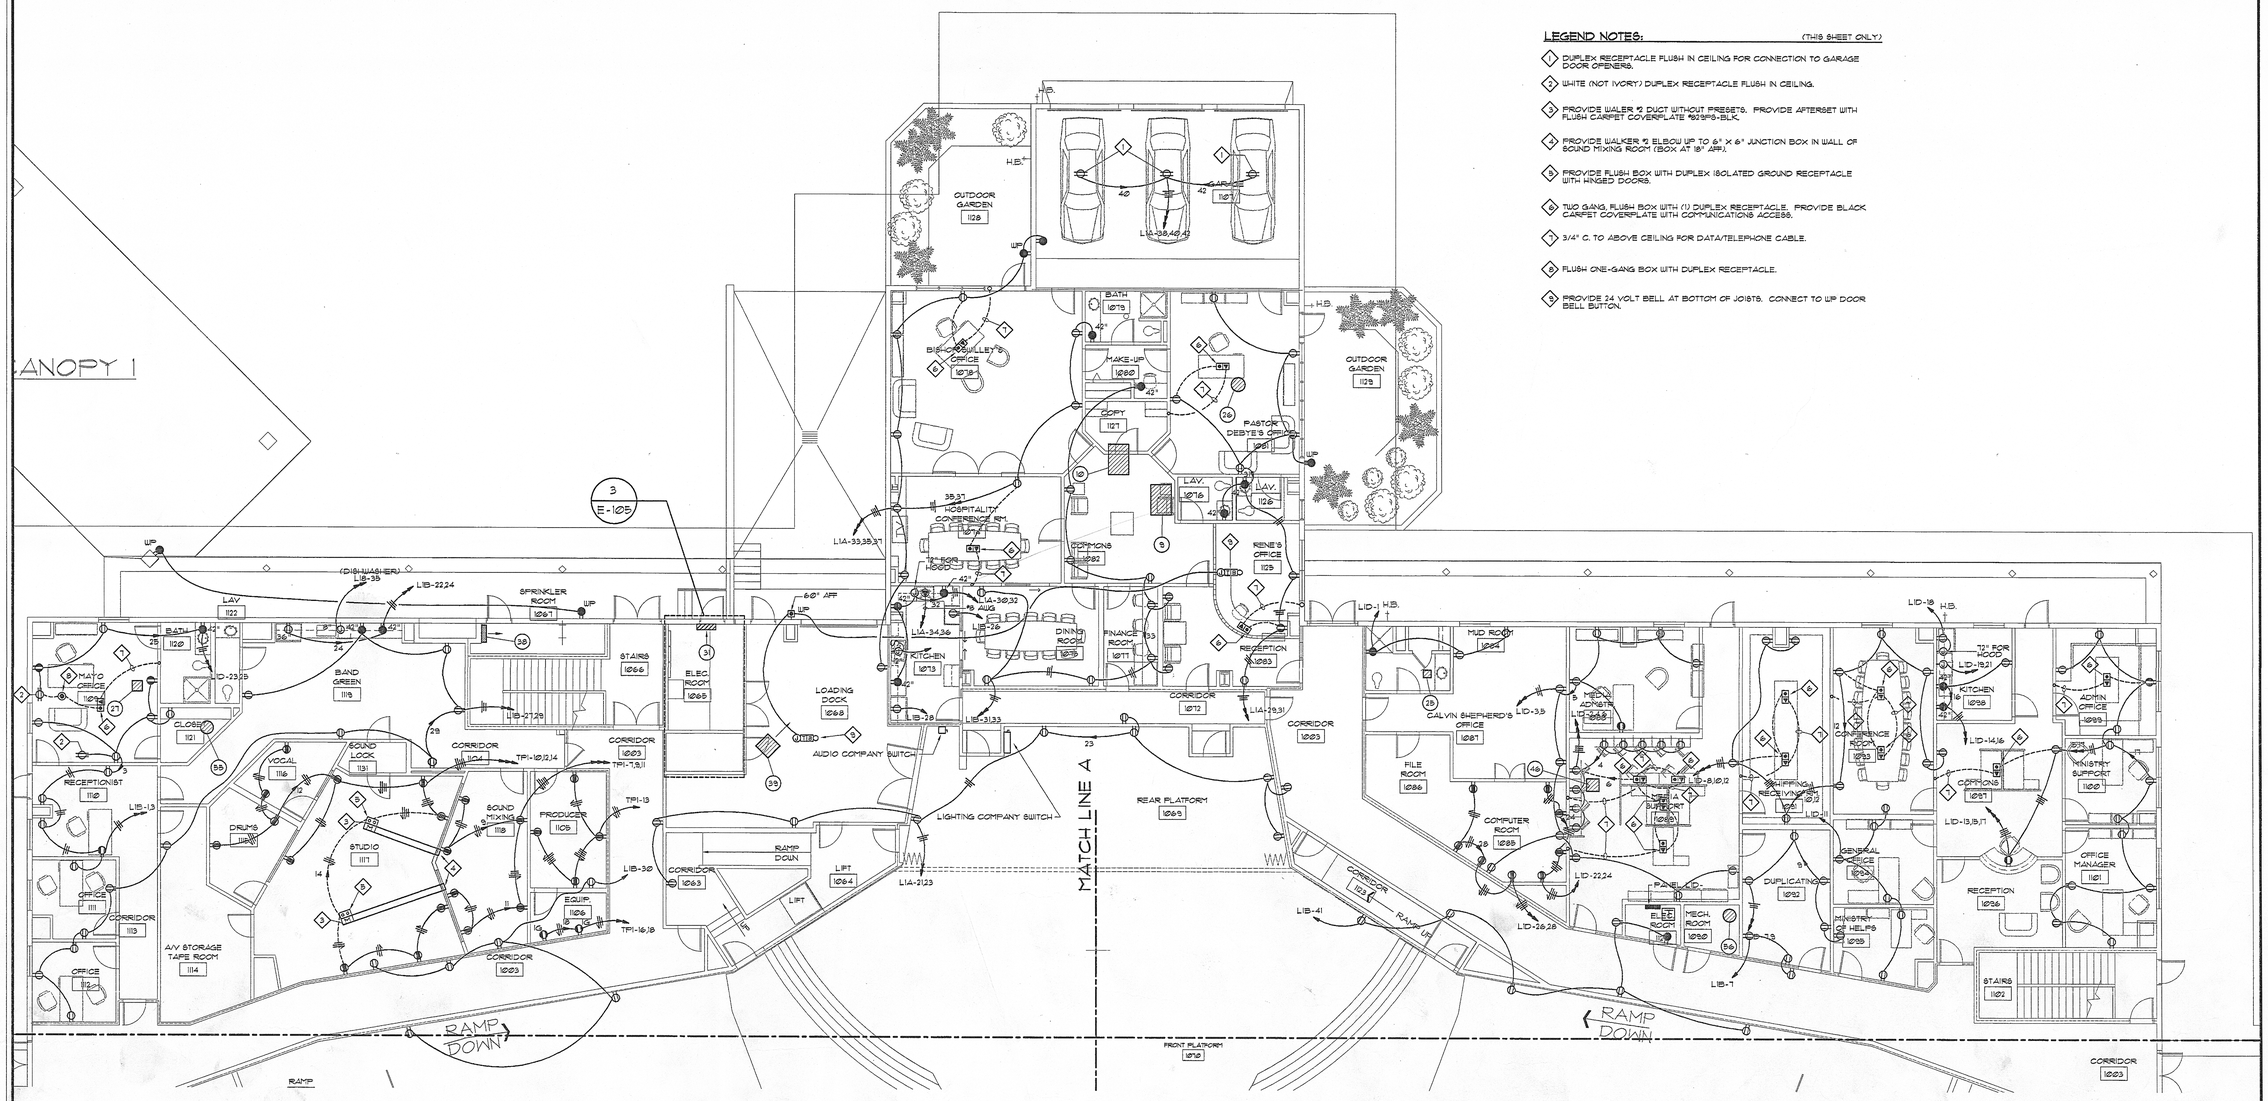

1 E-105 FIRST FLOOR PLAN - PART 3 - POWER
SCALE: 1/8"=1'-0"

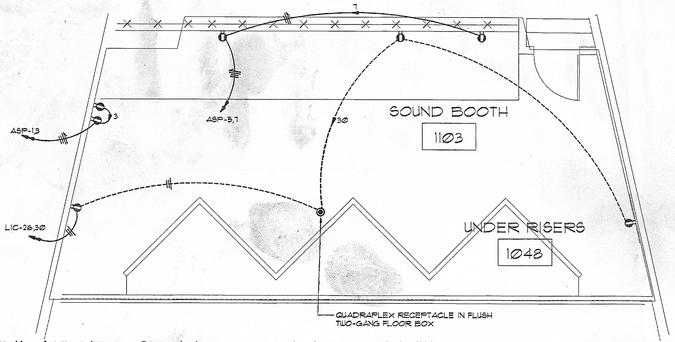

2 E-105 ENLARGED SOUND BOOTH ROOM #1103 PLAN - ELECTRICAL
SCALE: 1/4"=1'-0"

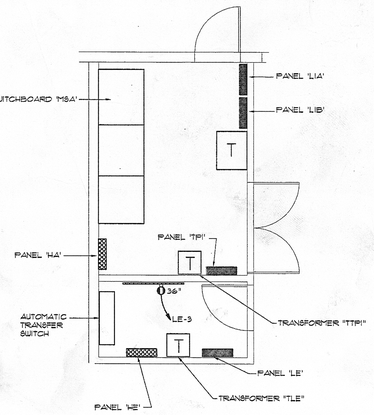

3 E-105 ENLARGED ELECTRICAL ROOM #1065 PLAN - ELECTRICAL
SCALE: 1/4"=1'-0"

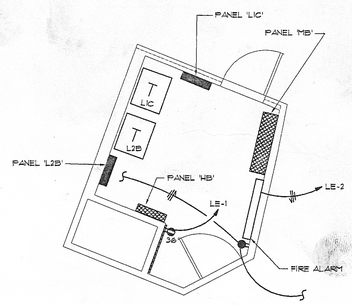

4 E-105 ENLARGED ELECTRICAL ROOM #1051 PLAN - ELECTRICAL
SCALE: 1/4"=1'-0"

revisions

for construction

This drawing, as an instrument of service, is and shall remain the property of the Architects and Engineers and shall not be reproduced, published or used in any way without the written permission of the Architect or Engineer.

Copyright ©1998 By John Ware & Associates, Inc.

seal

GEORGIA REGISTERED No. 7099 PROFESSIONAL GERALD E. ROBERDS
5-30-03

John Ware & Associates, Inc.
Architects & Engineers

1954 Airport Road
Suite 100
Atlanta, GA 30341
(770) 451-1921
FAX (770) 457-1920

project
CHURCH IN THE NOW

address
1873 & 1933 IRIS DRIVE
CONYERS, GA
for
COVENANT SERVICES, INC.
1777 WESLEY WAY
CONYERS, GA

sheet description
FIRST FLOOR PLAN-PART 3-POWER

drawn VJ
checked TWM

job 00-145
date 12/20/01

ROBERDS
CONSULTING ENGINEERS
455 EAST PACES FERRY ROAD, N.E.
SUITE 300
ATLANTA GEORGIA 30305
TELEPHONE (404) 237-8632
FACSIMILE (404) 237-4161

2001439 | TWM

E-105
of

I:\RCE\TIM\CHURHNOW\W439E105.DWG Plotted: May 30, 2003 - 3:27pm by Administrator