


NOTE: ALL LIGHTS SHOWN ON THIS PLAN SHALL AUTOMATICALLY TURN ON UPON OPERATION OF THE GENERATOR DUE TO UTILITY POWER LOSS TO BUILDING.

LEGEND NOTES: (THIS SHEET ONLY)

- ◆ INSTALL FIXTURE WITH BOTTOM OF REFLECTOR AT 1'-0" ABOVE BOTTOM OF CEILING PANELS.
- ◆ CIRCUIT WHERANS ARE TO BE #10 AWG MINIMUM. ALL CIRCUIT WHERANS TO BE ROUTED THROUGH A LIGHTING CONTACTOR THAT IS CONTROLLED VIA AUXILIARY CONTACTS IN THE EMERGENCY GENERATOR AND AUTOMATIC TRANSFER SWITCH. PROVIDE KEY SWITCHES TO MANUALLY OPERATE CONTACTOR SO THAT LIGHTS CAN BE TURNED ON FOR SANCTUARY HOUSEKEEPING.
- ◆ THREE-WAY, KEY SWITCH FLUSH MTD. AT 6'-0" AFF FOR MANUAL CONTROL OF SANCTUARY MAINTENANCE LIGHTING CONTACTOR. PROVIDE 3-WAY AND 4-WAY SWITCHES IN JANITOR CLOSETS 1055 AND 1041.

LIGHTS SHOWN ON THIS PLAN ARE TYPE "SE" UNLESS NOTED OTHERWISE.

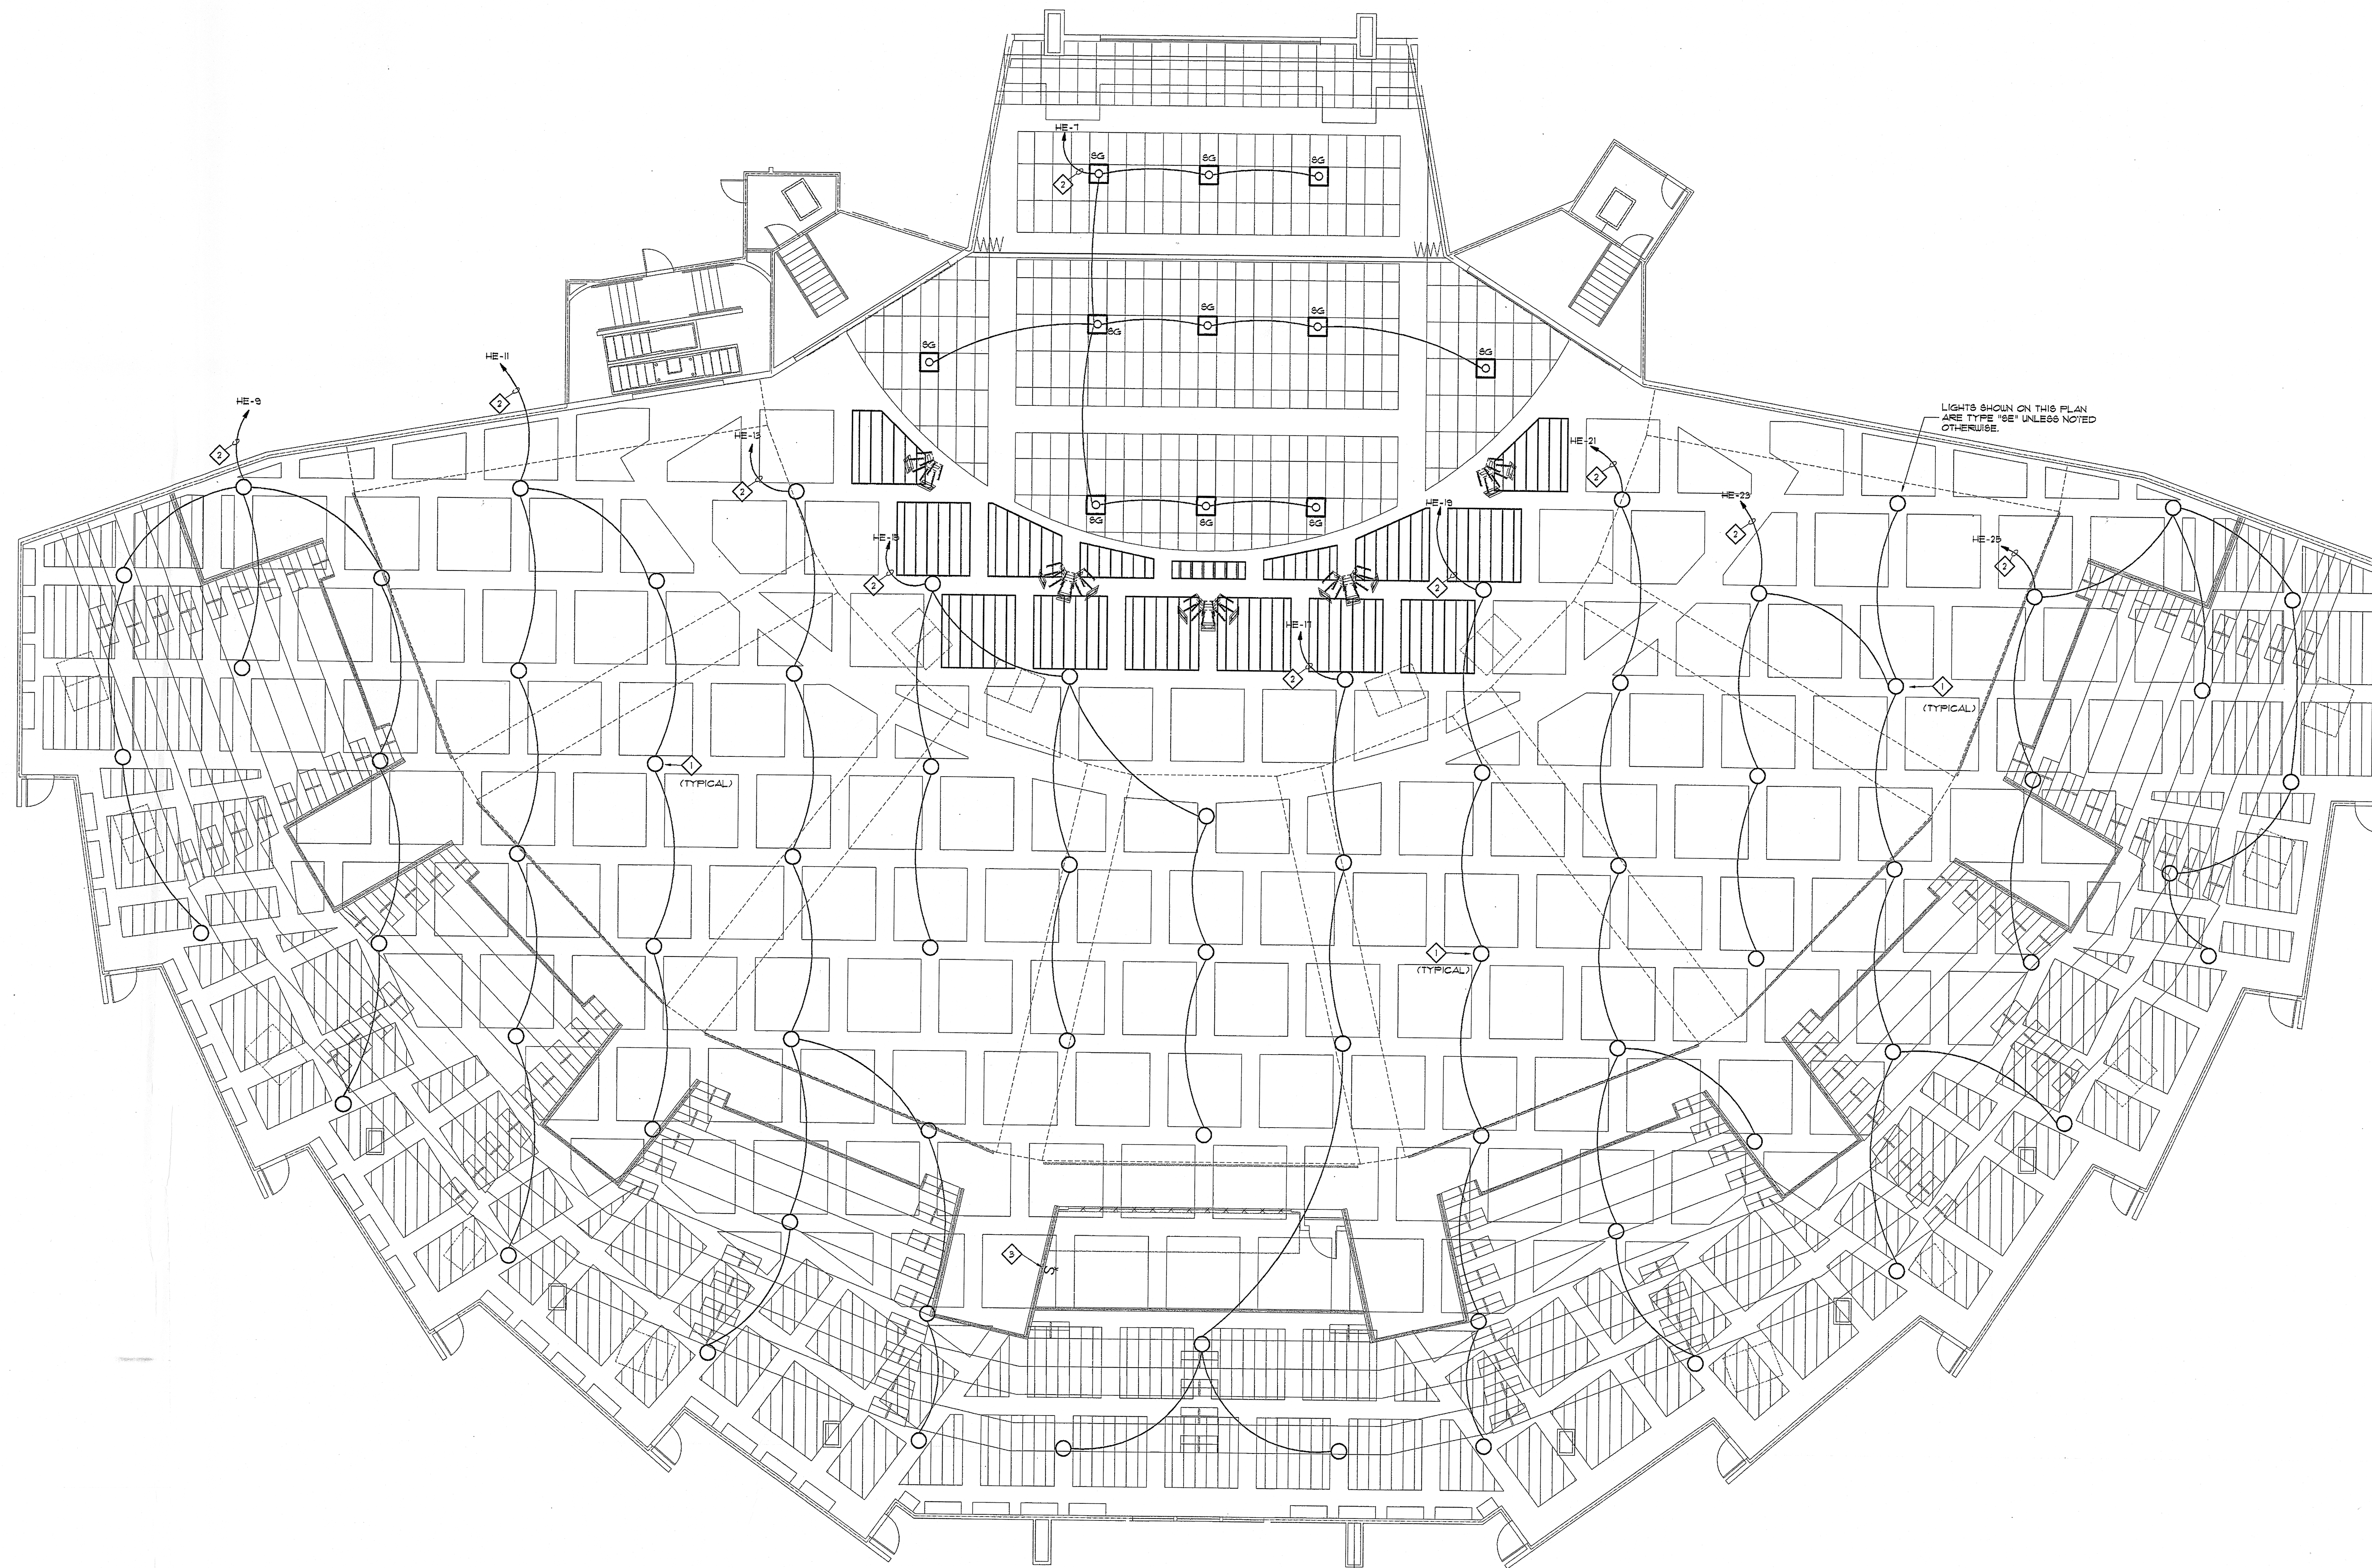


1 SANCTUARY MAINTENANCE/EMERGENCY LIGHTING
E-120 SCALE: 1/8" = 1'-0"

ROBERDS
CONSULTING
ENGINEERS
455 EAST PACES FERRY ROAD, N.E.
SUITE 300
ATLANTA, GEORGIA 30305
TELEPHONE (404) 237-8832
FACSIMILE (404) 237-4181

revisions
5-30-03
CITY REVIEW COMMENTS

for construction
This drawing, as an instrument of service, is and shall remain the property of the Architects and Engineers and shall not be reproduced, published or used in any way without the written permission of the Architect or Engineer.
Copyright ©1998 By
John Ware & Associates, Inc.

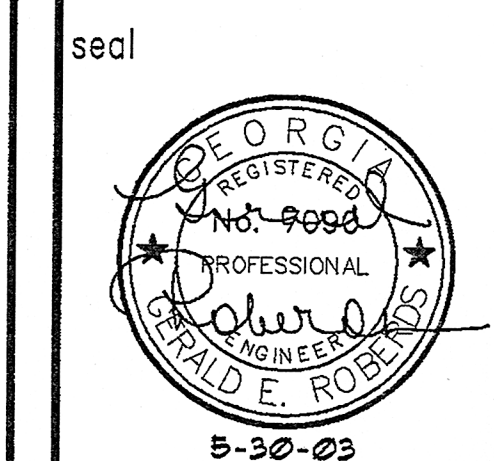

John Ware & Associates, Inc.
Architects & Engineers
1954 Airport Road
Suite 100
Atlanta, GA 30341
(770) 451-1921
FAX (770) 457-1920

project
**CHURCH
IN THE NOW**

address
1873 4 1933
IRIS DRIVE
CONYERS, GA
for
**COVENANT
SERVICES, INC.**
1771 WESLEY WAY
CONYERS, GA

sheet description
**SANCTUARY
MAINTENANCE
LIGHTING**

drawn VJ
checked TUM

job 00-145
date 12/20/01

E-120
of