


LEGEND NOTES:

(THIS SHEET ONLY)

- 1' X 4' LIGHTS THIS ROOM SHALL HAVE TWO BALLASTS, ONE BALLAST SHALL OPERATE THE CENTER LAMP(S) WHILE THE SECOND BALLAST SHALL OPERATE THE OUTER TWO LAMP(S).
- THIS FIXTURE SHALL HAVE BODINE, "GTD", GENERATOR TRANSFER DEVICE INSTALLED TO OPERATE ALL LAMPS. PROVIDE UNSWITCHED POWER FROM LIGHTING CIRCUIT AND POWER FROM GENERATOR PANEL.
- JUNCTION BOX ABOVE CEILING FOR CONNECTION TO EXTERIOR SIGN. PROVIDE CONDUIT FROM BOX TO SIGN LOCATION.
- MOTION DETECTOR SWITCH TO OPERATE LIGHTS INSTALL AT 84" AFF. DETECTOR EQUAL TO SENSOR SWITCH (USD-FDT-1).
- 3-WAY KEY SWITCH FOR CONTROL OF CORRIDOR LIGHTING CONTACTOR. SEE PANEL SCHEDULE NOTE 3 AND 5-109.
- PROVIDE #12 AWG CONDUCTORS TO PANEL.
- PROVIDE 4-WAY, KEY SWITCH AT 84" AFF. FOR CONTROL OF SANCTUARY MAINTENANCE LIGHTING CONTACTOR. SEE 3-WAY SWITCH LOCATED IN ROOM #1055 AND 3-WAY SWITCH LOCATED IN SOUND BOOTH.

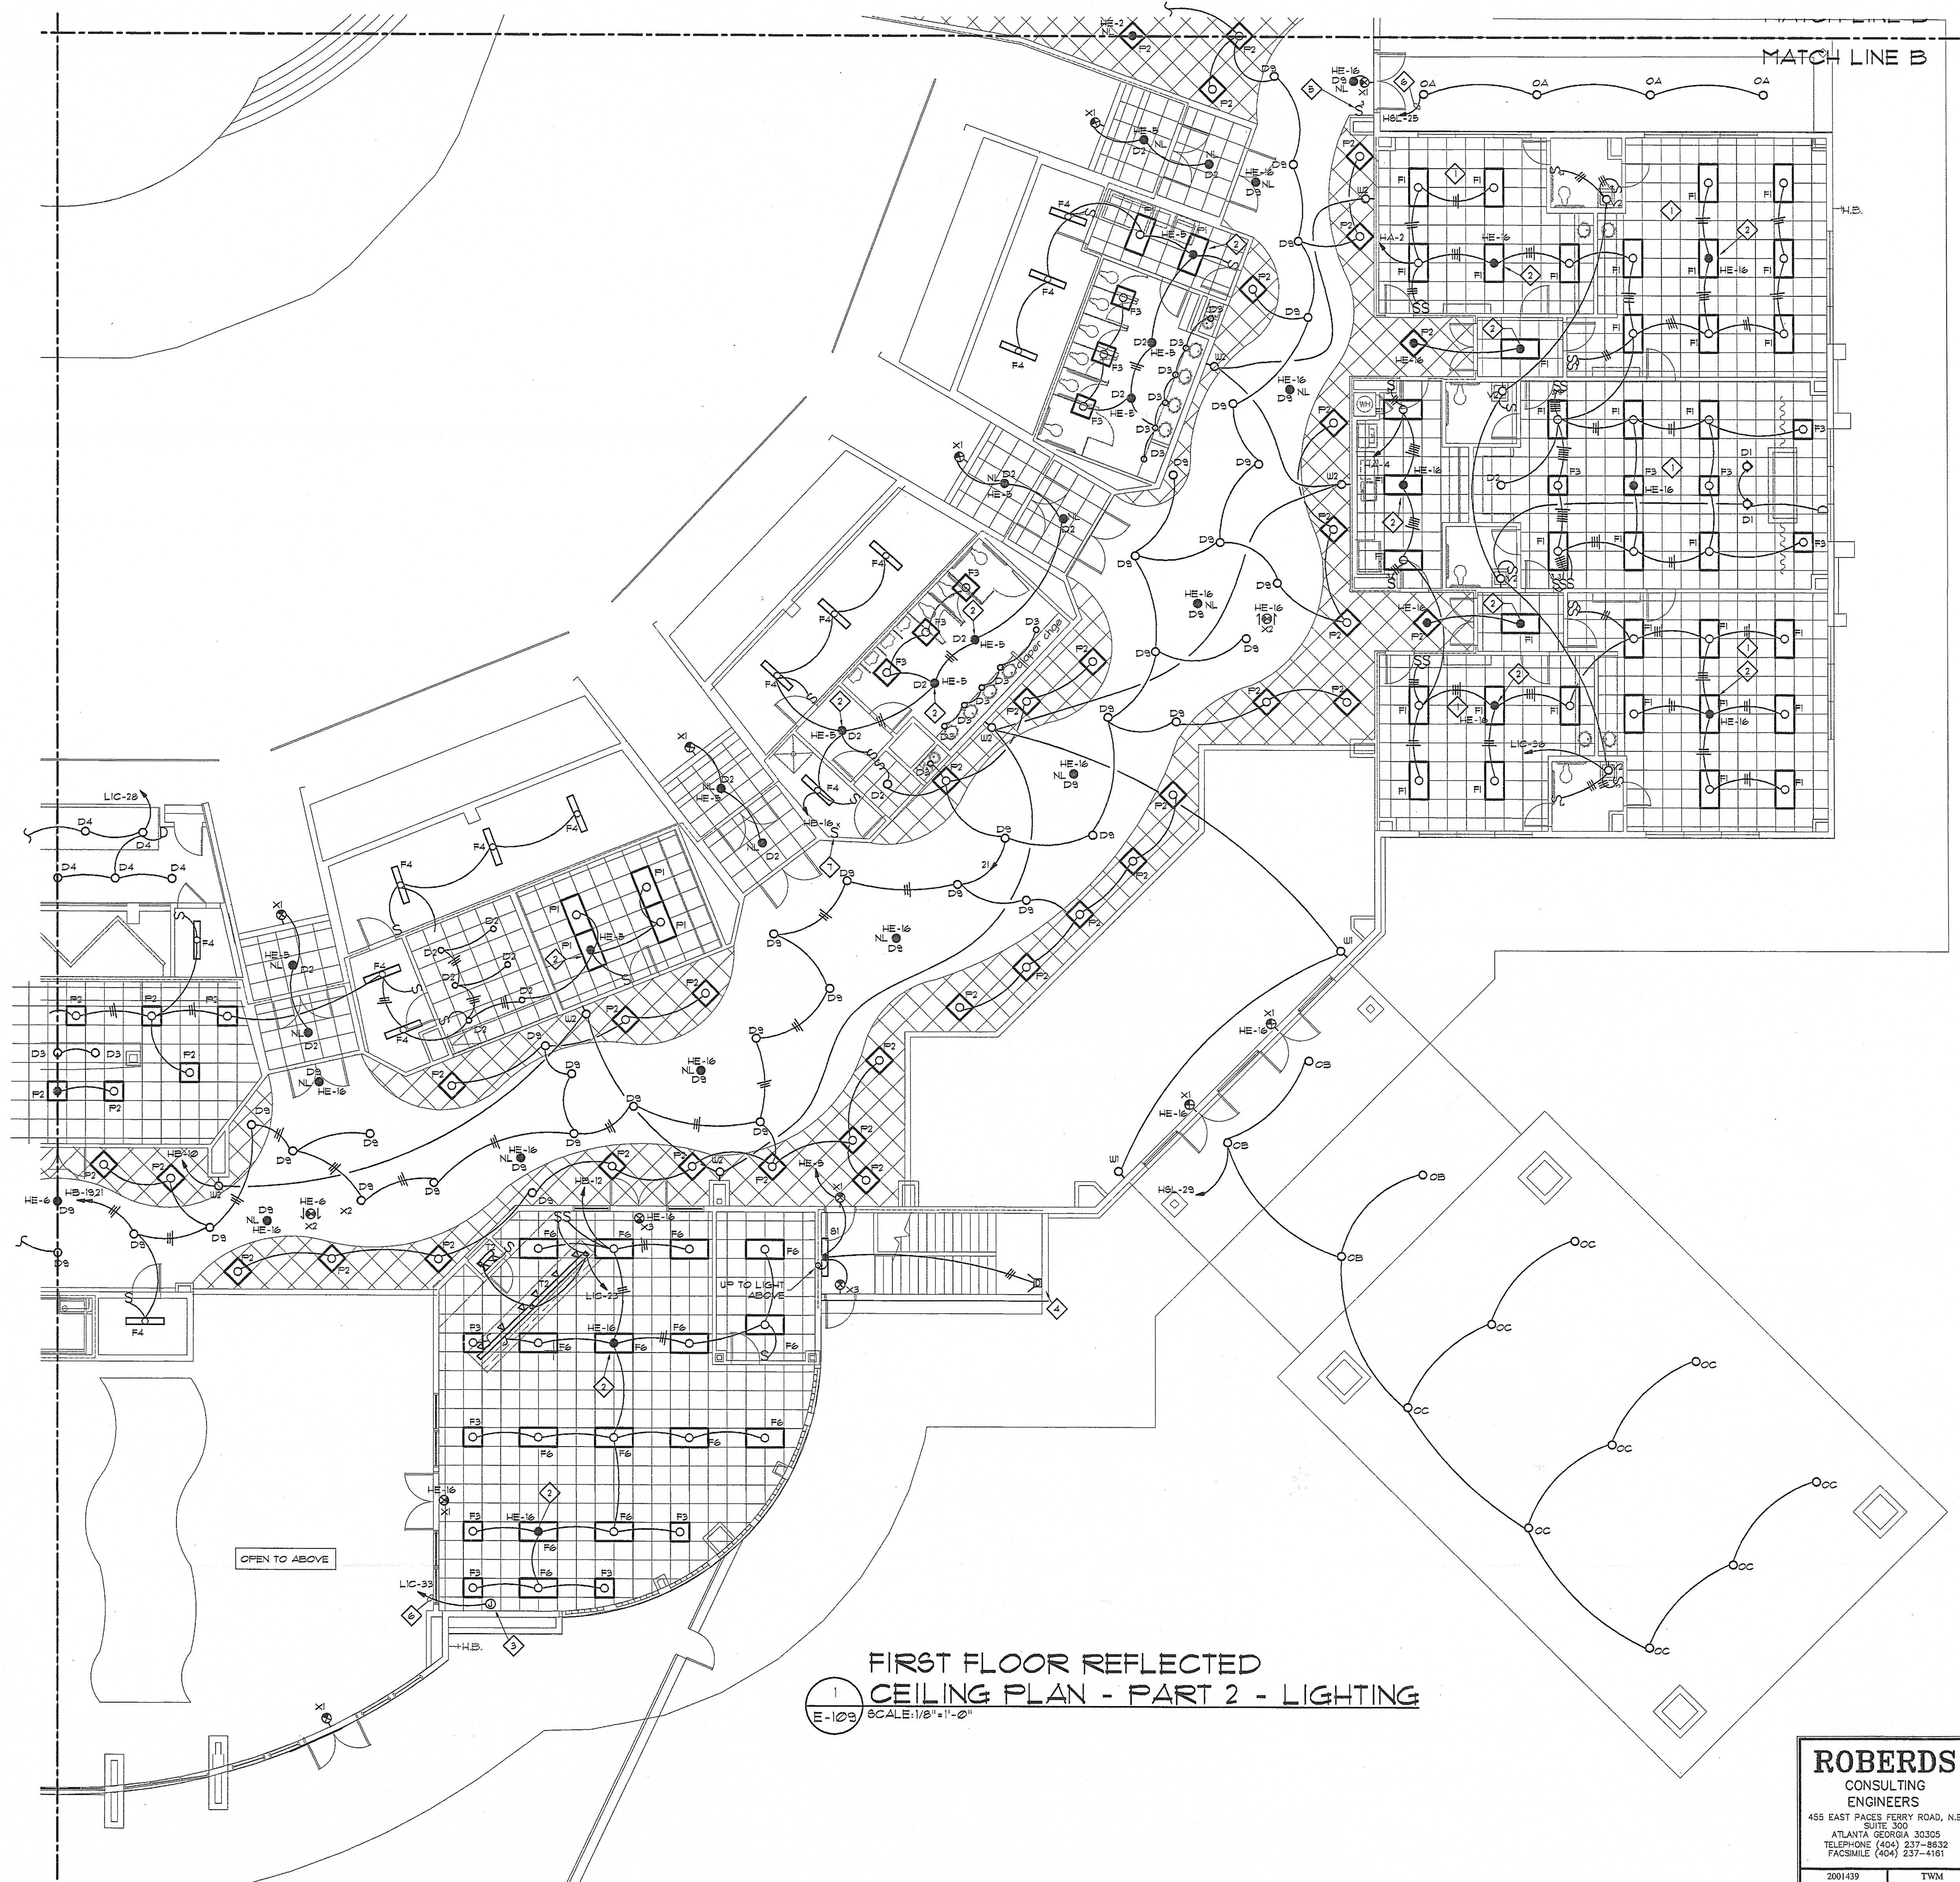

revisions

for construction

This drawing, as an instrument of service, is and shall remain the property of the Architects and Engineers and shall not be reproduced, published or used in any way without the written permission of the Architect or Engineer.

Copyright © 1998 By John Ware & Associates, Inc.

seal



John Ware & Associates, Inc.
Architects & Engineers

1954 Airport Road
Suite 100
Atlanta, GA 30341
(770) 451-1921
FAX (770) 457-1920

project
**CHURCH
IN THE NOW**

address
1873 4 1933
1819 DRIVE
CONYERS, GA
for
**COVENANT
SERVICES, INC.**
1771 WESLEY WAY
CONYERS, GA

sheet description
**FIRST FLOOR
REFL. CEILING
PLAN - PART 2
-LIGHTING**
drawn VJ
checked TUM

job 00-145

date 12/20/01

E-109
of

**ROBERDS
CONSULTING
ENGINEERS**
455 EAST PACES FERRY ROAD, N.E.
SUITE 300
ATLANTA, GEORGIA 30305
TELEPHONE (404) 237-8832
FACSIMILE (404) 237-1101
2001439 TWM